


GEO. M. YOUNG
124

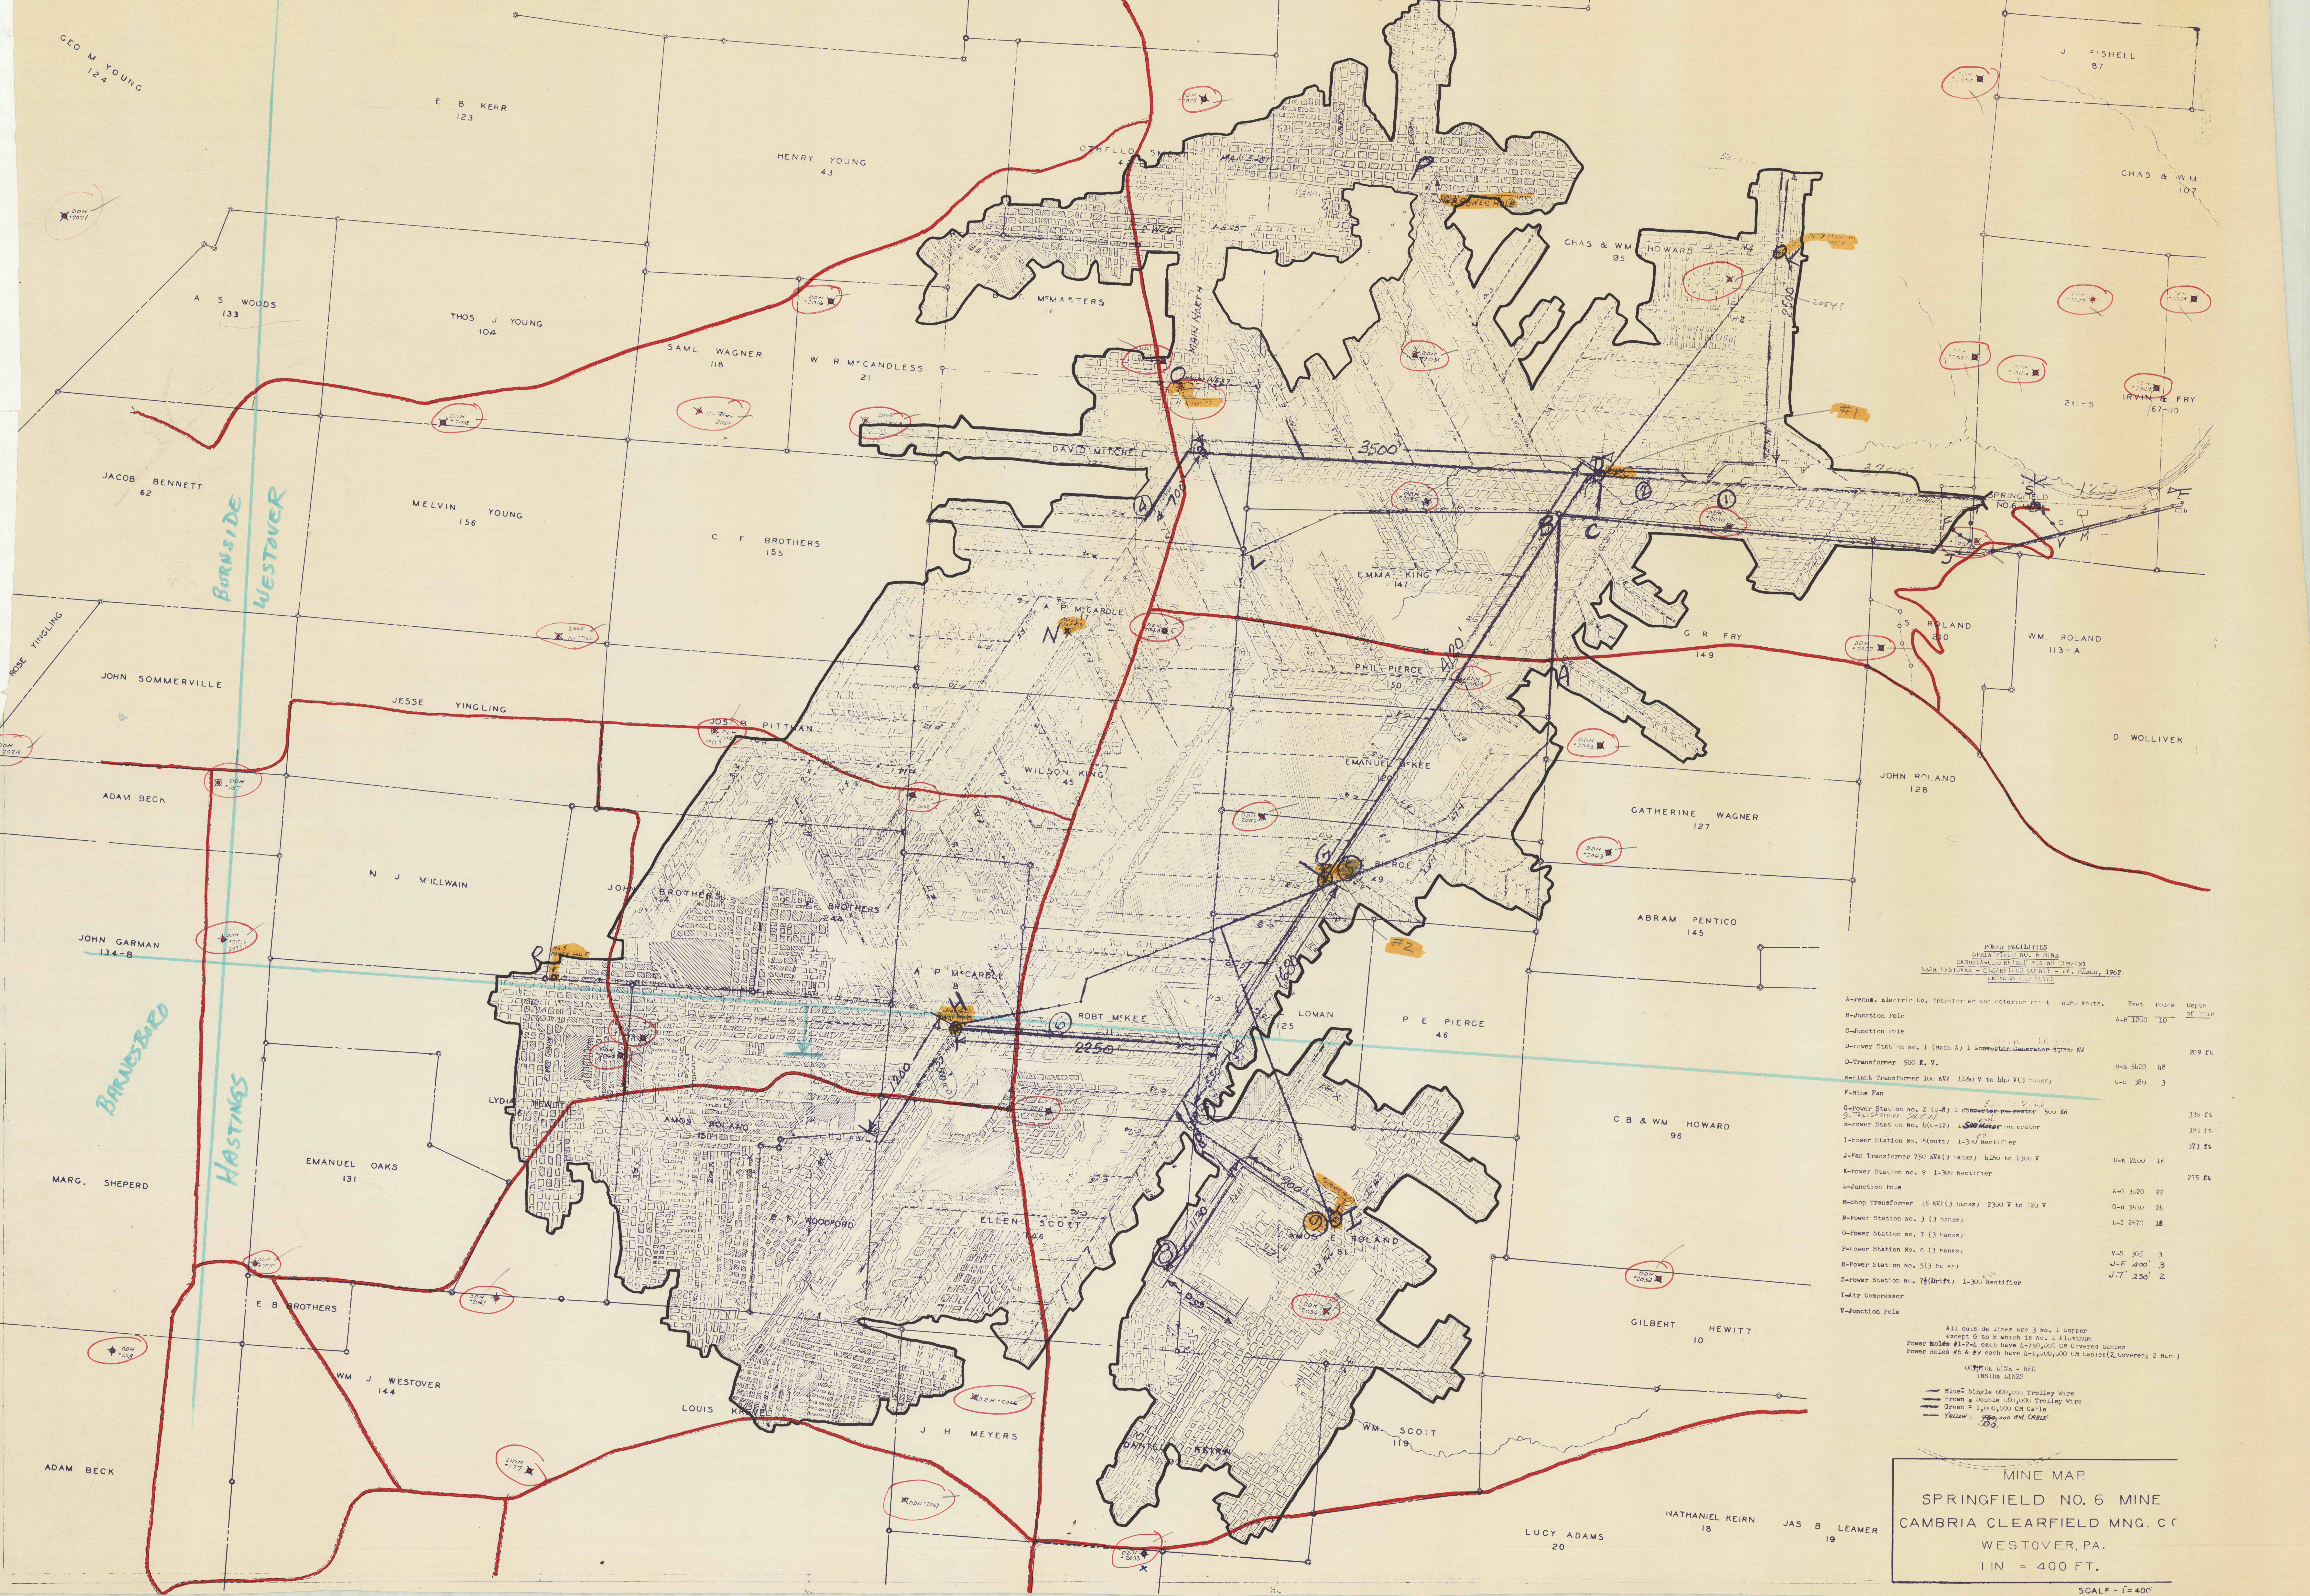

STANDARD SPECIFICATIONS
SPRINGFIELD NO. 6 MINE
CAMBRIA CLEARFIELD MNG. CO.
WESTOVER, PA.
REVISIONS - 10/10/1910 - 10/10/1910 - 10/10/1910 - 10/10/1910 - 10/10/1910

Letter	Description	Feet	Volts	Depth
A	Power Station No. 1 (Main 2) 1 Generator 1000 KW	209	209	10
B	Power Station No. 2 (1-4) 1 Generator 500 KW	339	339	10
C	Power Station No. 3 (3 hanks)	373	373	10
D	Power Station No. 4 (3 hanks)	275	275	10
E	Power Station No. 5 (3 hanks)	305	305	10
F	Power Station No. 6 (3 hanks)	400	400	10
G	Power Station No. 7 (3 hanks)	250	250	10
H	Power Station No. 8 (3 hanks)	305	305	10
I	Power Station No. 9 (3 hanks)	400	400	10
J	Power Station No. 10 (3 hanks)	250	250	10
K	Power Station No. 11 (3 hanks)	305	305	10
L	Power Station No. 12 (3 hanks)	400	400	10
M	Power Station No. 13 (3 hanks)	250	250	10
N	Power Station No. 14 (3 hanks)	305	305	10
O	Power Station No. 15 (3 hanks)	400	400	10
P	Power Station No. 16 (3 hanks)	250	250	10
Q	Power Station No. 17 (3 hanks)	305	305	10
R	Power Station No. 18 (3 hanks)	400	400	10
S	Power Station No. 19 (3 hanks)	250	250	10
T	Power Station No. 20 (3 hanks)	305	305	10
U	Power Station No. 21 (3 hanks)	400	400	10
V	Power Station No. 22 (3 hanks)	250	250	10

All outside lines are 3 No. 1 Copper
except 9 to 11 which is No. 1 Aluminum
Power poles #1-24, each have 4-1/2" dia. or 6" covered cables
Power poles #6 & #9 each have 4-1/2" dia. or 6" covered cables (2 hanks)

OUTSIDE LINES - RED
INSIDE LINES
Blue = Single 000,000 Trolley Wire
Green = Double 000,000 Trolley Wire
Yellow = 1,000,000 CM Cable
Red = 300,000 CM Cable

MINE MAP
SPRINGFIELD NO. 6 MINE
CAMBRIA CLEARFIELD MNG. CO.
WESTOVER, PA.
1 IN = 400 FT.