METHOD OF GROUNDING UNDERGROUND EQUIPMENT TO DC INSULATED LINE

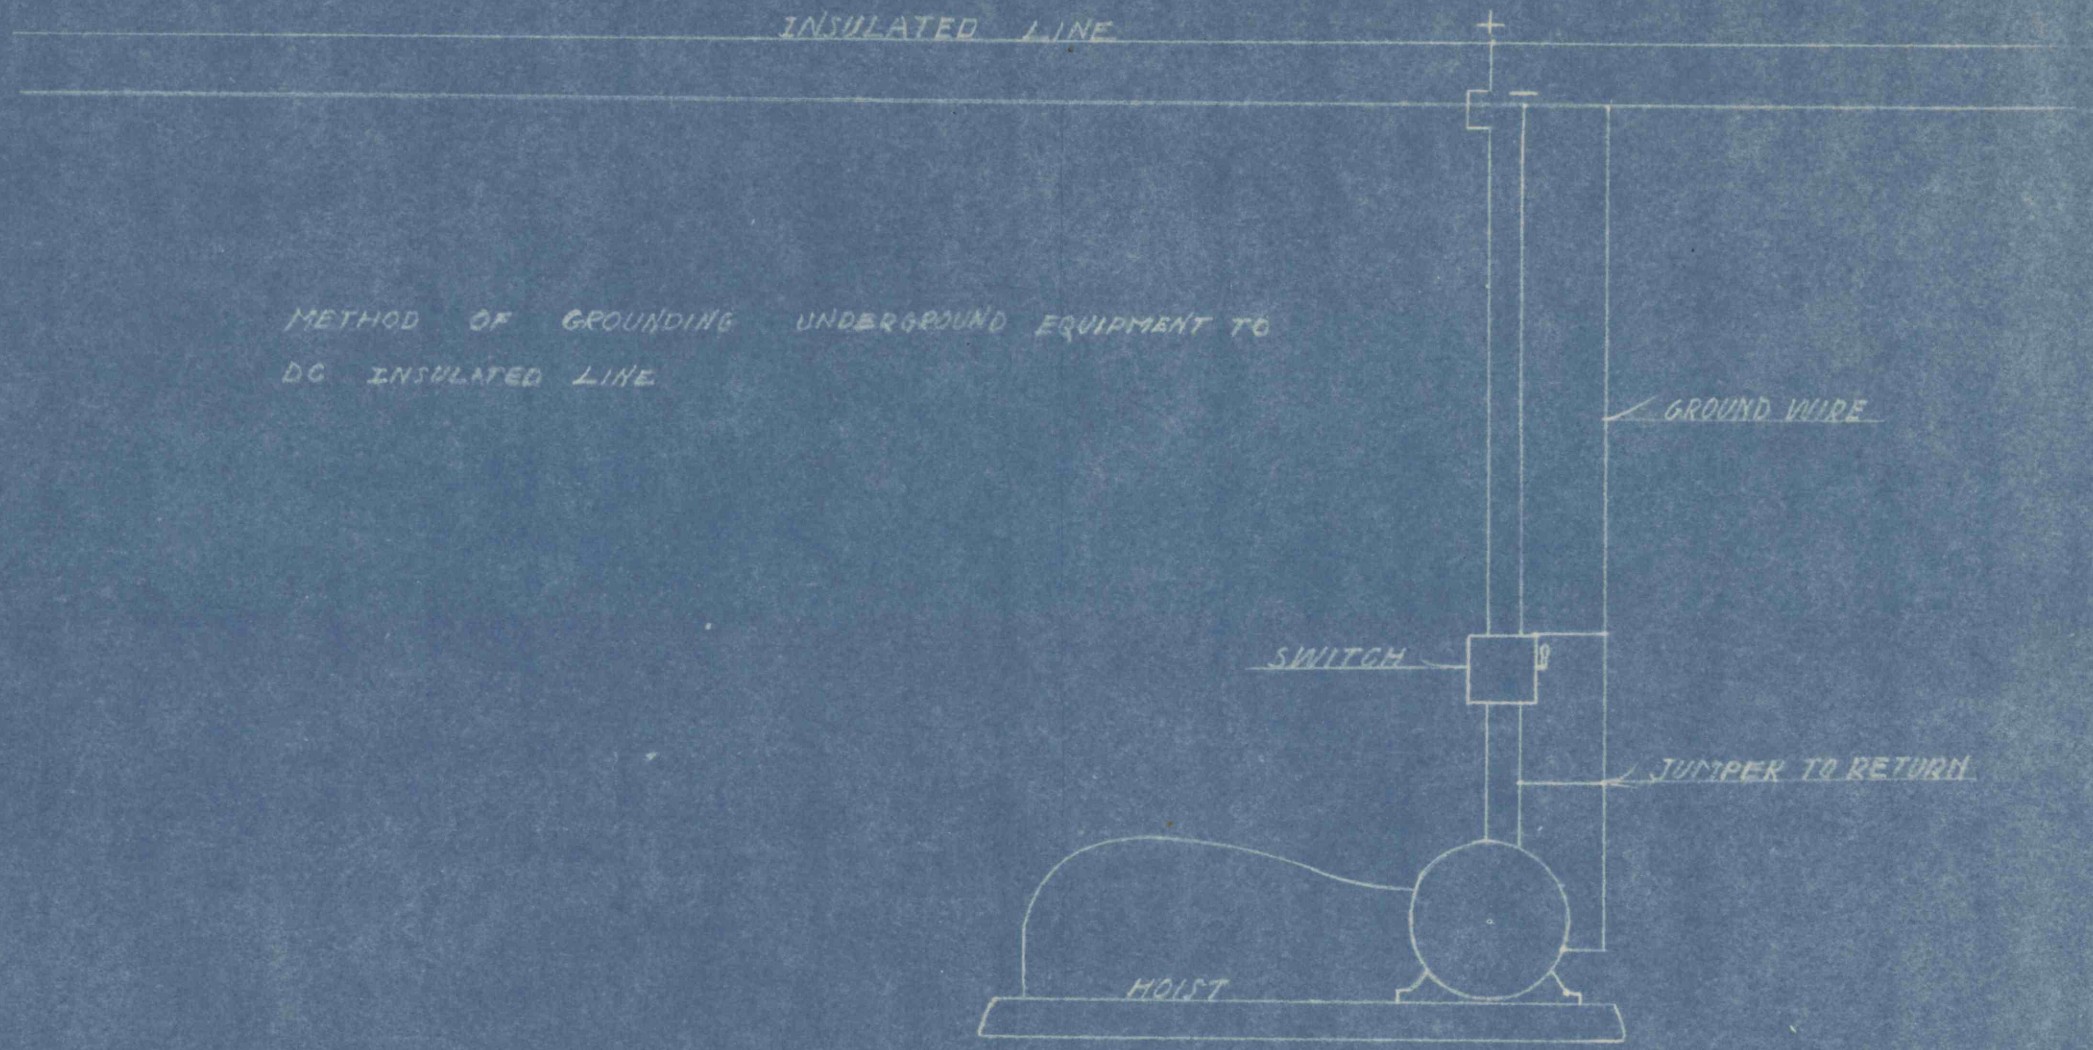

6-24-37

J.F.C.