


KEYSTONE COAL & COKE COMPANY

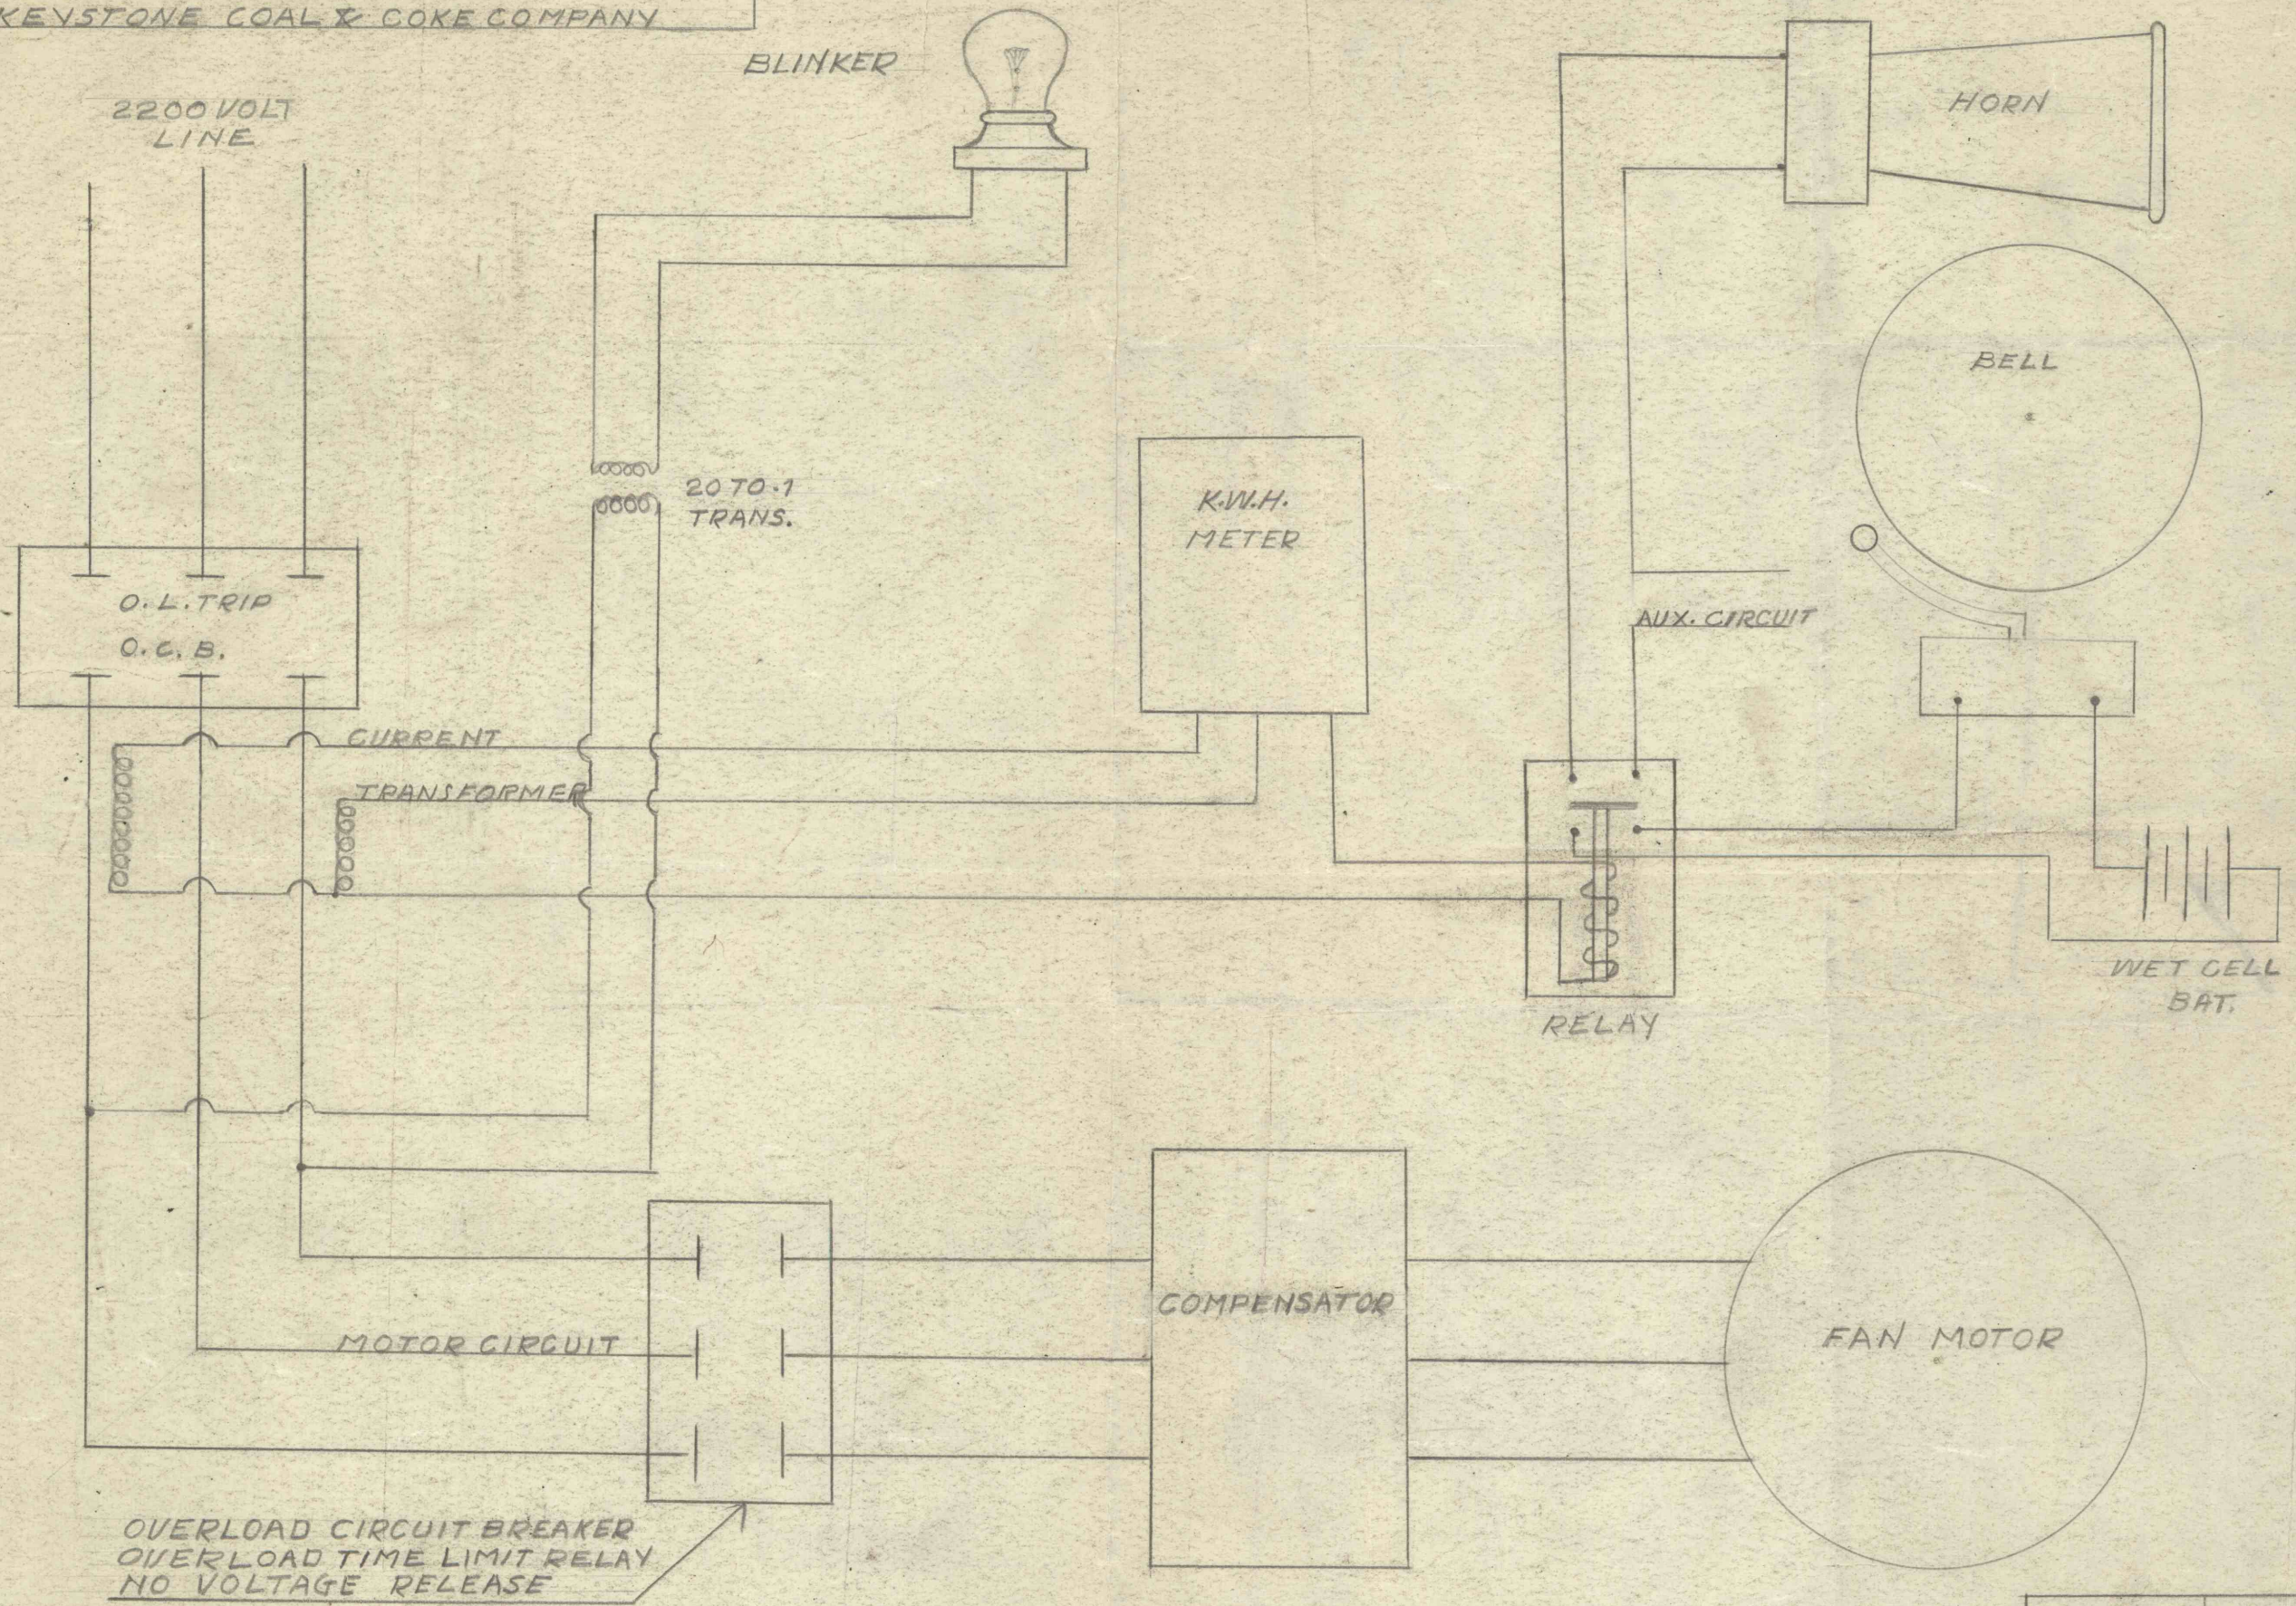

OVERLOAD CIRCUIT BREAKER
OVERLOAD TIME LIMIT RELAY
NO VOLTAGE RELEASE

DRAWN 1-11-37
VISUAL & AUDIBLE SIGNAL
FOR FANS
JOHN F. CONRAD