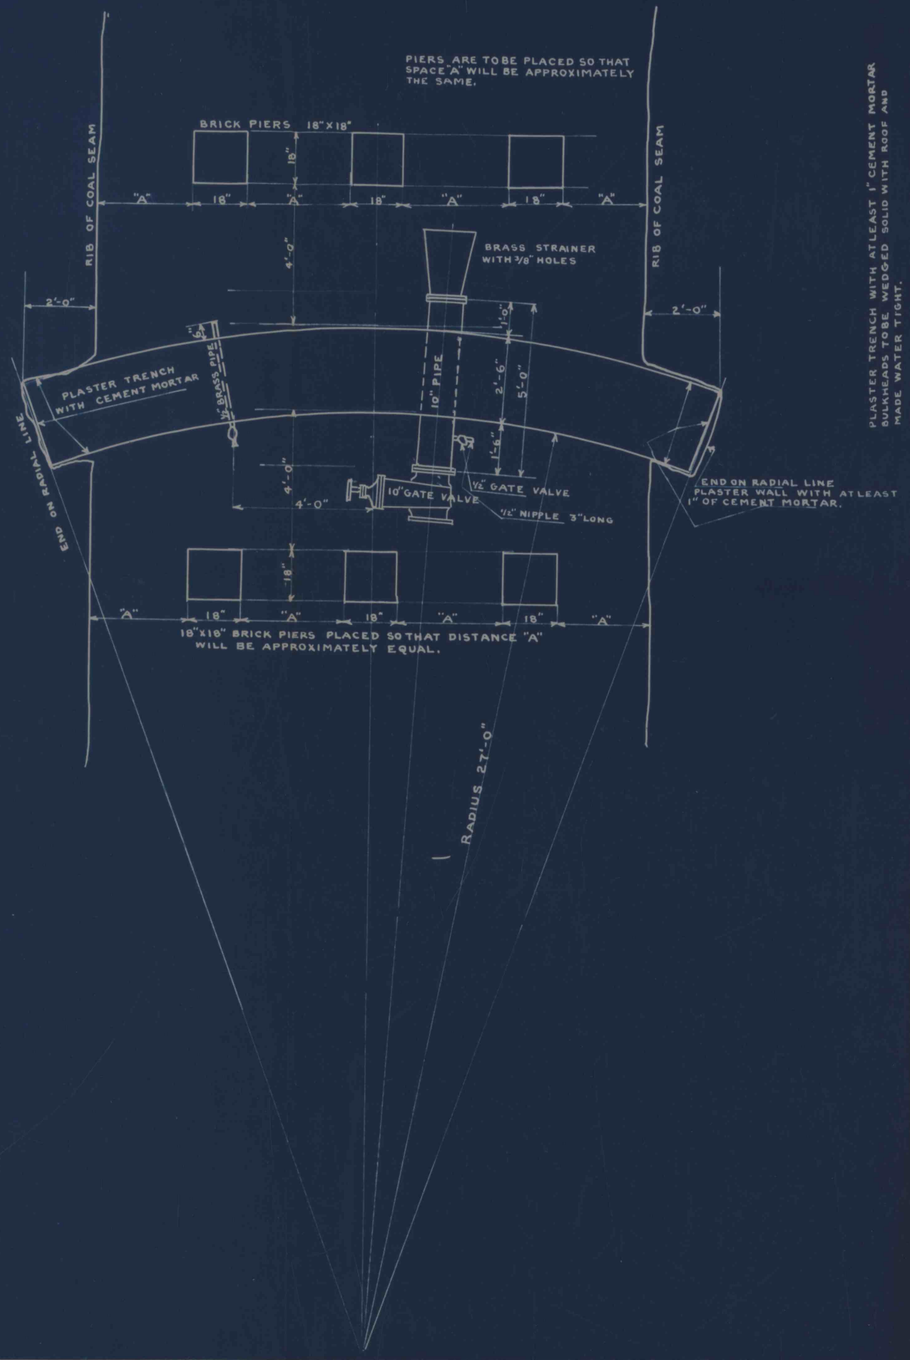

PLASTER TRENCH WITH AT LEAST 1" CEMENT MORTAR BULKHEADS TO BE WEDGED SOLID WITH ROOF AND MADE WATER TIGHT.

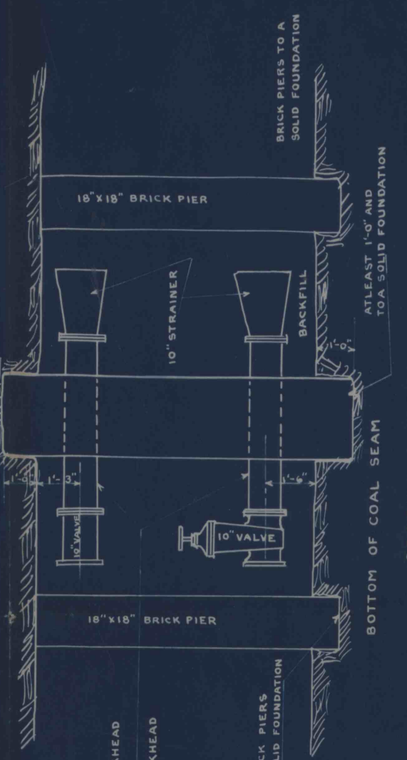

SECTION ℄ ENTRY

NOTE:
ALL PIPE, VALVES, STRAINERS AND BOLTS TO BE ACID RESISTANT BRONZE.
BULKHEADS 1 TO 13 INC TO BE 30" THICK.
BULKHEADS 14 TO 19 INC TO BE THICK.
BULKHEADS TO BE BUILT OF HARD BURNED VITRIFIED PAVING BLOCKS.

COMMONWEALTH OF PENNA.
MAYVIEW HOSPITAL
MAYVIEW MINE

BULKHEADS FOR SEALING A SECTION OF THE MINE.

SCALE 1/2" = 1'-0" JULY 1, 1949

GEO. S. BATON & CO.
ENGINEERS
1100 UNION TRUST BLDG.
PITTSBURGH 19, PENNA.

M-158