


LEGEND

- ⊕ MAIN FAN
- INTAKE AIR
- ↪ RETURN AIR
- = PERMANENT STOPPING
- TEMPORARY STOPPING
- Q AIR MEASUREMENT LOCATION
- O-- AUXILIARY FAN AND TUBING
- E ESCAPEWAY
- ⊕ / N^o 1 SLOPE

BERNITSKY NO. 2 SLOPE
BERNITSKY BROS. COAL CO.
I.D. NO. 36-01789

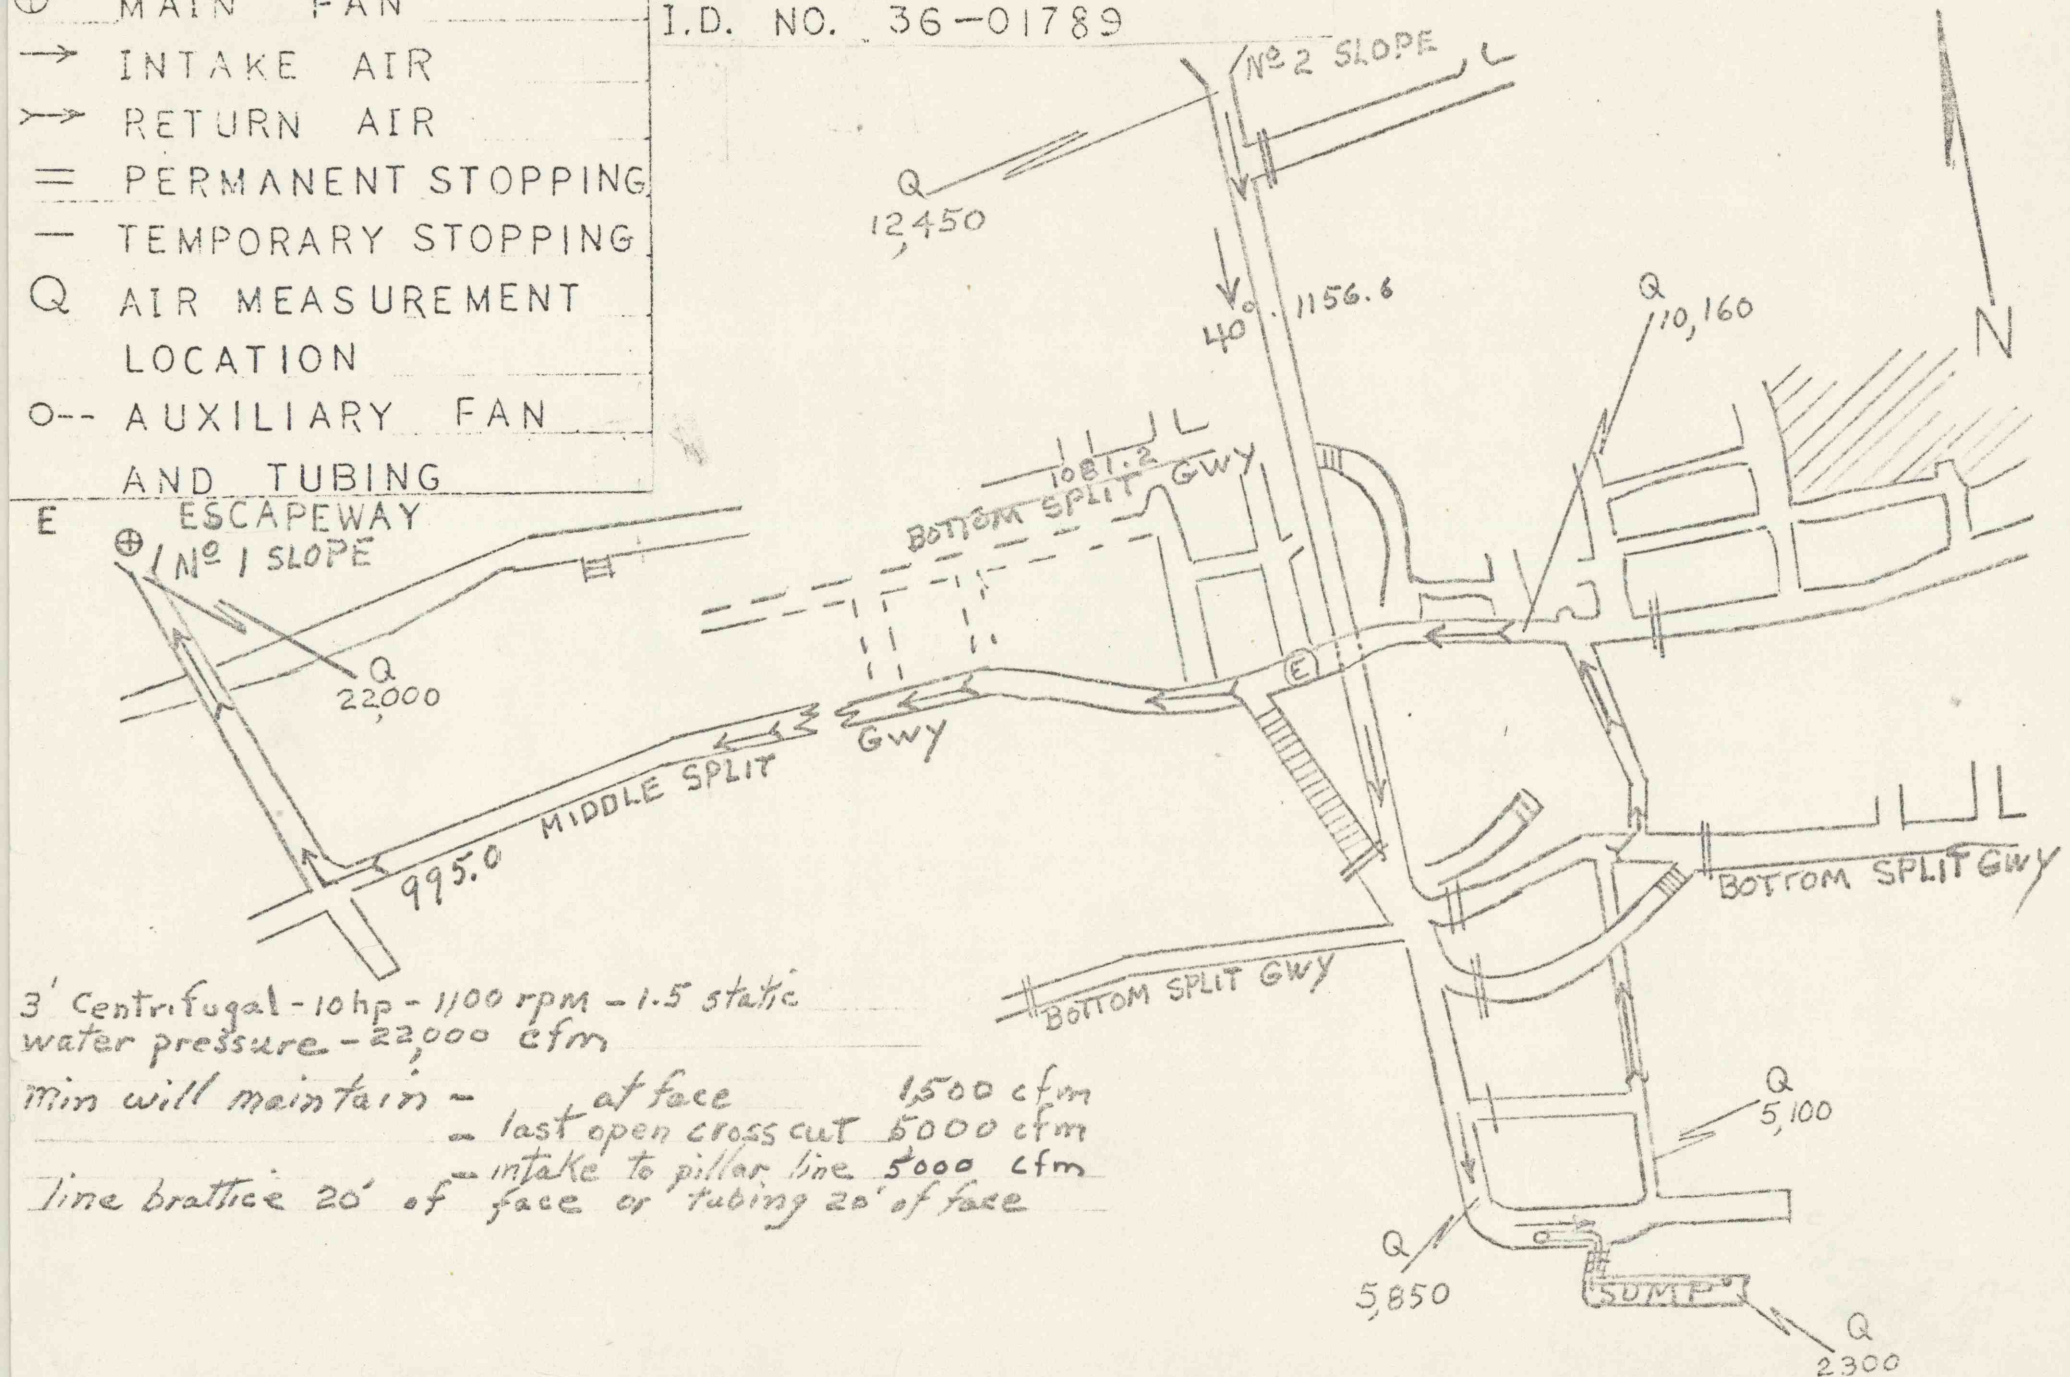

3' Centrifugal - 10hp - 1100 rpm - 1.5 static
water pressure - 22000 cfm

min will maintain - at face 1500 cfm
- last open cross cut 5000 cfm
- intake to pillar line 5000 cfm
line brattice 20' of face or tubing 20' of face