
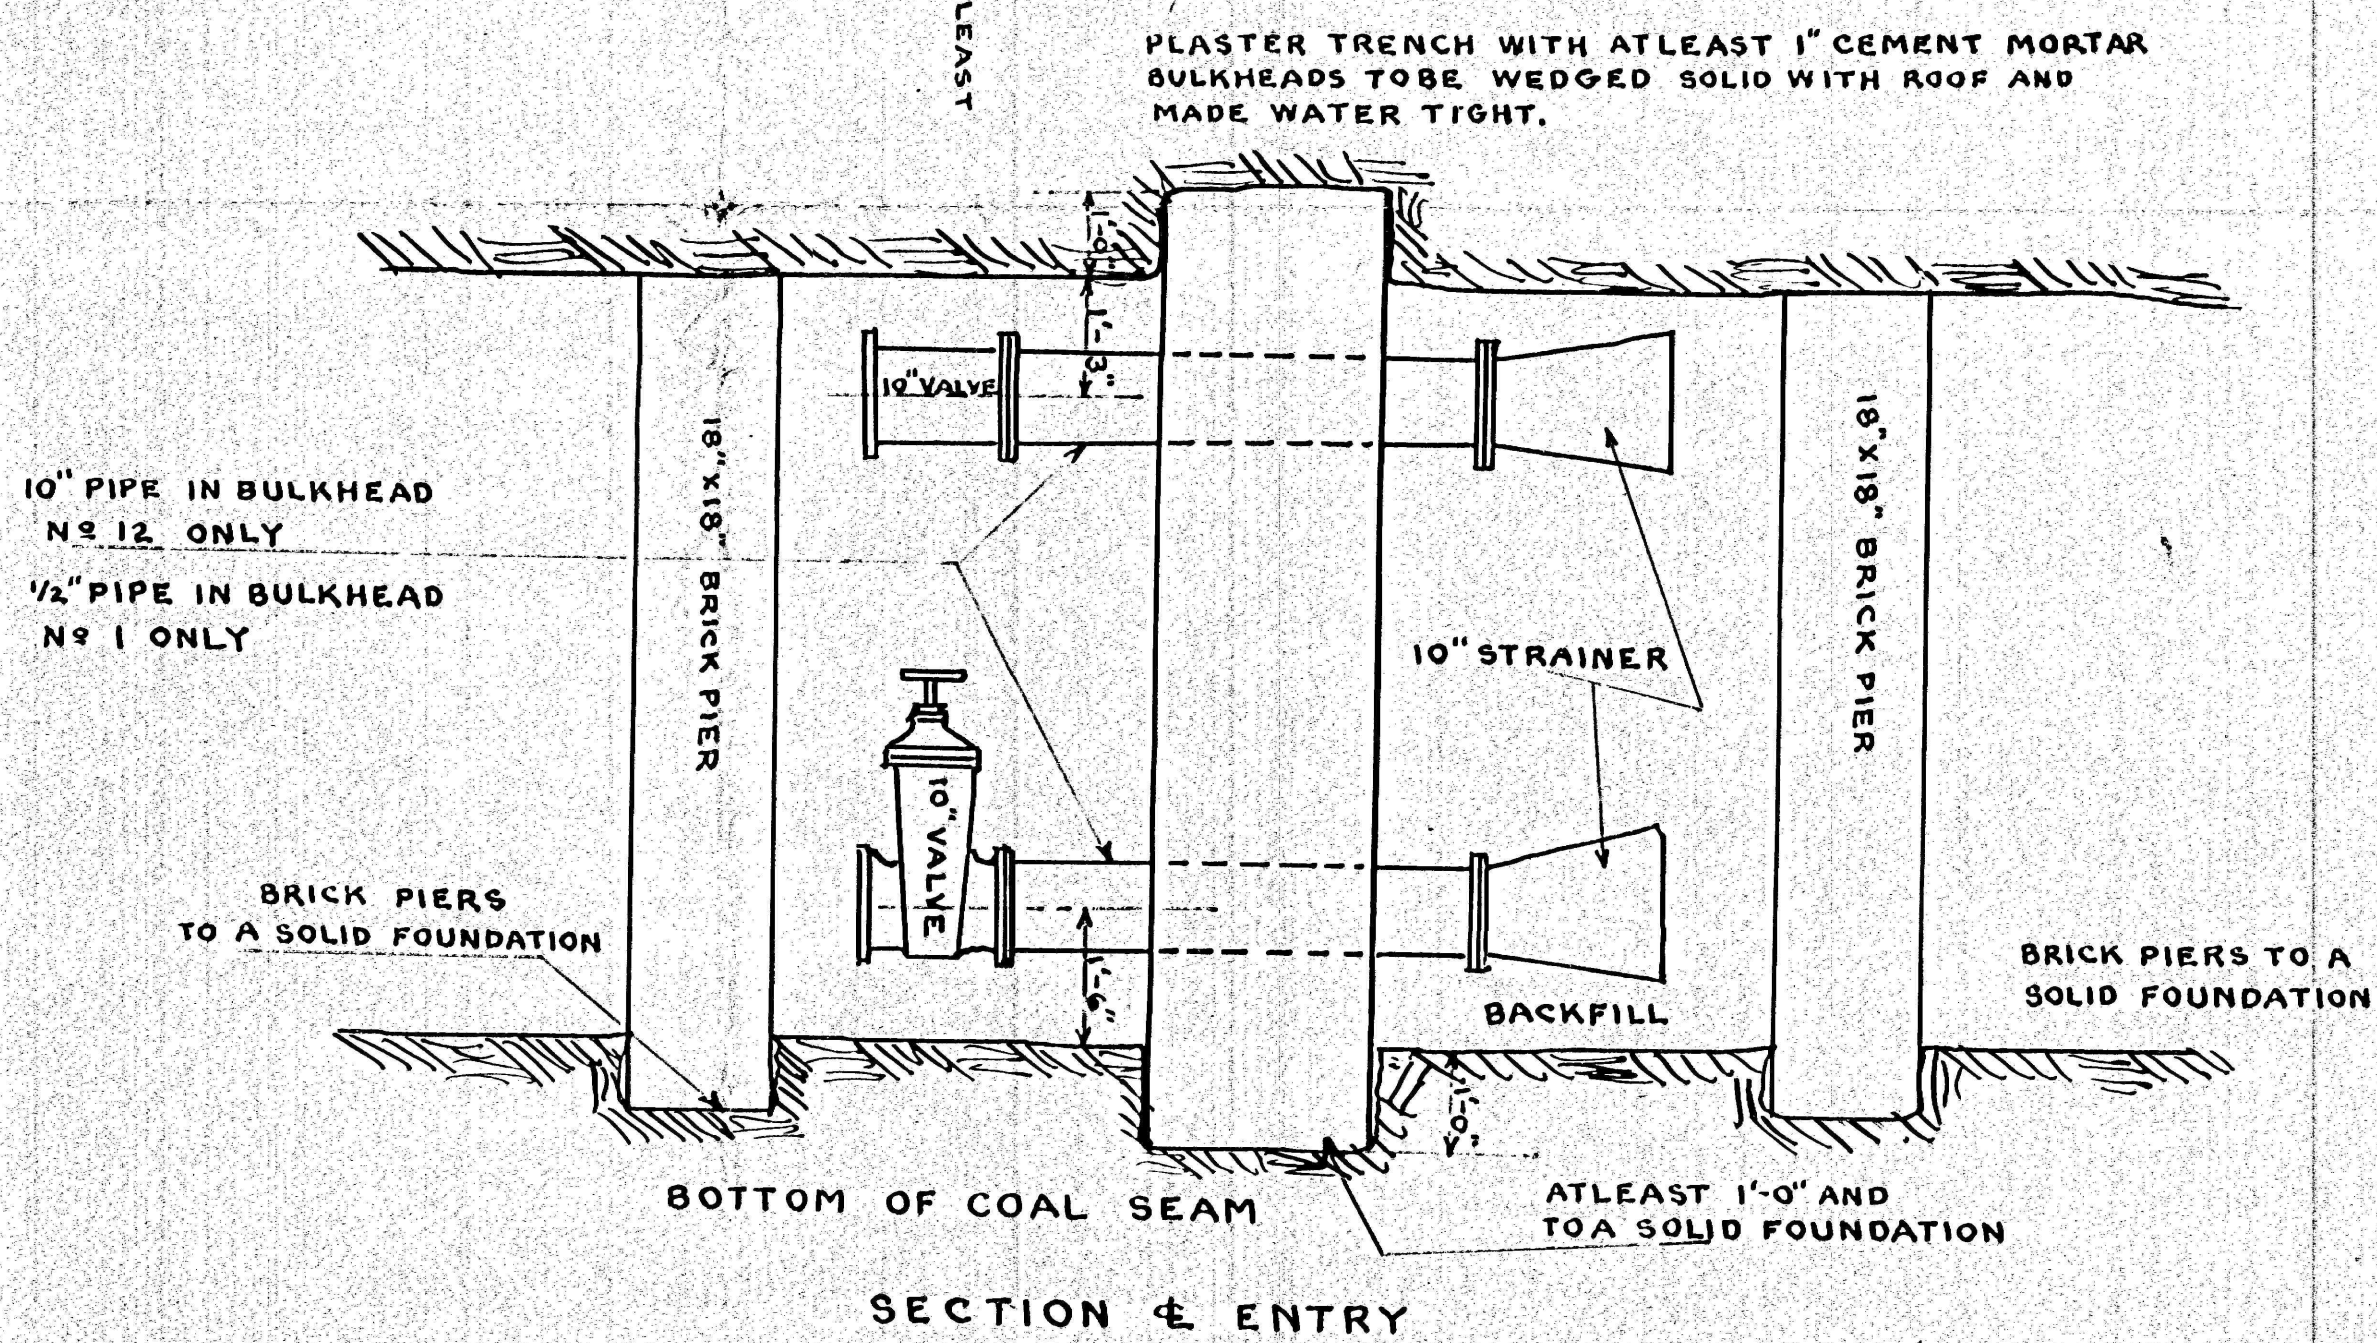


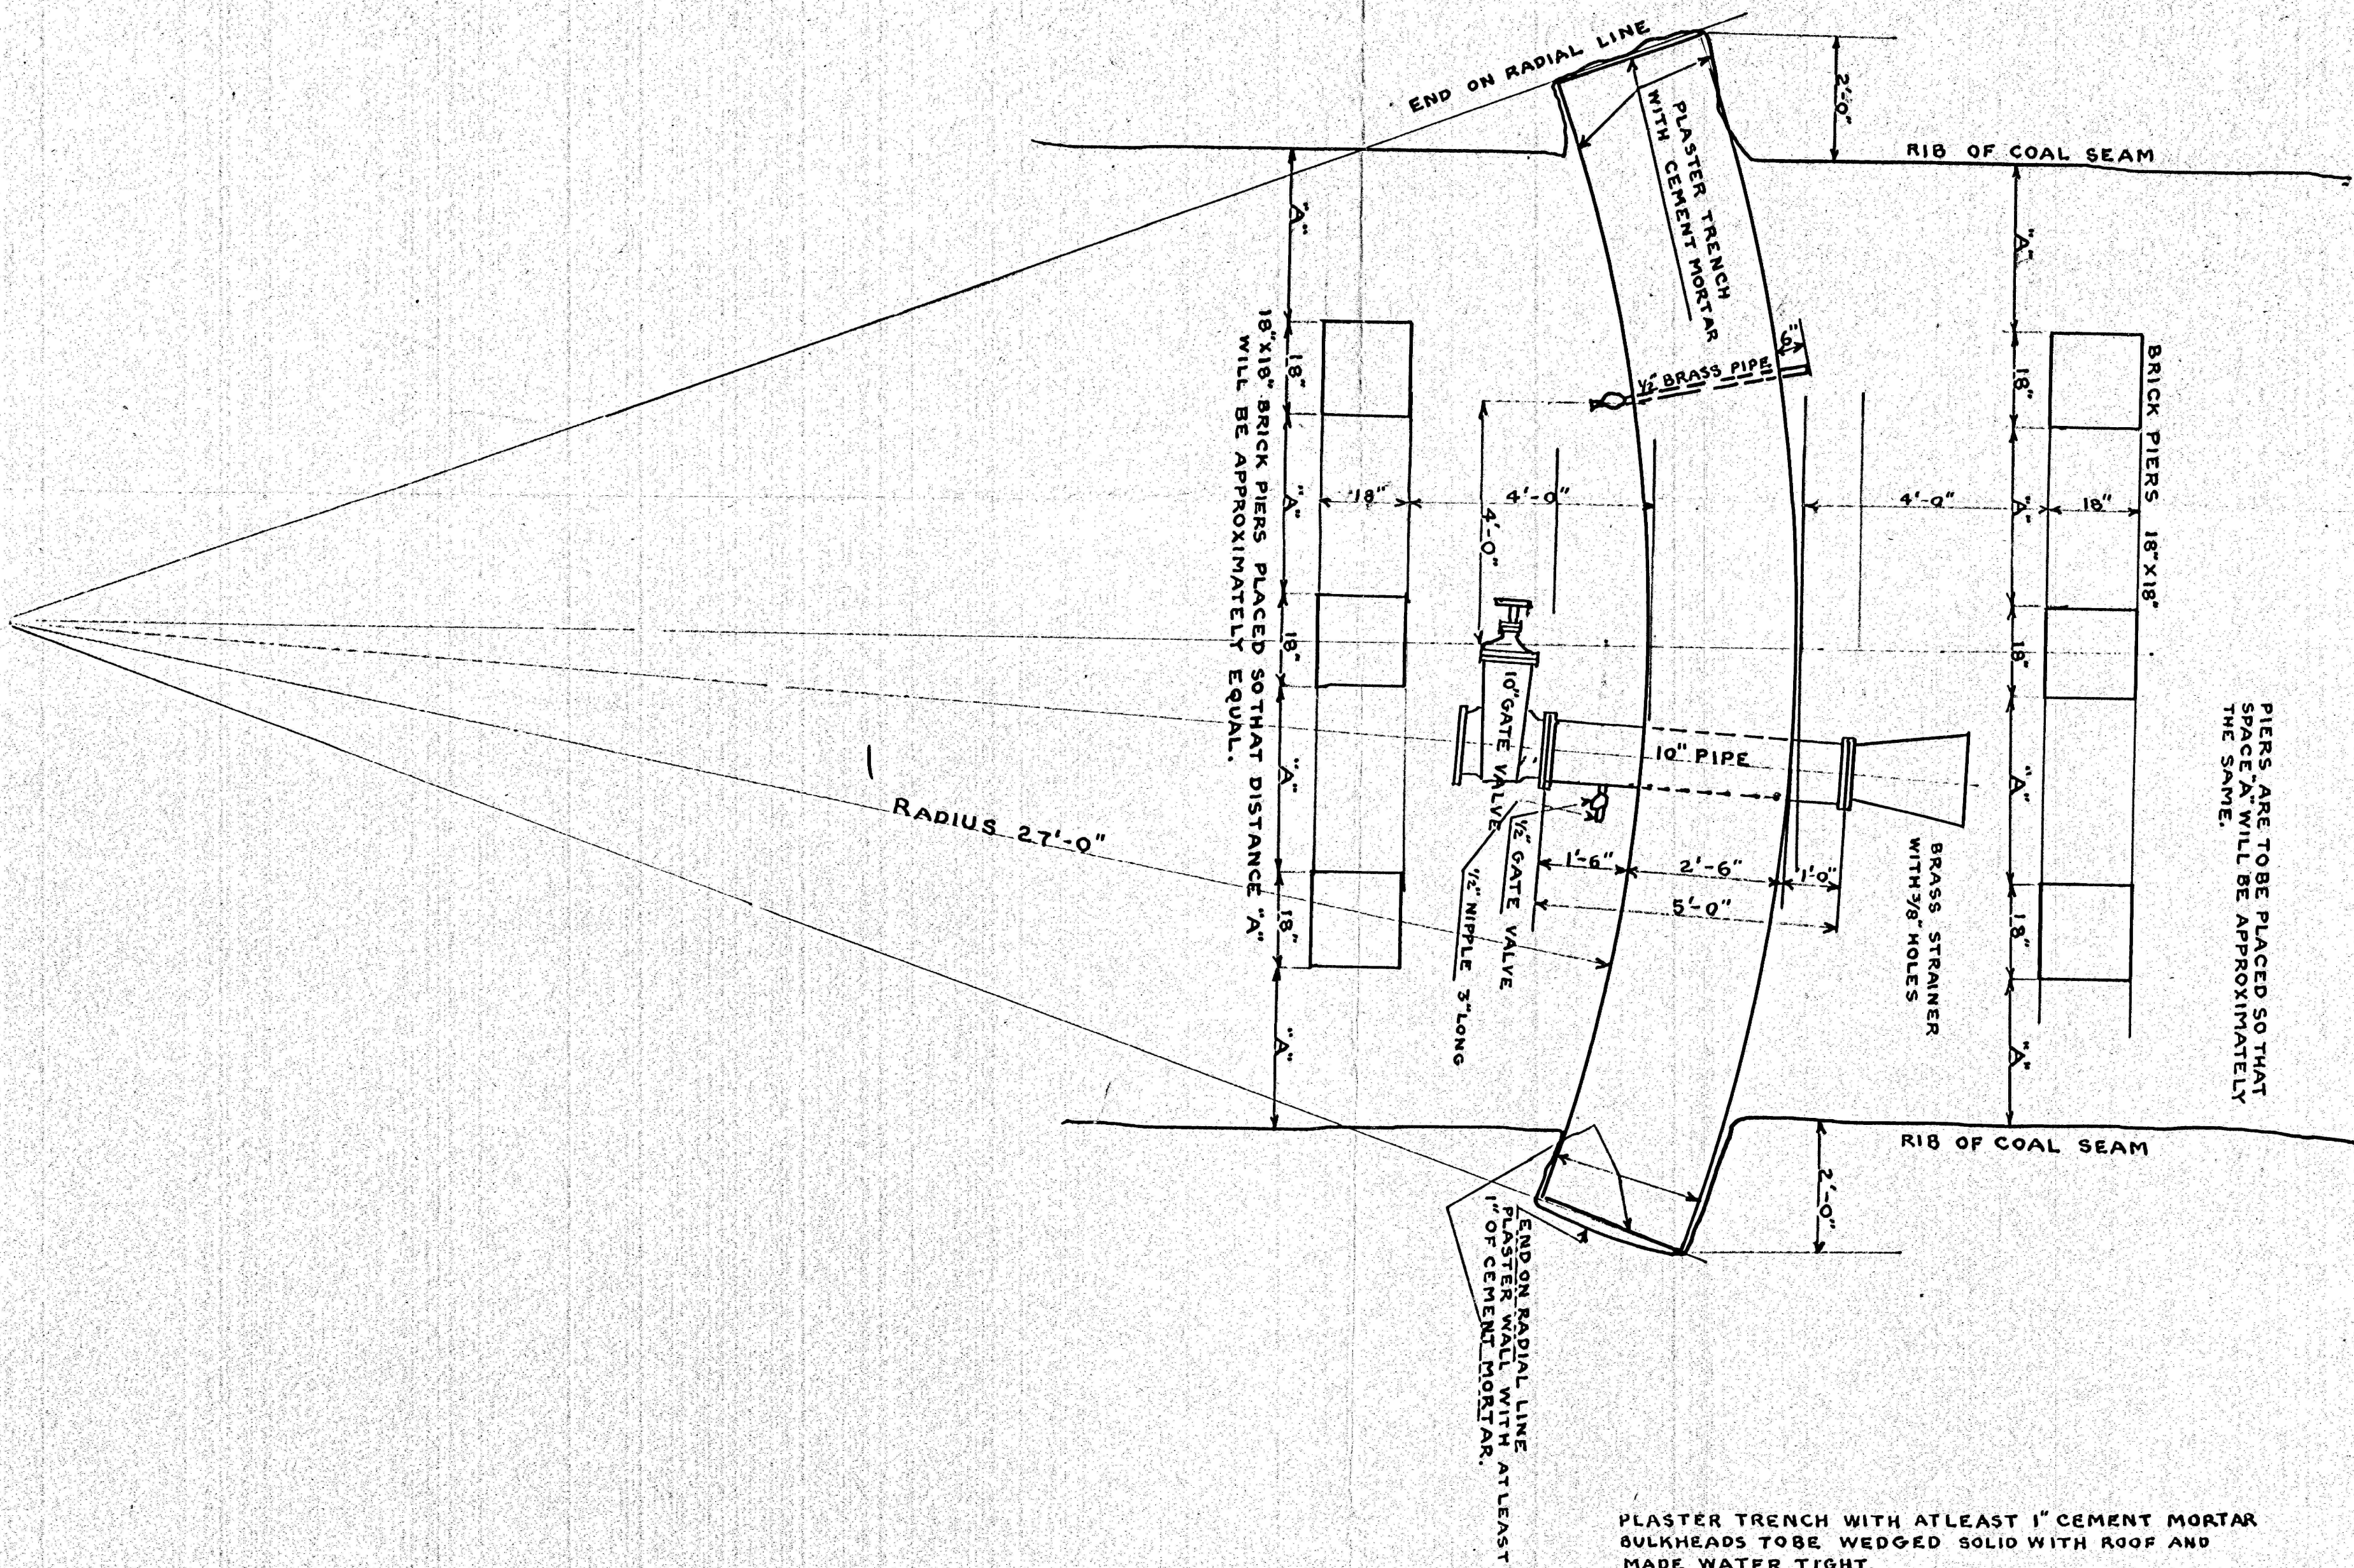

NOTE:  
ALL PIPE, VALVES, STRAINERS AND BOLTS TO BE ACID RESISTANT BRONZE.  
BULKHEADS 1 TO 13 INC TO BE 30" THICK.  
BULKHEADS 14 TO 19 INC TO BE 36" THICK.  
BULKHEADS TO BE BUILT OF HARD BURNED VITRIFIED PAVING BLOCKS.

COMMONWEALTH OF PENNA.  
MAYVIEW HOSPITAL  
MAYVIEW MINE

BULKHEADS FOR SEALING  
A SECTION OF THE MINE.  
SCALE 1/2" = 1'-0" JULY 1, 1949

GEO. S. BATON & CO.  
ENGINEERS  
1100 UNION TRUST BLDG.  
PITTSBURGH 19, PENNA.