

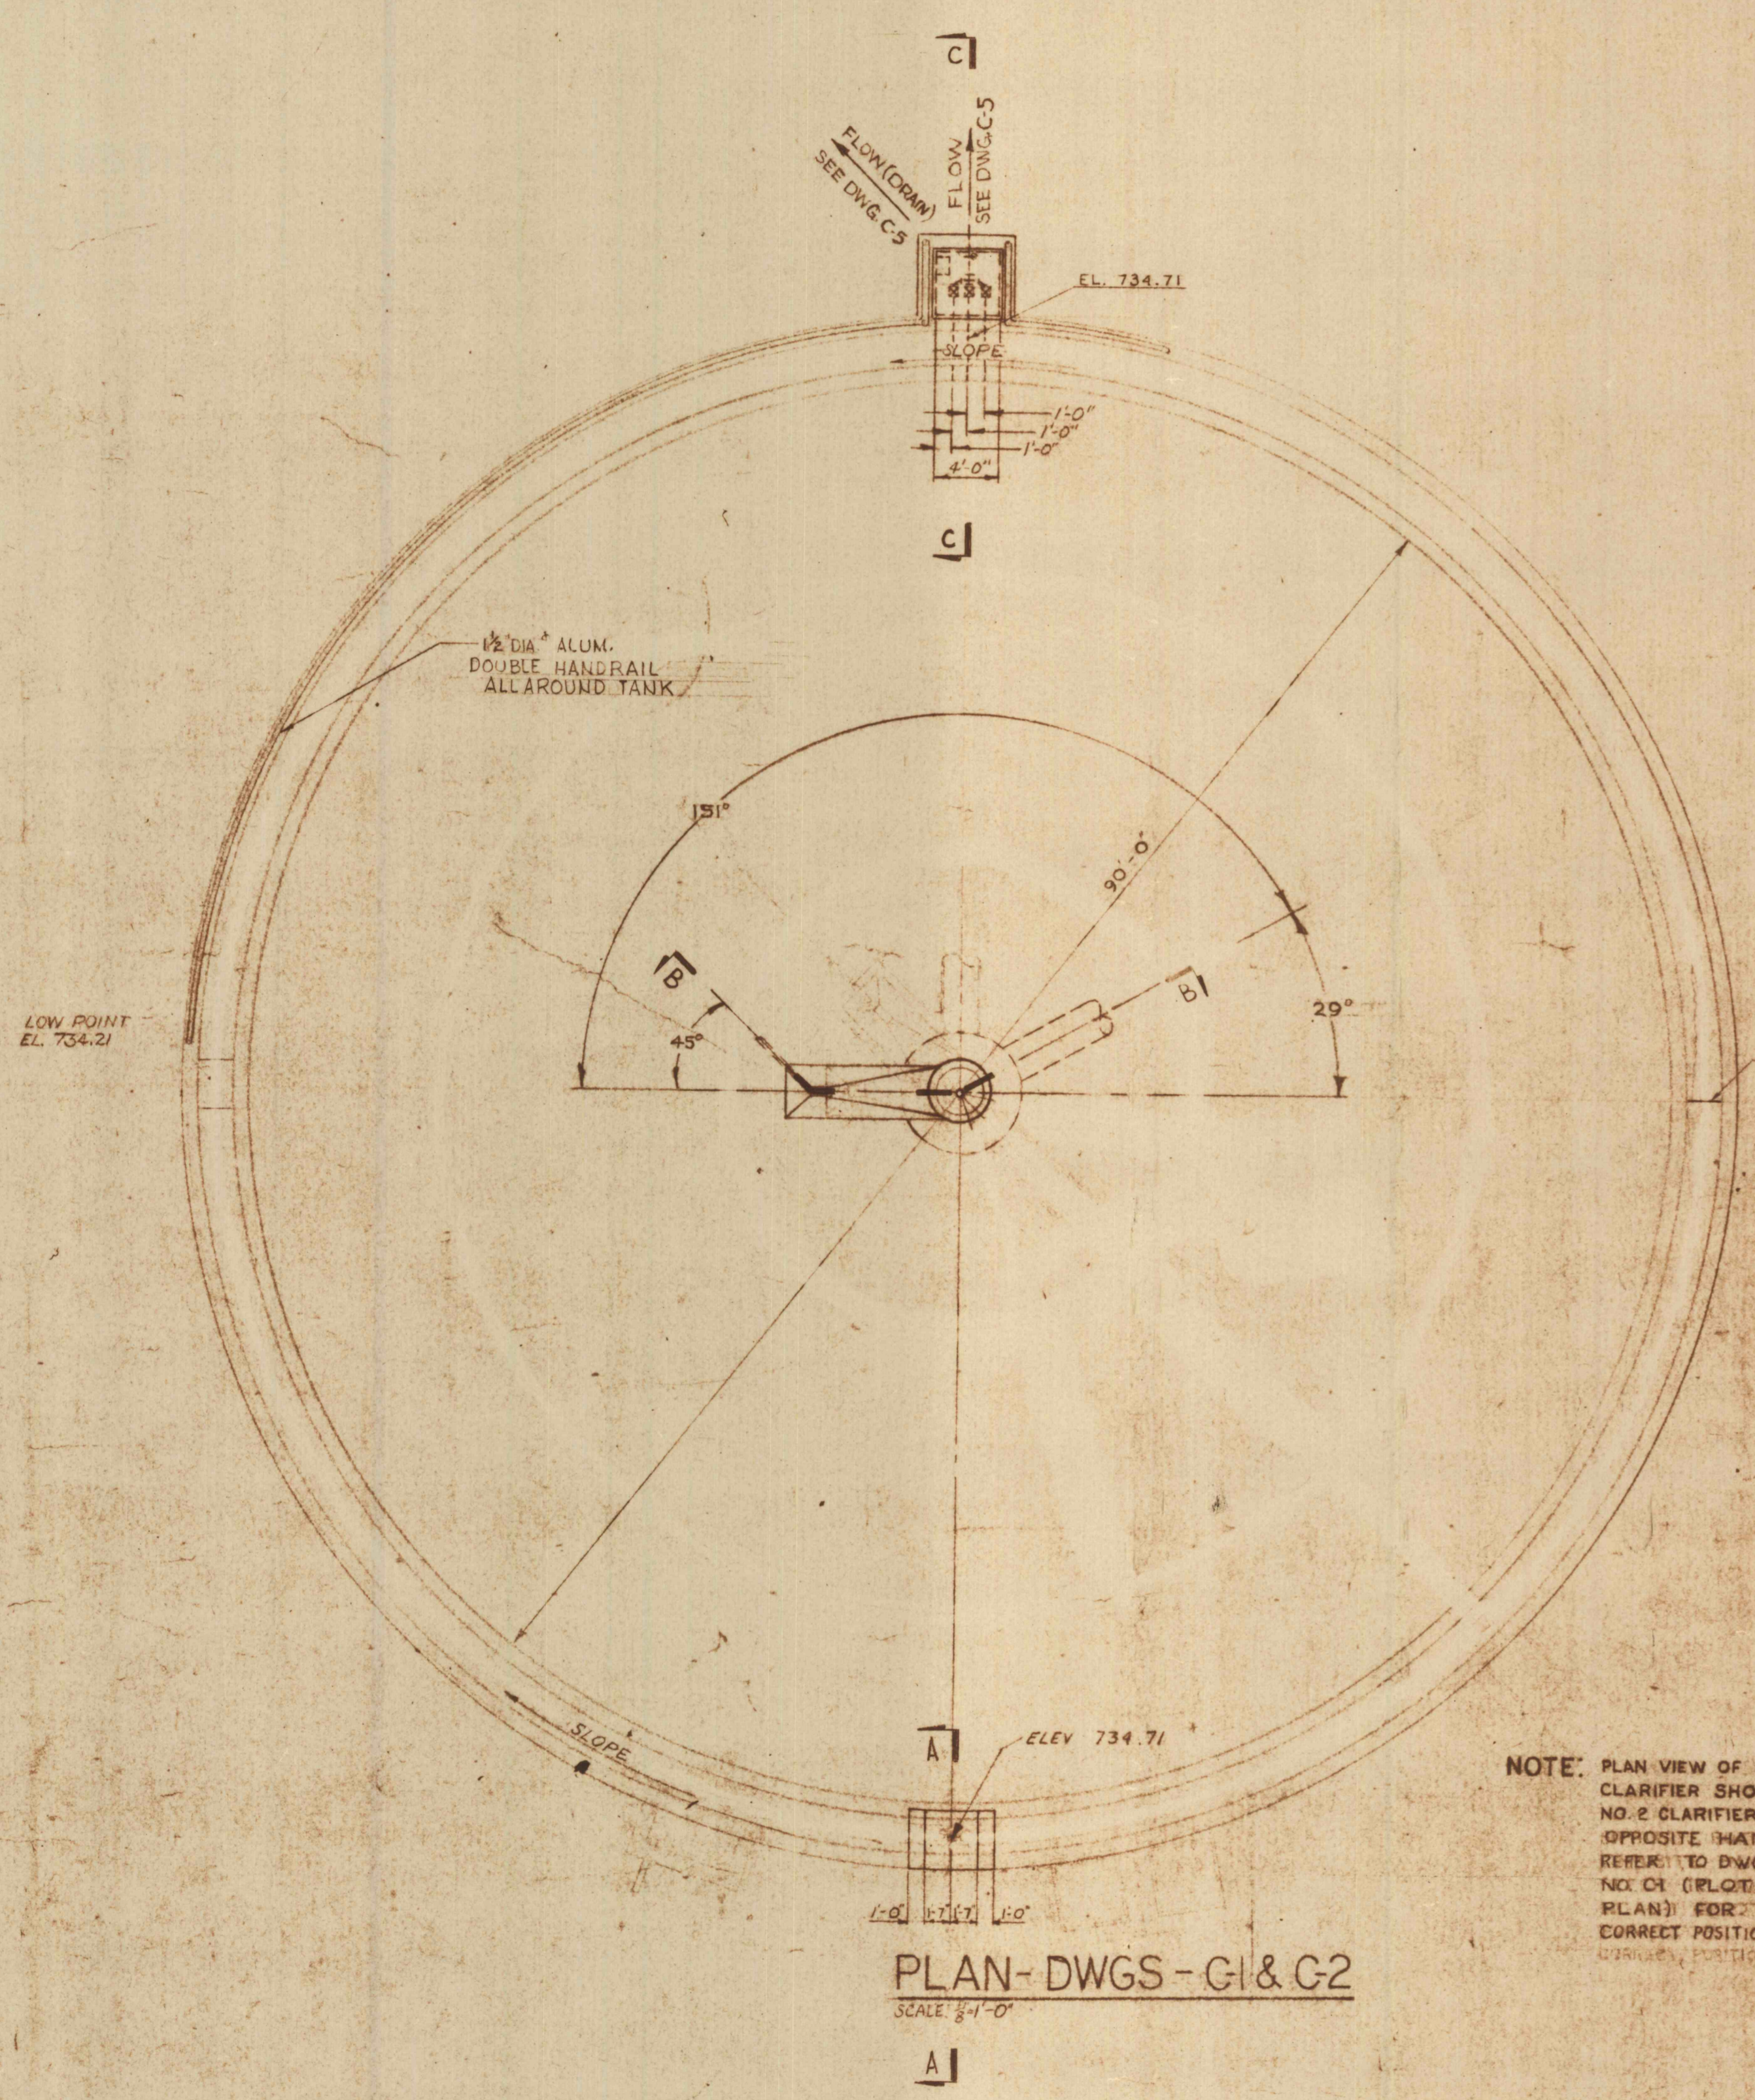


- GENERAL NOTES:**
1. WATER-TIGHT FLANGED SLEEVE FOR ALL PIPES THRU WALLS OR SLABS BELOW WATER LEVEL.
  2. REFER TO DWG. NO. C-17 FOR CLARIFIER MECHANICAL DETAILS.
  3. CONTINUOUS WATER-STOP TO BE PLACED AT ALL CONSTRUCTION JOINTS.
  4. SUB SOIL MUST BE UNIFORMLY WELL COMPACTED. A 12" BASE COURSE OF WELL COMPACTED CRUSHED STONE OR GRAVEL MUST BE PROVIDED BEFORE THE SLAB IS POURED.

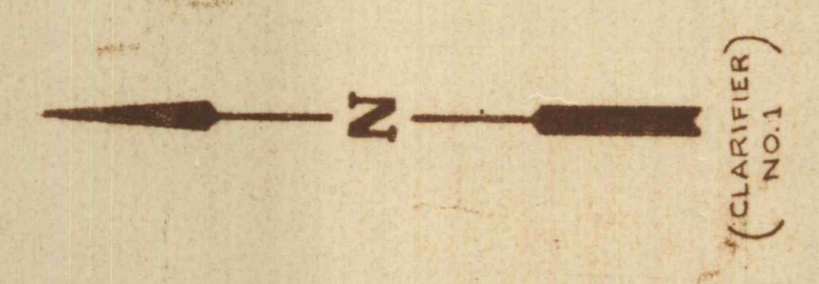

NOTE: PLAN VIEW OF NO. 1 CLARIFIER SHOWN. NO. 2 CLARIFIER IS OPPOSITE HAND. REFER TO DWG. NO. C-1 (PLOT PLAN) FOR CORRECT POSITIONING.

PLAN - DWGS - G1 & G2  
SCALE 3/4" = 1'-0"

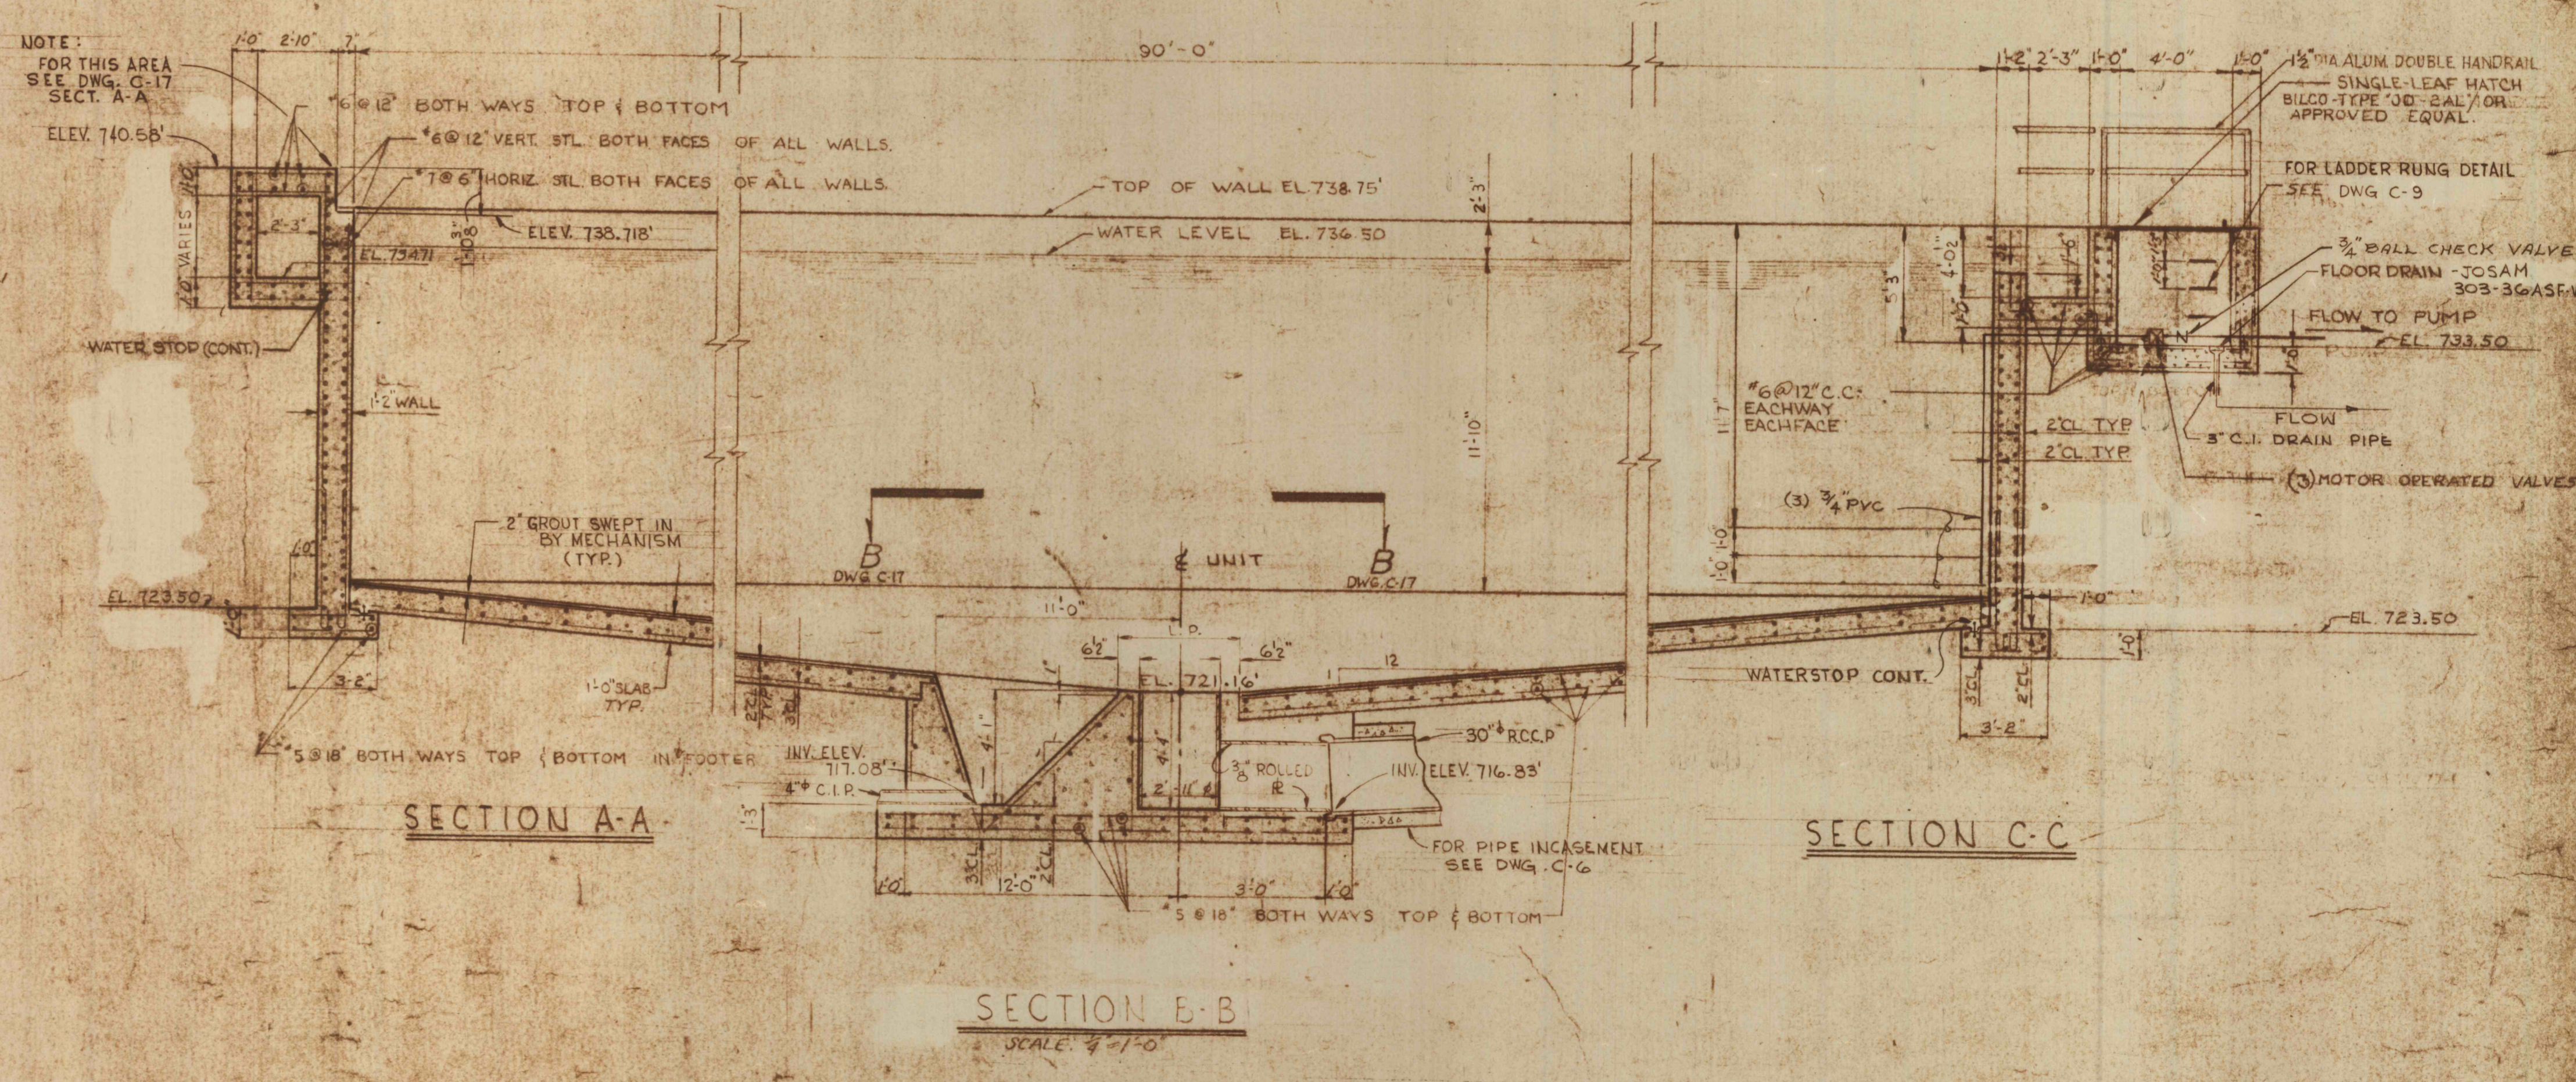

SECTION A-A

SECTION B-B  
SCALE 3/4" = 1'-0"

SECTION C-C

NO.	DATE	REVISIONS
2	12-9-78	REVISED FLOOR DRAIN IN BOX
1	10-27-78	RELOCATED KEY 2 WATERSTOP IN WALL FOOTING & L.P. ELEV. OF TANK

**TYPICAL CLARIFIER - STRUCTURAL**

CONSTRUCTION OF TREATMENT FACILITIES FOR ACID MINE DRAINAGE  
**RAUSCH CREEK WATERSHED**  
 SCHUTTKILL COUNTY, PENNSYLVANIA

ANTHRACITE  
 RESEARCH & DEVELOPMENT CO. INC.  
 consulting engineers  
 POTTSVILLE, PENNSYLVANIA

THOMAS H. RIE  
 PROFESSIONAL ENGINEER  
 JOHN J. LEVITELLO  
 PROFESSIONAL ENGINEER

JOB NO. 4500  
 DATE: JAN 1970  
 SCALE: AS SHOWN  
 DRAWN BY: STEPHEN  
 APPROVED: [Signature]

DRAWING NO.  
**C-16**

