GENERAL NOTES:
1. TYPICAL FOR ALL BOXES: 1" GALV. WROUGHT IRON OR ALUM. LADDER RUNGS MIN. 12" WIDTH EADS SET IN CONCRETE TO BE COATED WITH BITUMASTIC PASTE.
2. ALL CONSTRUCTION JOINTS BELOW WATER LEVEL TO HAVE 9" WATER STOPS CONTINUOUS.
3. FOR TYPICAL REINFORCING CLEARANCES ON ALL BOXES SEE DETAIL "A" DWG. Nº C-22
4. REFER TO DWG. Nº C-1 FOR LOCATION OF ALL DETAILS ON THIS SHEET.
5. SHADING INDICATES SIDES OF WALLS.

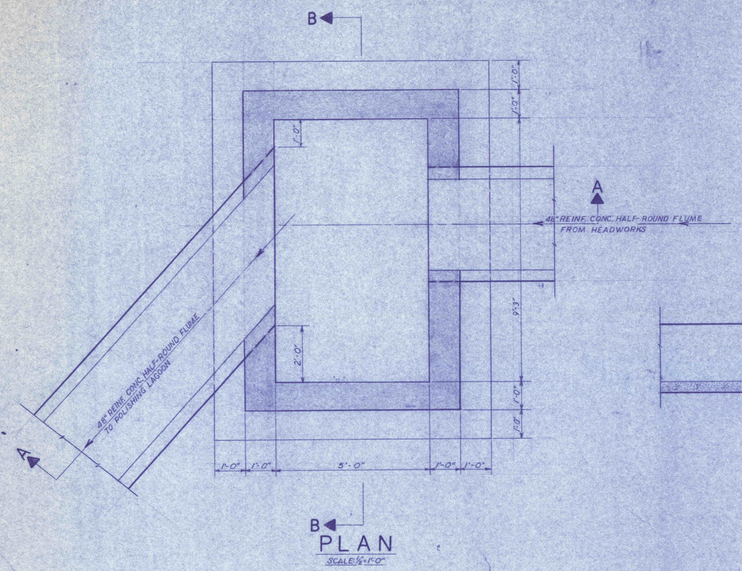

PLAN
SCALE: 1/4"=1'-0"

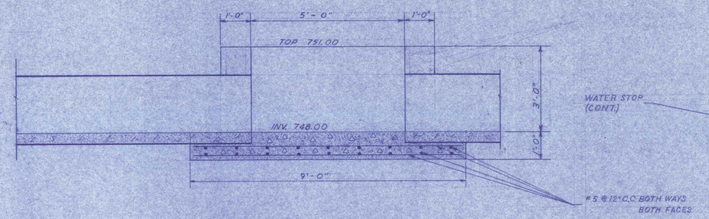

SECTION A-A
SCALE: 1/2"=1'-0"

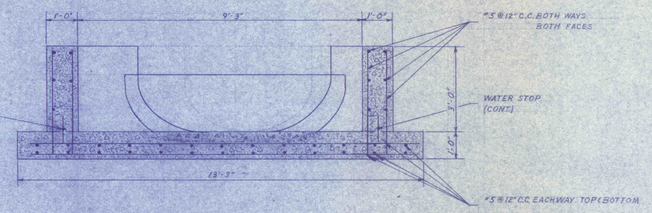

SECTION B-B
SCALE: 1/2"=1'-0"

DETAIL NO. 6
INTERCEPTOR BOX

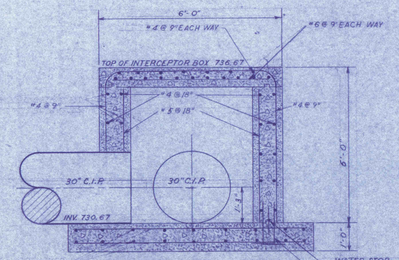

SECTION B-B
SCALE: 1/2"=1'-0"

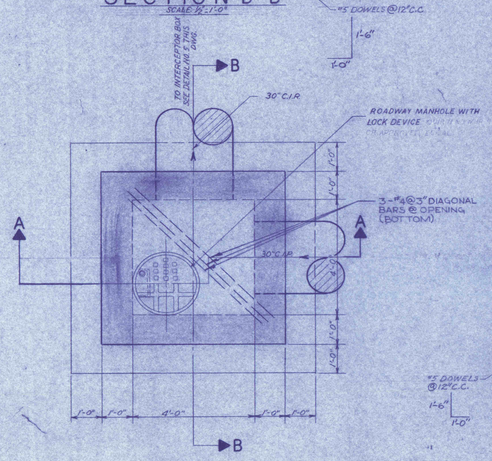

PLAN
SCALE: 1/2"=1'-0"

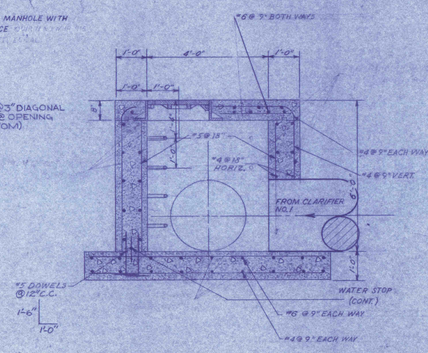

SECTION A-A
SCALE: 1/2"=1'-0"

DETAIL NO.4
INTERCEPTOR BOX

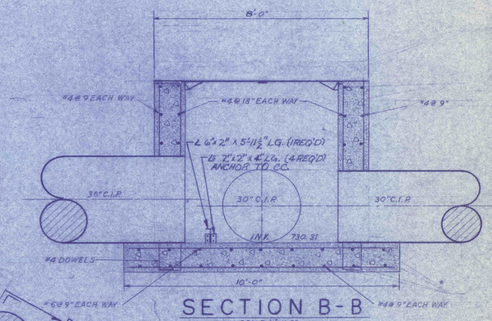

SECTION B-B
SCALE: 1/2"=1'-0"

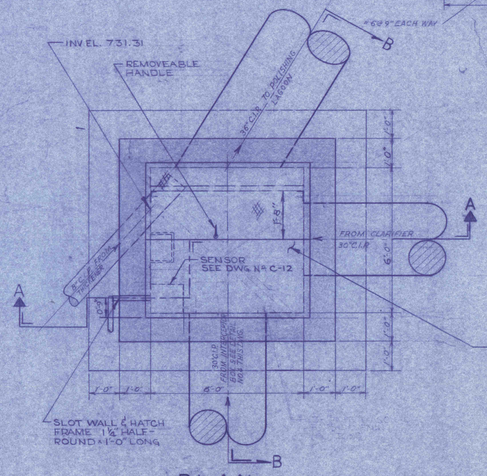

PLAN
SCALE: 1/2"=1'-0"

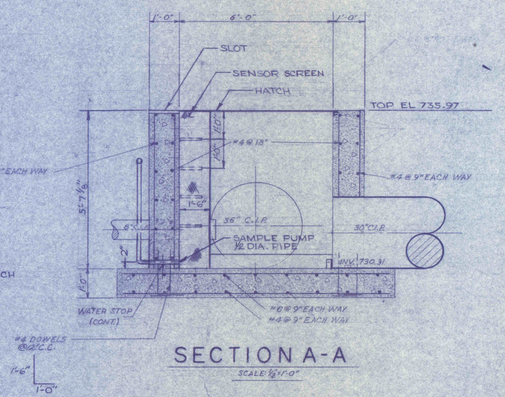

SECTION A-A
SCALE: 1/2"=1'-0"

DETAIL NO.5
INTERCEPTOR BOX

PRE-FINAL

REVISIONS

CONSTRUCTION DETAILS

CONSTRUCTION OF TREATMENT FACILITIES FOR ACID MINE DRAINAGE
RAUSCH CREEK WATERSHED
SCHUYLKILL COUNTY PENNSYLVANIA

ANTHRACITE RESEARCH & DEVELOPMENT CO. INC.
consulting engineers
POTTSVILLE PENNSYLVANIA TAMAQUA

JOB NO: 6805
DATE: NOV. 1969
SCALE: NOTED
DRAWN: J.S.N.
APPROVED: T.H.R.-J.J.L.

DRAWING NO:
C-23

THOMAS H. RILL — COMMONWEALTH OF PENNSYLVANIA — PROFESSIONAL ENGINEER — No. 19661
JOHN J. LEVANDIO — COMMONWEALTH OF PENNSYLVANIA — REGISTERED — No. 8014

DIETZGEN 199M Tracing Vellum 36134