


Water Pools - Feb 24, 1959

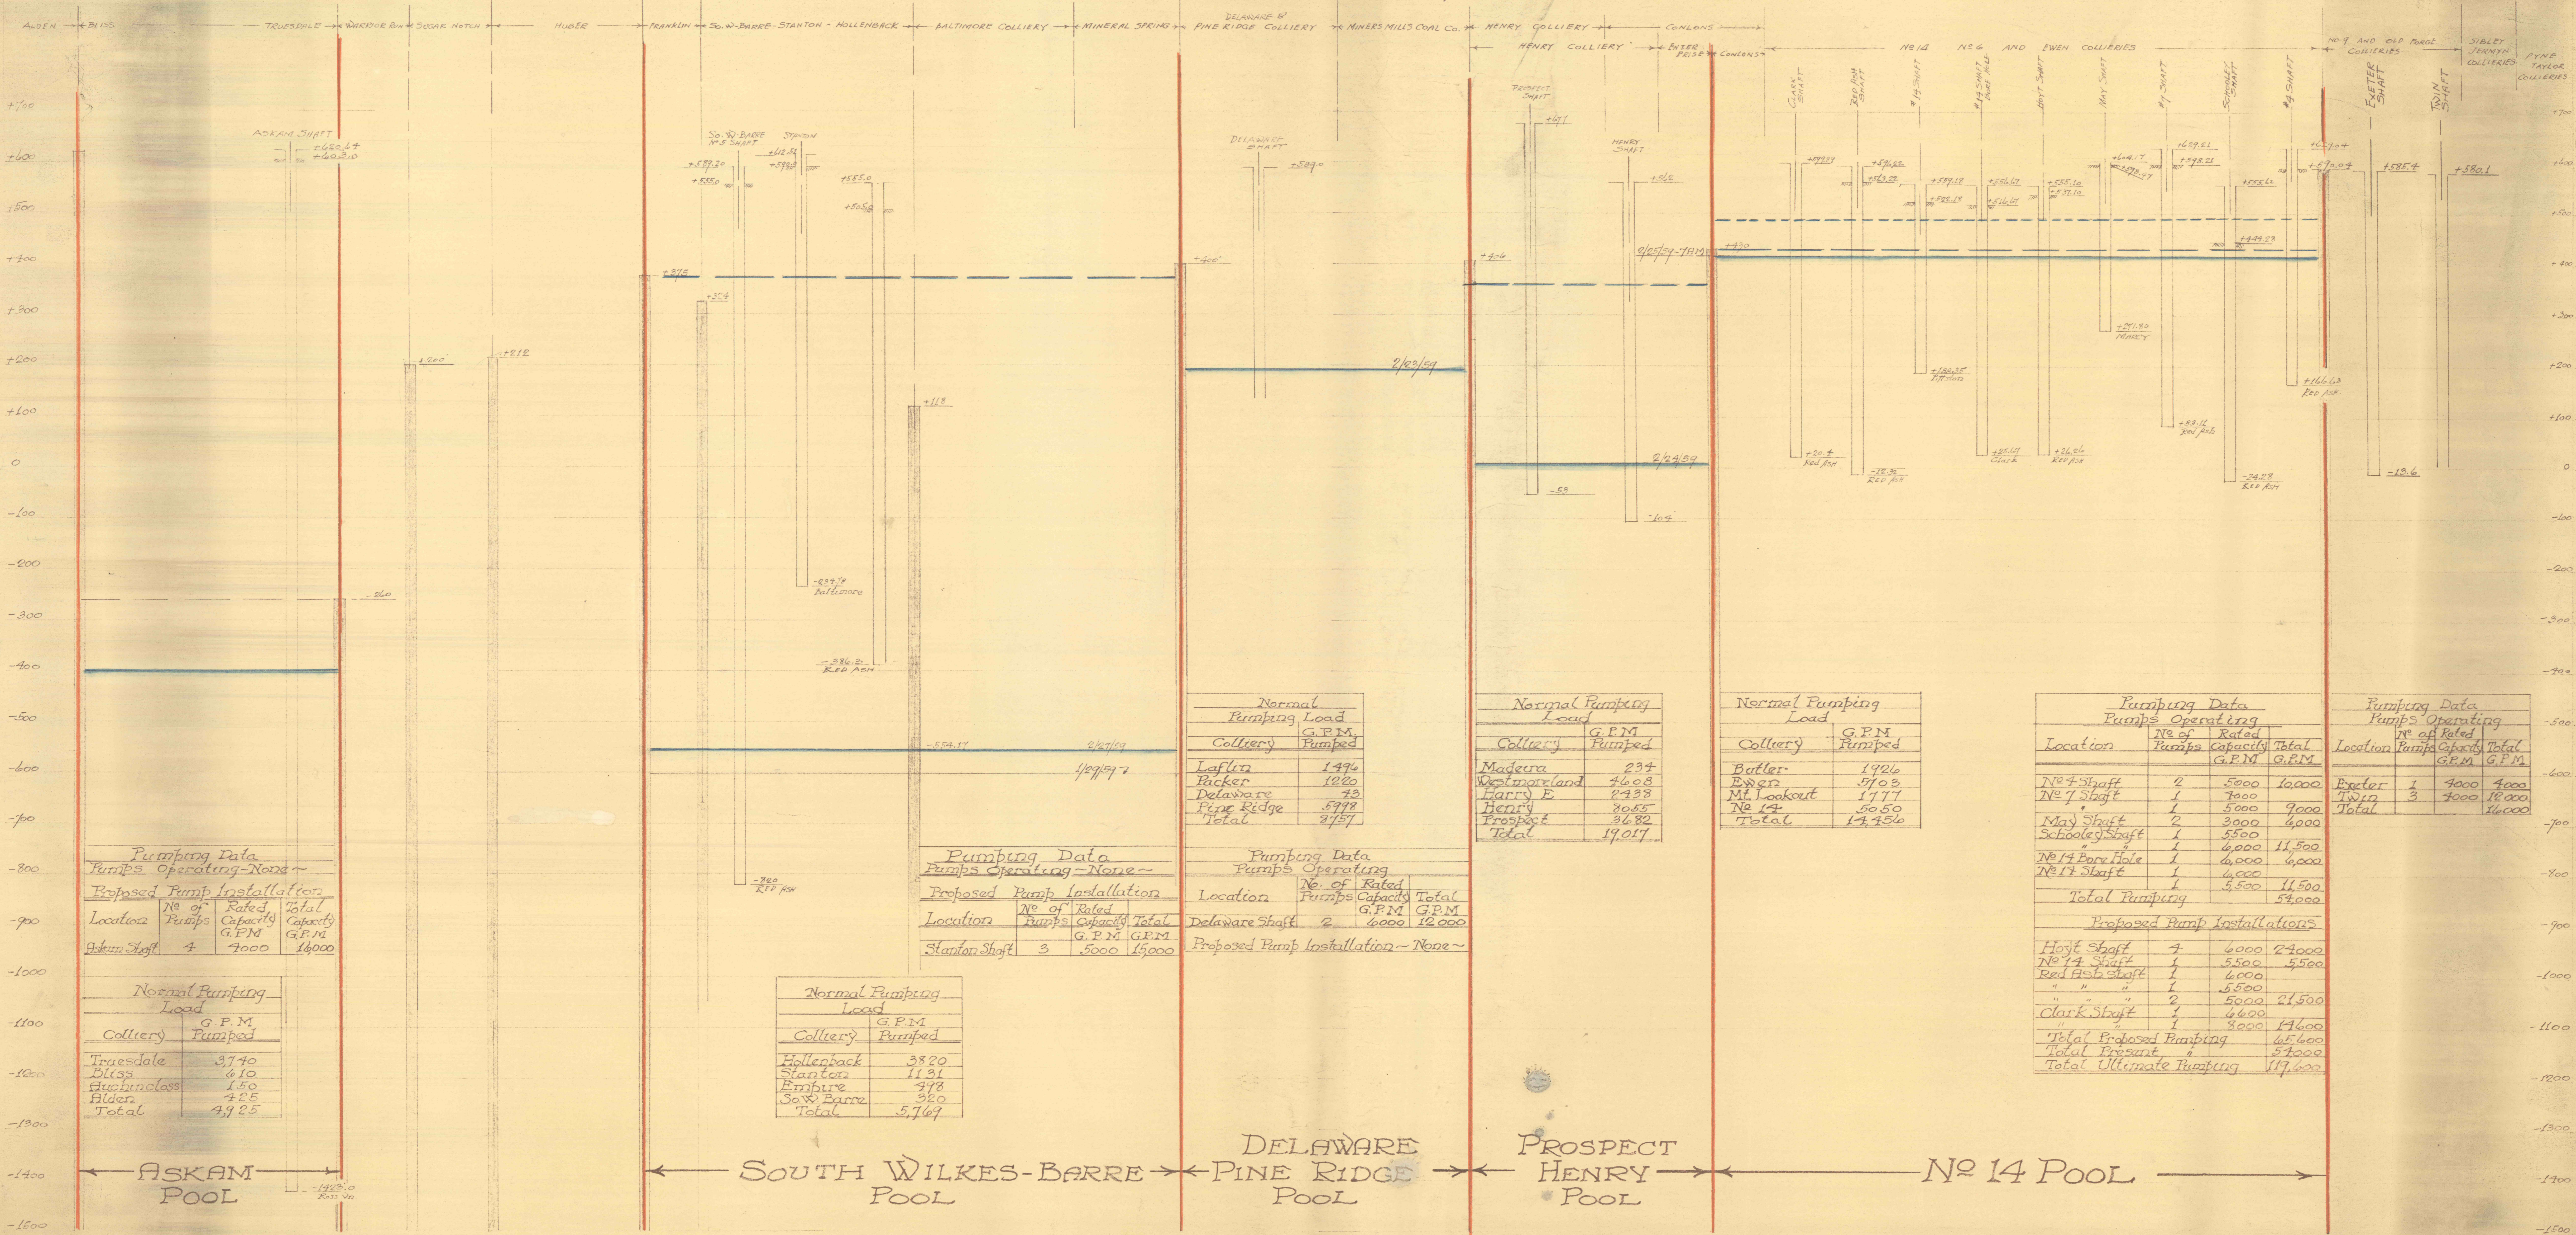

Pumping Data
Pumps Operating - None -

Proposed Pump Installation

Location	No. of Pumps	Rated Capacity G.P.M.	Total Capacity G.P.M.
Askam Shaft	4	7000	14000

Normal Pumping Load

Colliery	G.P.M. Pumped
Truesdale	3740
Bliss	610
Auchincloss	150
Alder	425
Total	4925

Pumping Data
Pumps Operating - None -

Proposed Pump Installation

Location	No. of Pumps	Rated Capacity G.P.M.	Total G.P.M.
Stanton Shaft	3	5000	15000

Normal Pumping Load

Colliery	G.P.M. Pumped
Hollenback	3820
Stanton	1131
Empire	498
So. W. Barre	320
Total	5769

Normal Pumping Load

Colliery	G.P.M. Pumped
Lafayette	1496
Packer	1220
Delaware	73
Pine Ridge	5998
Total	2757

Pumping Data
Pumps Operating

Location	No. of Pumps	Rated Capacity G.P.M.	Total G.P.M.
Delaware Shaft	2	6000	12000

Proposed Pump Installation - None -

Normal Pumping Load

Colliery	G.P.M. Pumped
Madera	234
Westmoreland	4608
Harry E	2438
Henry	3055
Prospect	3682
Total	19,017

Normal Pumping Load

Colliery	G.P.M. Pumped
Butler	1926
Eger	5703
Mt. Lookout	1777
No. 14	5050
Total	14,456

Pumping Data
Pumps Operating

Location	No. of Pumps	Rated Capacity G.P.M.	Total G.P.M.
No. 7 Shaft	2	5000	10000
No. 7 Shaft	1	7000	7000
"	1	5000	5000
May Shaft	2	3000	6000
Schooler Shaft	1	5500	5500
"	1	4000	4000
No. 14 Pore Hole	1	4000	4000
No. 17 Shaft	1	4000	4000
Total Pumping	1	5,500	11,500

Proposed Pump Installations

Location	No. of Pumps	Rated Capacity G.P.M.	Total G.P.M.
Holt Shaft	4	6000	24000
No. 14 Shaft	1	5500	5500
Red Ash Shaft	1	6000	6000
"	1	5500	5500
"	2	5000	10000
Clark Shaft	1	4600	4600
"	1	8000	8000
Total Proposed Pumping	11	45,600	45,600
Total Present	1	5,500	5,500
Total Ultimate Pumping	12	51,100	51,100

Pumping Data
Pumps Operating

Location	No. of Pumps	Rated Capacity G.P.M.	Total G.P.M.
Exeter	1	4000	4000
Twin	3	7000	21000
Total	4	11,000	14,000

ASKAM POOL

SOUTH WILKES-BARRE POOL

DELAWARE PINE RIDGE POOL

PROSPECT HENRY POOL

No. 14 POOL