


PLAN - POLE LINE EXTENSION TO NEW SUBSTATION
SCALE 100'-1"=10'

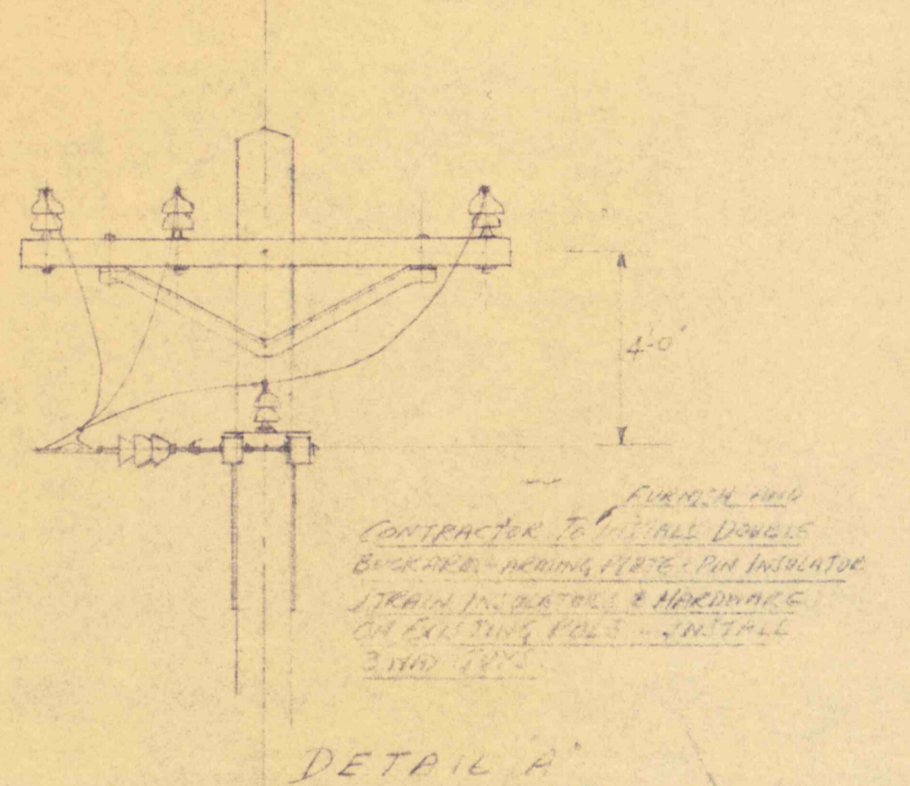

MATERIAL BIDD & S.C. STD. REFERENCE DWG.

| QTY | DESCRIPTION | REFERENCE DWG. |
|------|--|-----------------|
| 1 | 45' CEDAR POLE | 66-511 |
| 3 | 40' | 66-500X |
| 7 | 4" X 4" X 1/2" TRUSS | 66-507 |
| 200' | #1 B&S 7 STRAND COPPER WIRE | |
| 10 | 3500V PIN INSULATOR | 66-503 |
| | 2" X 1/2" X 1/2" INSULATOR | 66-506 & 66-507 |
| 7 | CANTONER | 66-508 |
| 3 | WIRE BRACKET | 66-509 |
| 6 | BRACKET SPACING - CANTONER FOR #1 TRUSS WIRE | 66-510 |
| 9 | TRUSS INSULATOR | 66-511 |
| 100' | WIRE BRACKET - CANTONER - WIRE BRACKET | 66-512 |
| | WIRE BRACKET - WIRE BRACKET - WIRE BRACKET | 66-513 |
| | WIRE BRACKET - WIRE BRACKET - WIRE BRACKET | 66-514 |
| | WIRE BRACKET - WIRE BRACKET - WIRE BRACKET | 66-515 |
| | WIRE BRACKET - WIRE BRACKET - WIRE BRACKET | 66-516 |
| | WIRE BRACKET - WIRE BRACKET - WIRE BRACKET | 66-517 |
| | WIRE BRACKET - WIRE BRACKET - WIRE BRACKET | 66-518 |
| | WIRE BRACKET - WIRE BRACKET - WIRE BRACKET | 66-519 |
| | WIRE BRACKET - WIRE BRACKET - WIRE BRACKET | 66-520 |

POLE LINE FOR 23KV POWER
INSTALLATION OF BOOM DEEPWELL PUMP
FOR GEORGE - TASHMAN PROPERTY - NEWPORT TWP.
L. DISCHENBERG ELECTRICAL, INC.
DATE 11/10/1966 BY 21/1966

