
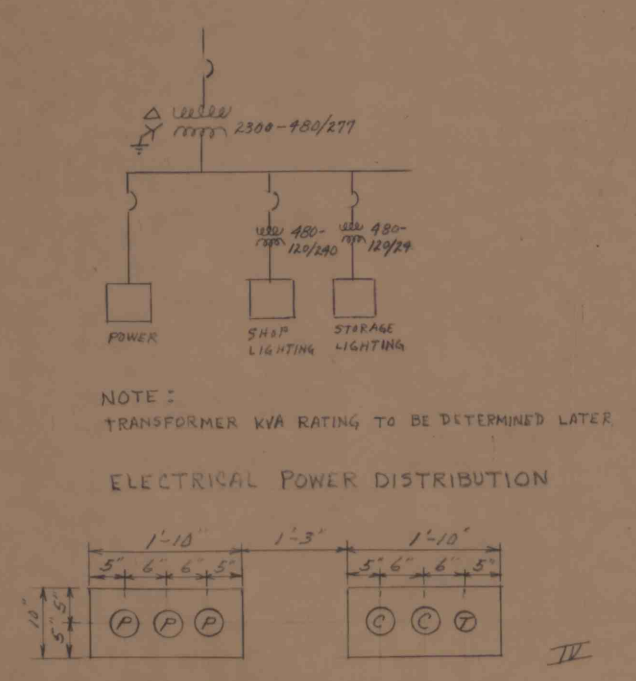
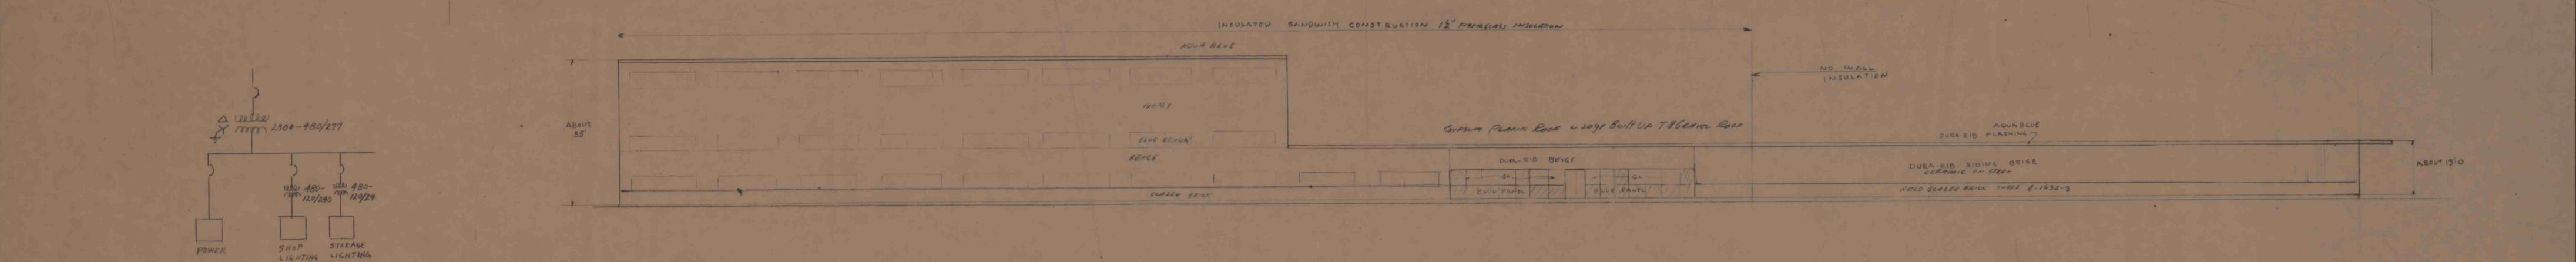


REQUIRED LIST									
NO.	NAME	MC.	NO. PCS.	DESCRIPTION	LGTH.	PC. MC.	REMARKS	WT.	

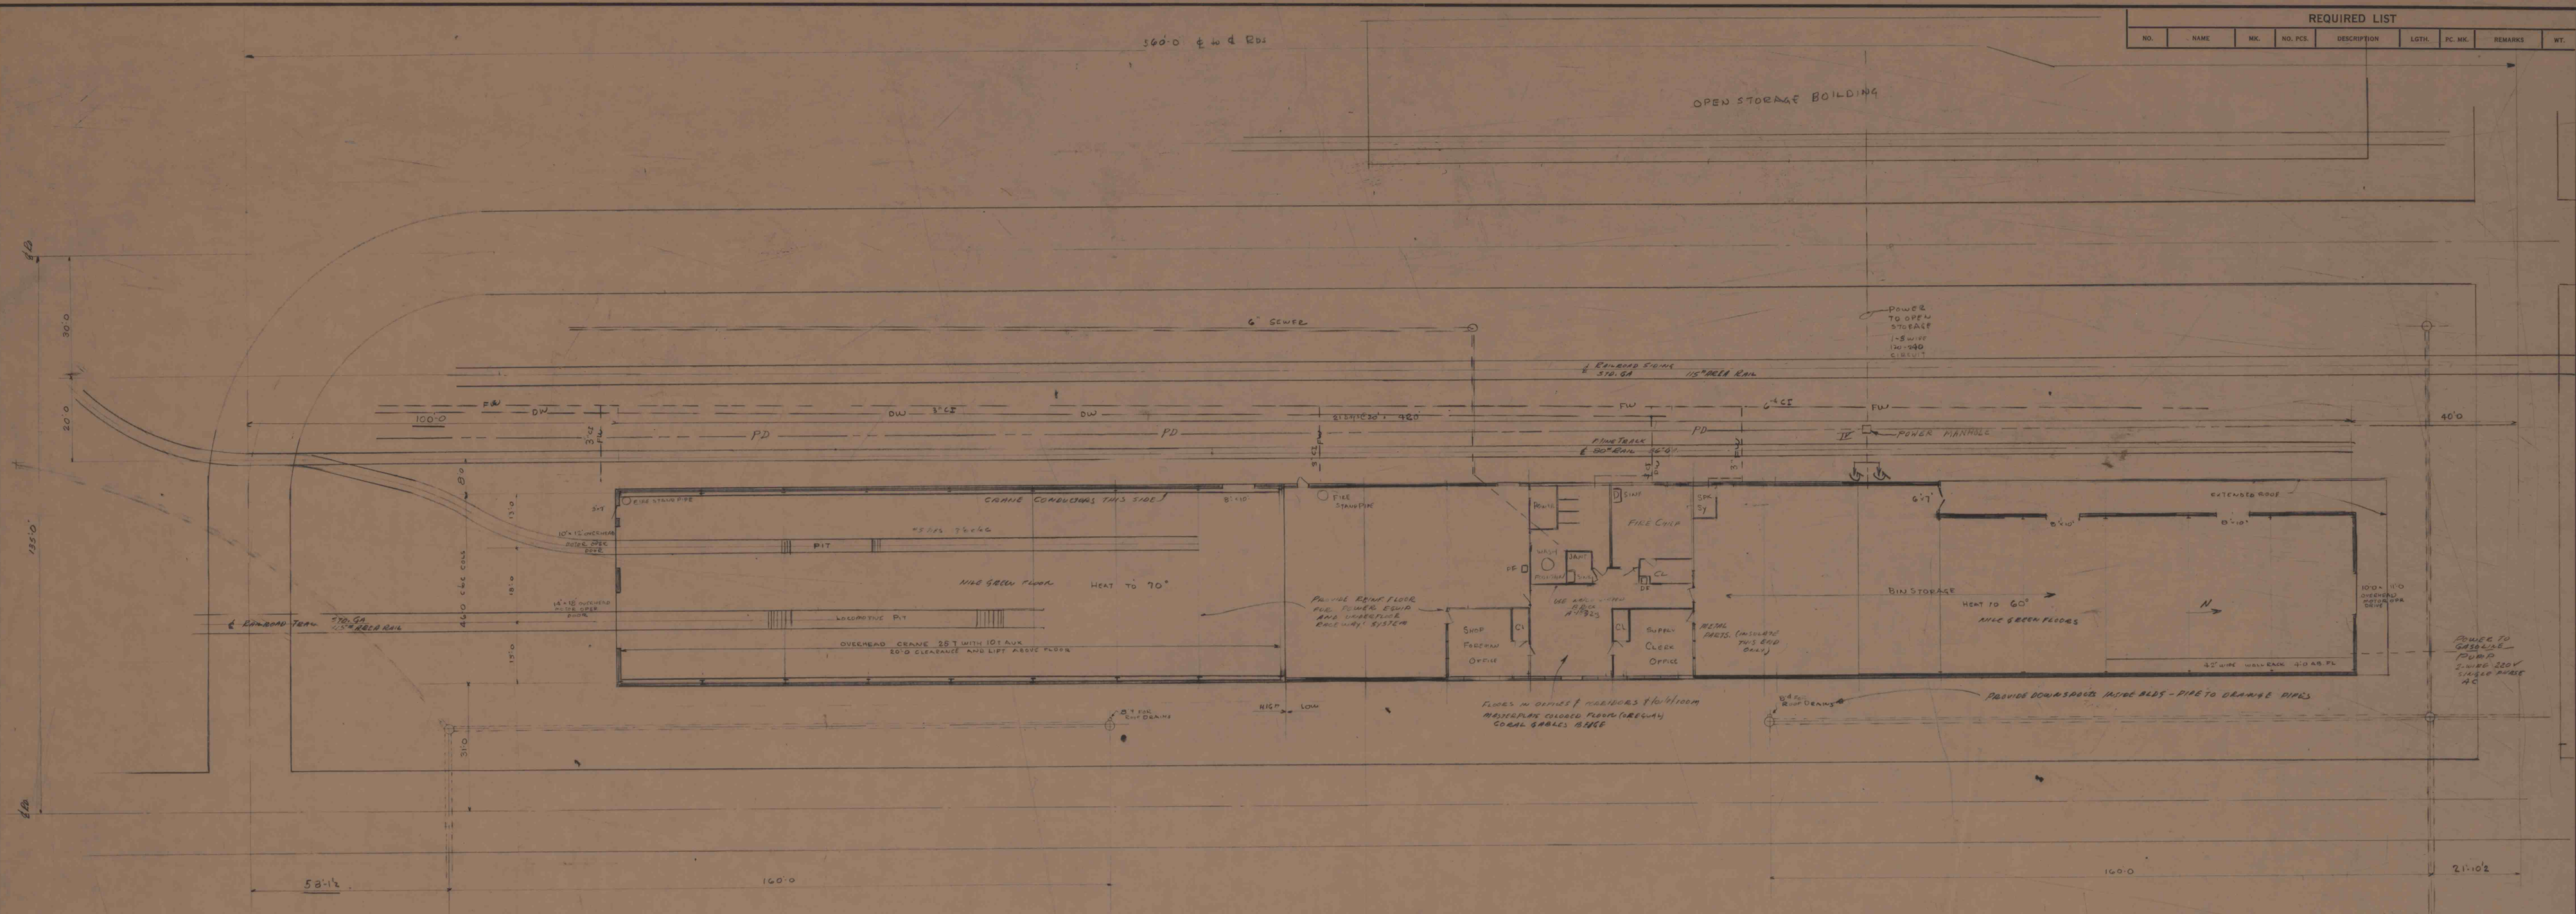

NOTE:
TRANSFORMER KVA RATING TO BE DETERMINED LATER.

ELECTRICAL POWER DISTRIBUTION

SECTION G-G

NOTES:
ALL DUCTS ARE 3" TRANSITS EXCEPT TELEPHONE DUCT IS 2" TRANSIT.
POWER TO OPEN STORAGE BUILDING SHALL BE RUN IN CONDUIT DUCT.

DWG. NO.		REFERENCE		REVISIONS	
GENERAL ARRANGEMENT FOR SHOP & STORAGE BLDG.					
DIVISION		MINE NO.			
BETHLEHEM MINES CORPORATION		ENGINEERING DEPARTMENT-JOHNSTOWN, PA.			
DRAWN		DATE		ORDER NO.	
CHECKED		DATE		SCALE	
APPROVED		DATE		DWG. NO. 3284-257	

II CHANGED PARTIAL TO 905
II CHANGED CENTER AREA
II ADD OFFICE - CHANGED WATER/SWEEPER