
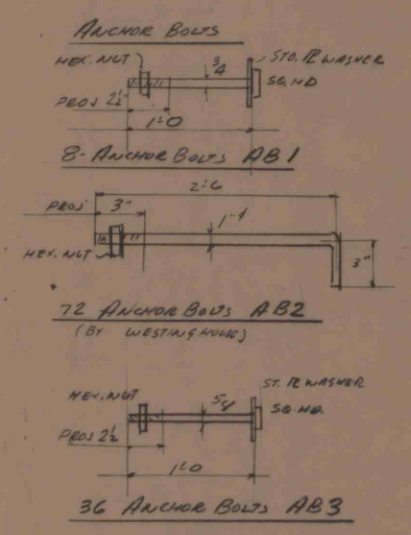


REQUIRED LIST									
NO.	NAME	REL.	NO. PCS.	DESCRIPTION	LOTH.	PC. NO.	REMARKS	WT.	

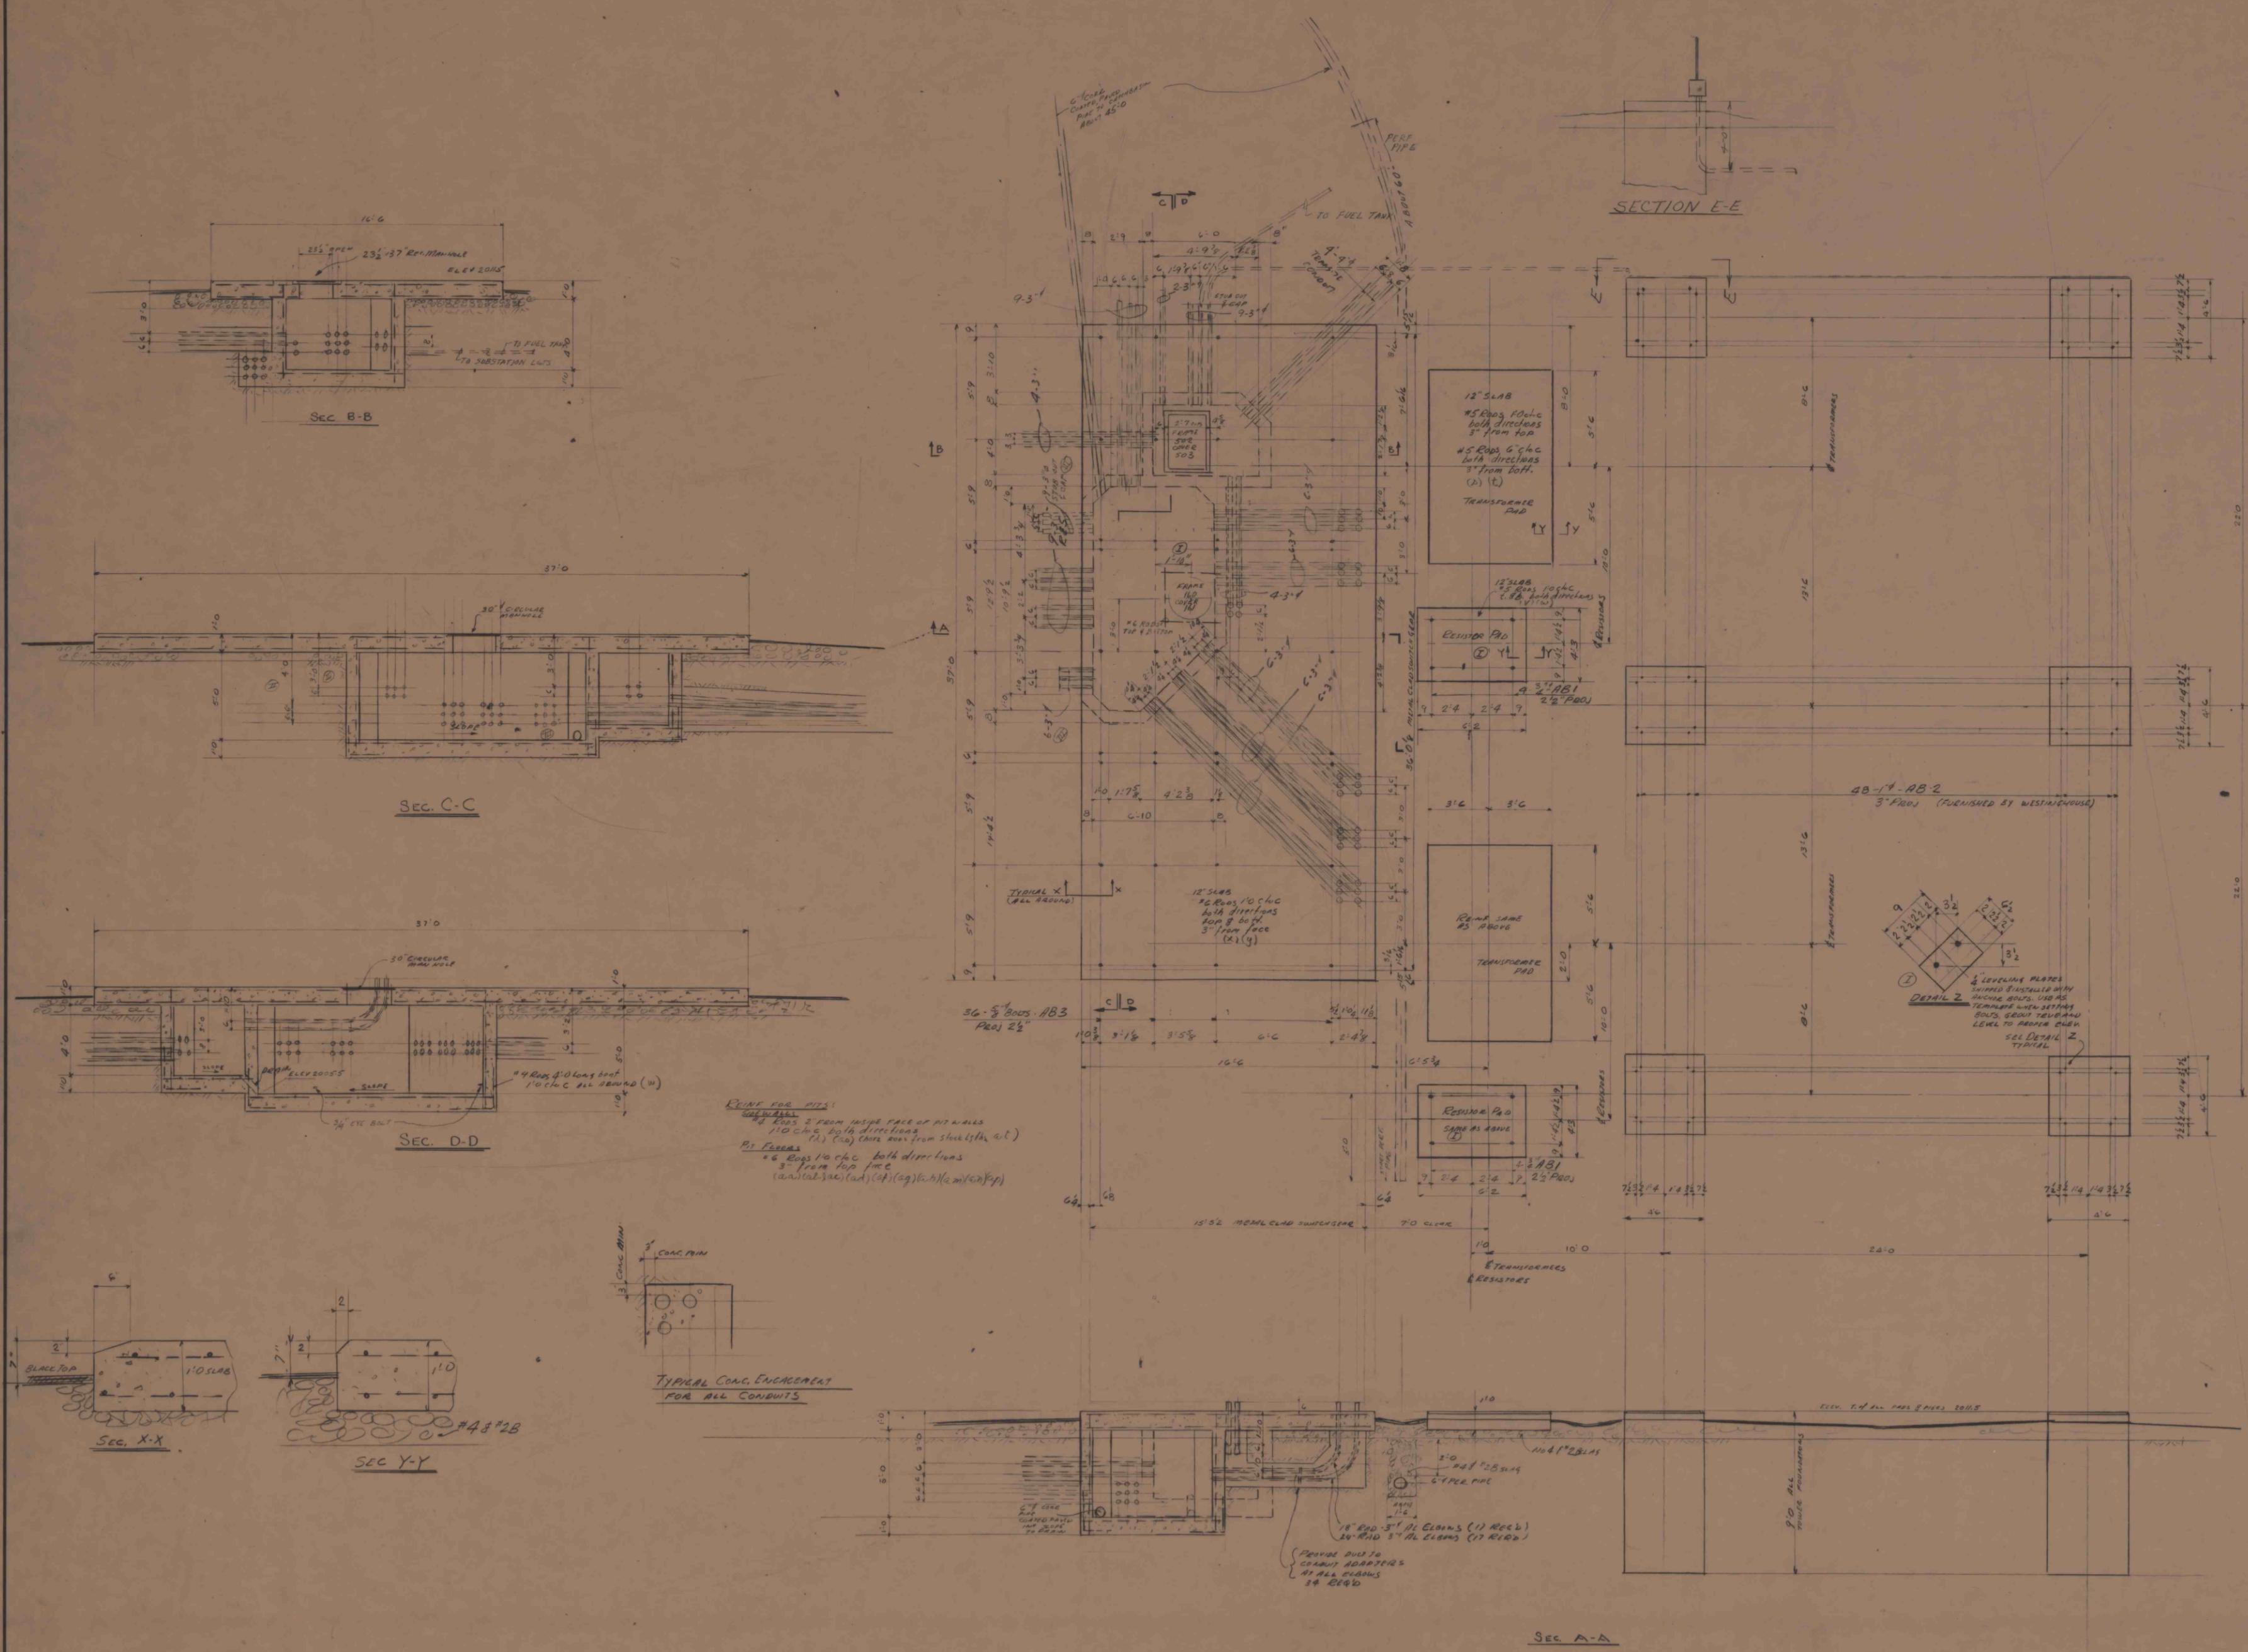

- NOTES:-
- FOOTINGS SUBGRADE TO DRAIN AWAY FROM SPOT ON IN ALL DIRECTIONS
 - PROVIDE ABOUT 6" #4 SLAB, CHOKED WITH #2'S AND FINES WELL COMPACTED UNDER ALL SLABS.
 - PROVIDE 6" SLAB SUBGRADE UNDER ALL CONDUIT RUNS
 - PROVIDE GROUNDING AS SHOWN ON WESTINGHOUSE Dwg 3360793
 - CONCRETE SHALL BE 3000 PSI CONCRETE
 - UPON COMPLETION OF CONCRETE WORK #4 SLAB CHOKED WITH #2'S AND FINES SHALL BE COMPACTED AND DRESSED FOR DRAINAGE AWAY FROM ALL PADS & TIERS
 - 1" MIN. HOLE FRAME "502 COVER" 503 CAST IRON 1" (ALLEGHENY FOUNDRY CO.)
 - ALL CONDUITS ARE 3" #1 TENSILE CONDUITS EXCEPT AS NOTED
 - TERMINATE DUST RUNS WITH PORCELAIN DUST BELLS IN MAN HOLES.

438 D943	WESTINGHOUSE DES. 600A	J	7-10-24	CB
DWG. NO.	REFERENCE	NO.	DATE	BY
REVISIONS				
FOUNDATION FOR 45KV TO 13.2KV SUBSTATION CAMBRIA SLOPE				
DIVISION CAMBRIA		MINE NO. 32		
BETHLEHEM MINES CORPORATION				
ENGINEERING DEPARTMENT-JOHNSTOWN, PA.				
DRAWN SMC	DATE 6-62	ORDER NO. 9028-034		
CHECKED	DATE	SCALE 1/4"=1'-0"		
APPROVED	DATE	DWG. NO. 33 L3-269		