


NOTES

ALL DUCTS ARE 3" Ø TRANSITE EXCEPT TELEPHONE DUCT IS 2" Ø TRANSITE.
DUCT RUNS PASSING UNDER ROADS & RAILWAY TRACKS SHALL BE REINFORCED WITH 3/8" Ø STEEL RODS. NO STEEL SHALL BE USED BETWEEN DUCTS.
1/2" BARE COPPER GROUND WIRE SHALL BE RUN WITH ALL POWER DUCTS.
DUCT RUNS SHALL SLOPE TOWARD MANHOLES WITH MINIMUM SLOPE OF 1" PER 100 FT. LENGTH.
CABLES IN MANHOLES SHALL BE ARRANGED ON UNISTRUT ASSEMBLIES IN THE FIELD.


LEGEND

— BMC DUCT
--- RFS DUCT


REQUIRED LIST									
NO.	NAME	PK.	NO. PCS.	DESCRIPTION	LGTH.	PC. MK.	REMARKS	WT.	

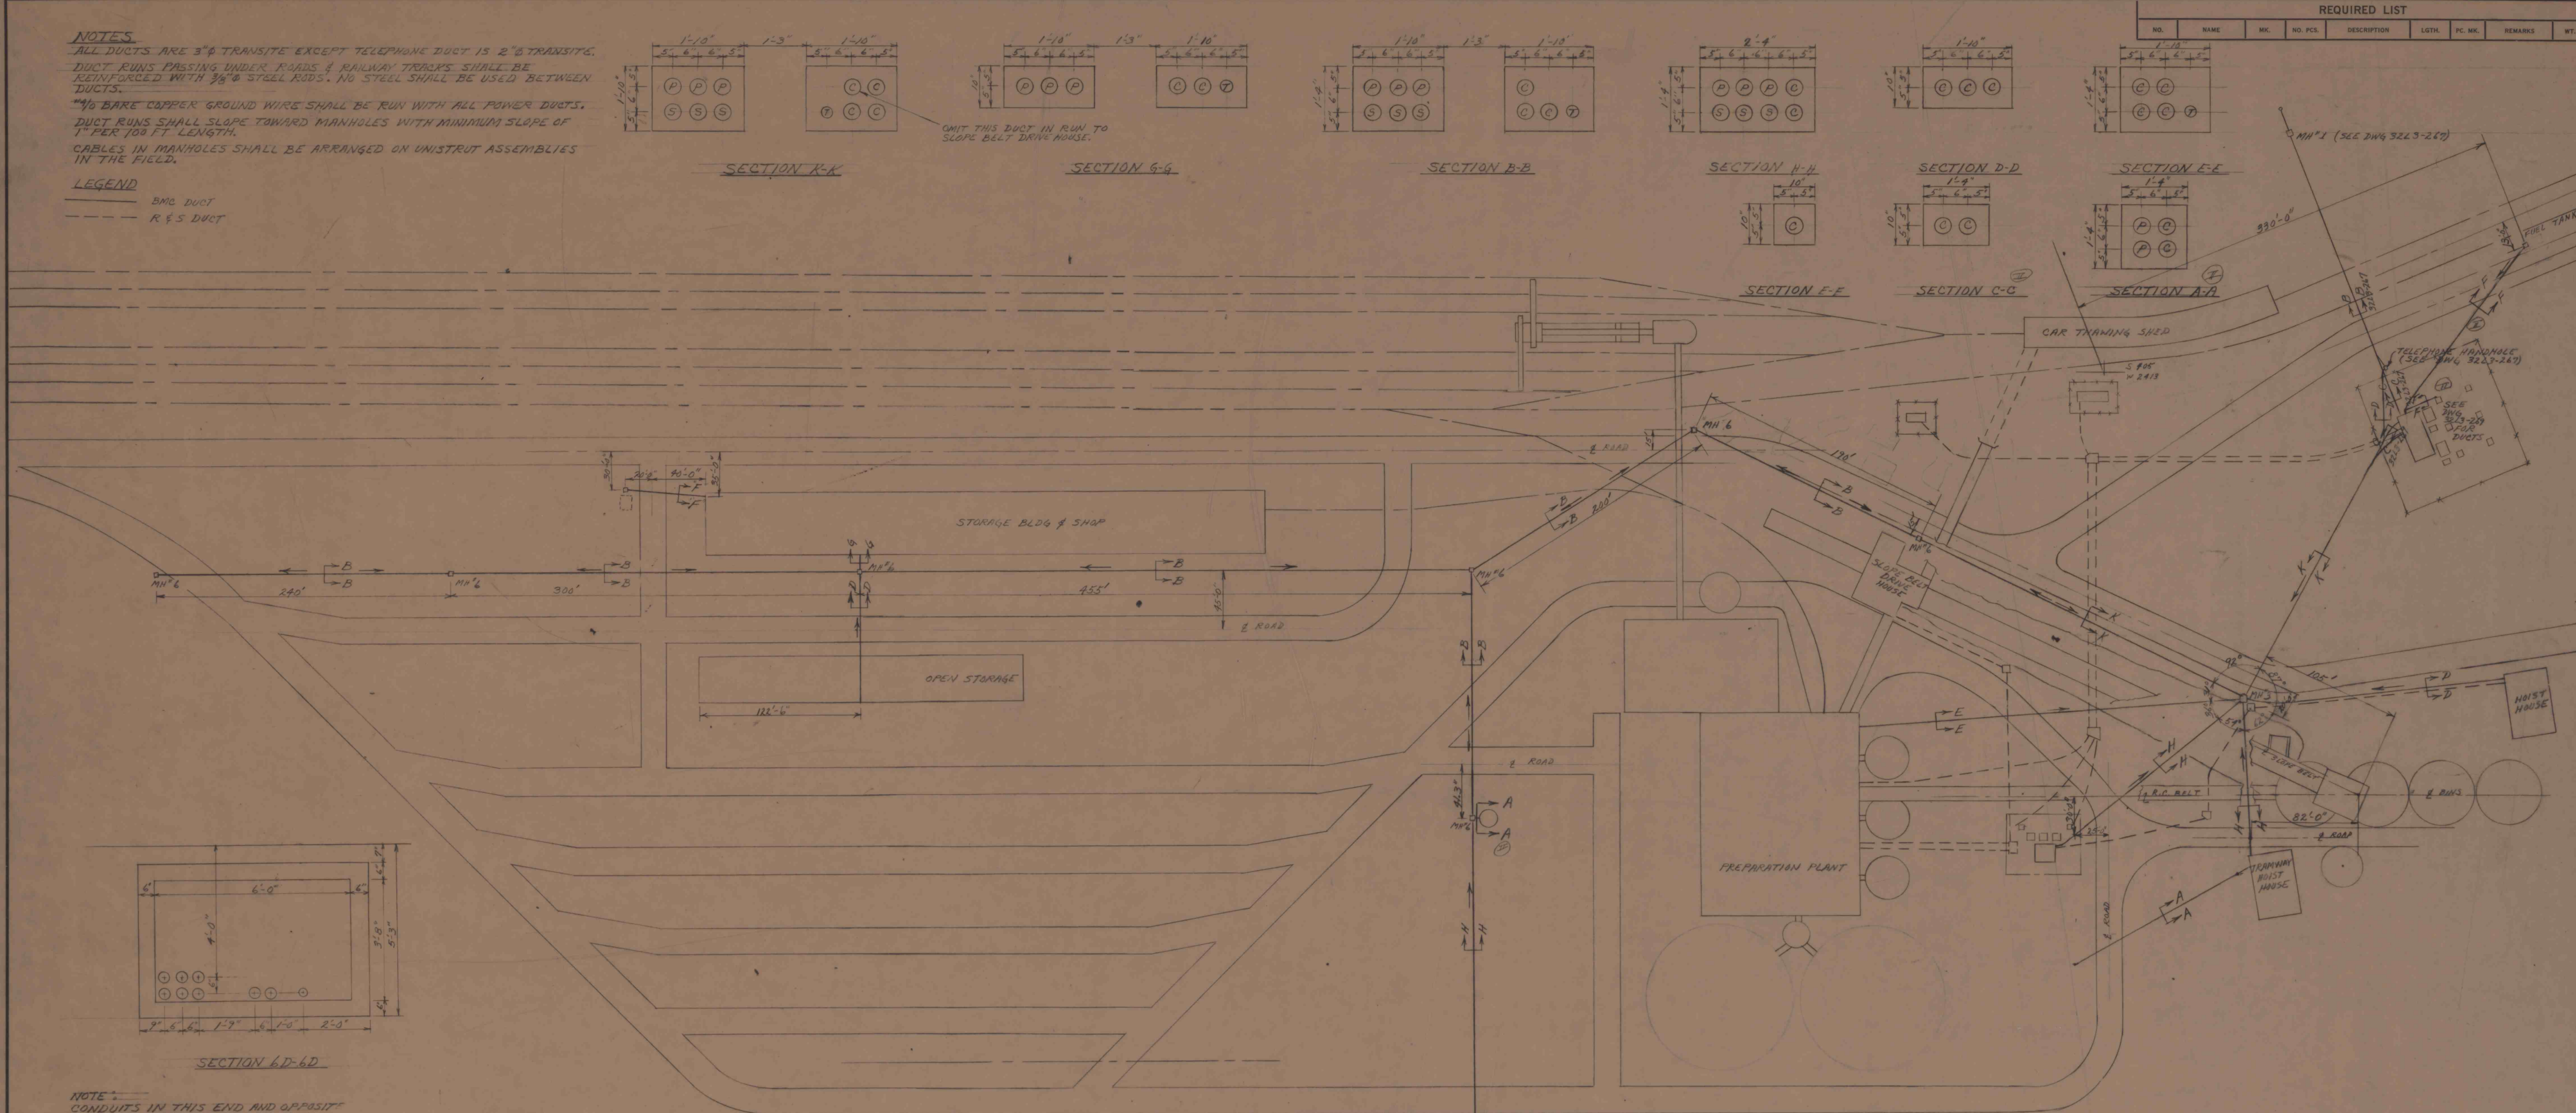


NOTE: CONDUITS IN THIS END AND OPPOSITE END SHALL BE ALTERED IN THE FIELD TO MATCH SECTION VIEWS OF THE CONDUIT RUNS. SHOULD NO SECTION VIEWS BE SHOWN, STUB OUT THESE DUCTS AND CAP FOR FUTURE USE.

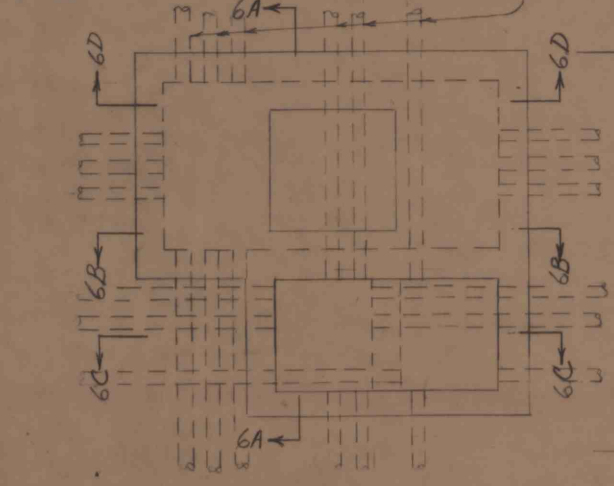


SECTION 6D-6D

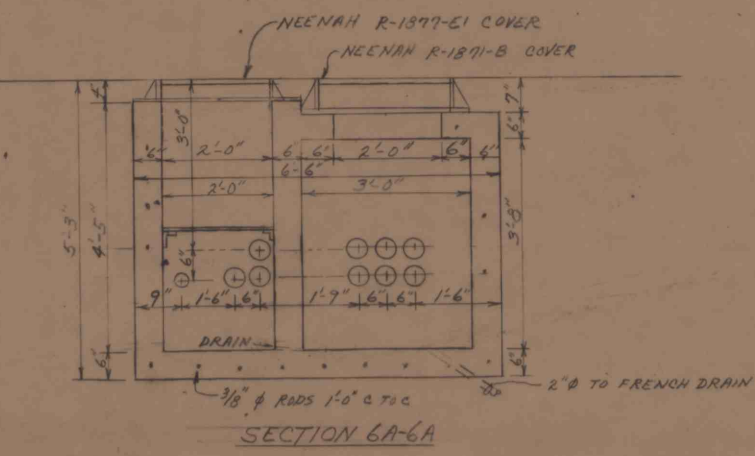


SECTION 6A-6A

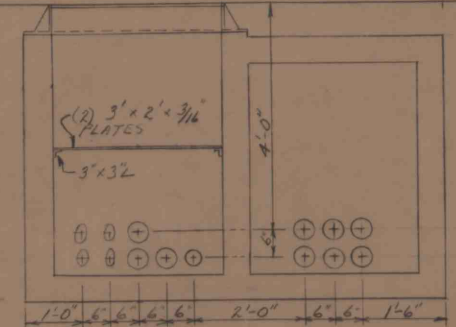


SECTION 3D-3D

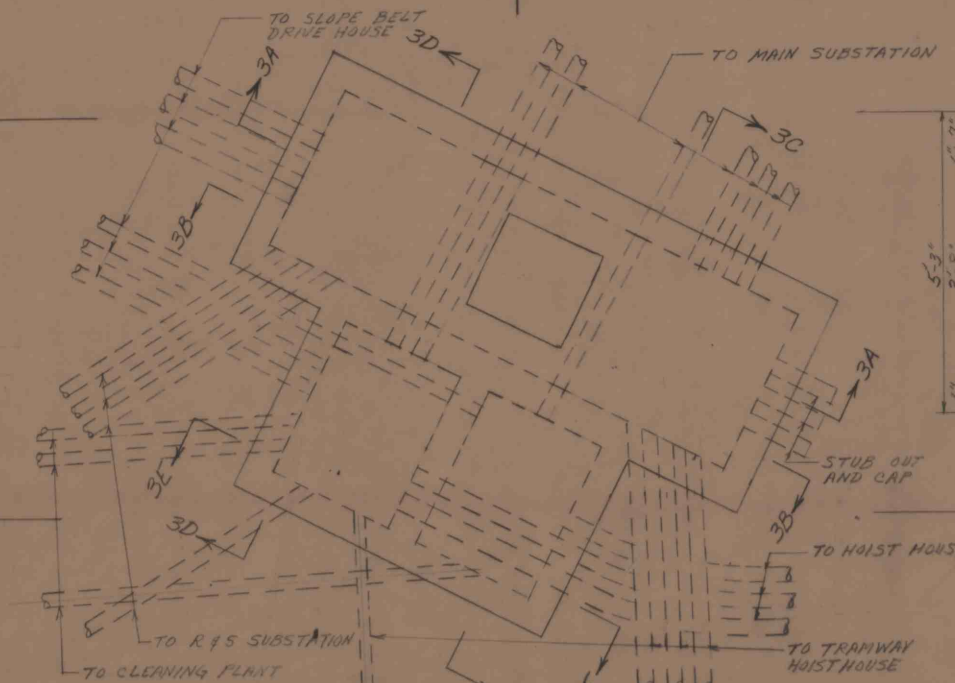


DETAIL MH 3

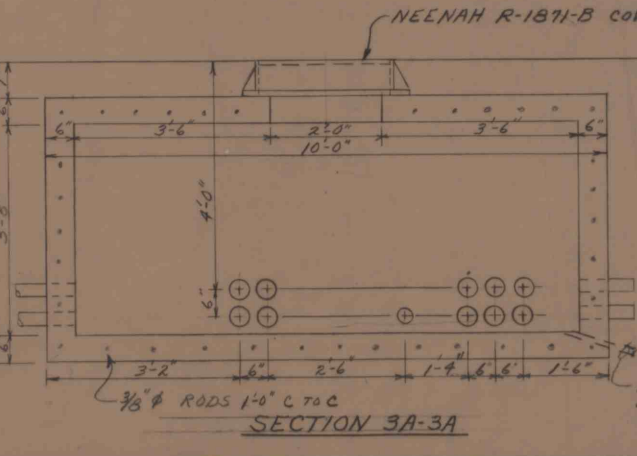

SECTION 3A-3A

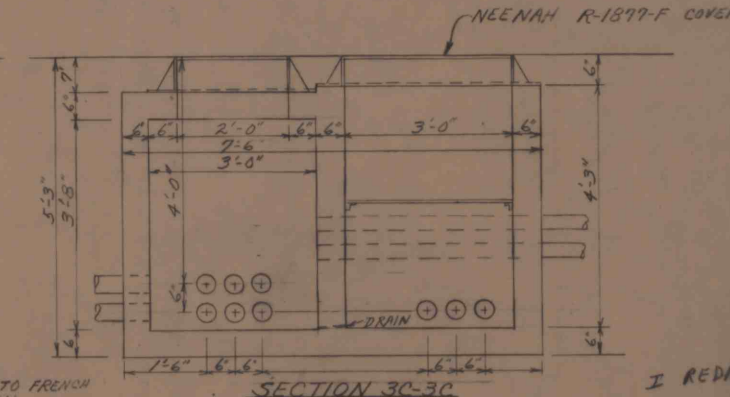


SECTION 3C-3C

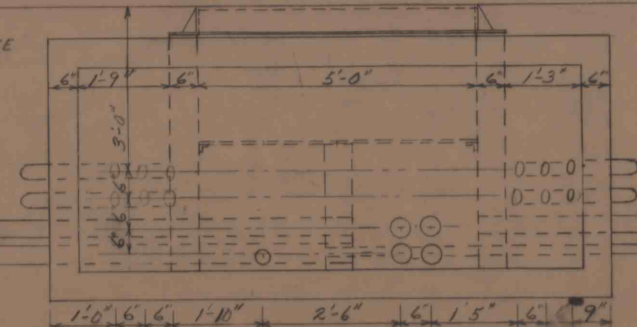


SECTION 3B-3B


NOTE: REVISE SECTIONS 6B, 6C, & 6D IN THE FIELD TO MATCH SECTION VIEWS OF CONDUIT RUNS.

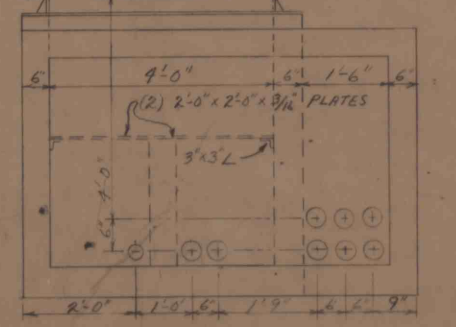

SECTION 6B-6B

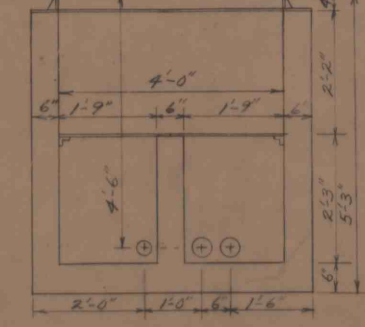

SECTION 6C-6C

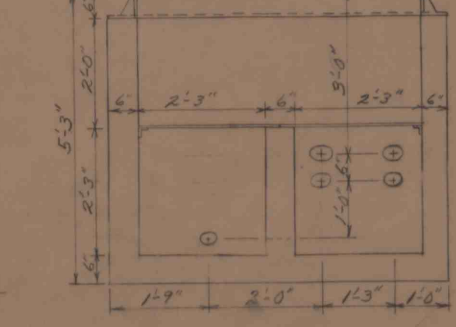

SECTION 3E-3E

				I		8/12		05	
				J		8/12		30	
DWG. NO.		REFERENCE				NO.		DATE	
								BT	
								REVISIONS	
MINE 32 SLOPE									
ELECTRICAL DISTRIBUTION SYSTEM-SH. 2									
DIVISION CAMBRIA					MINE NO. 33				
BETHLEHEM MINES CORPORATION									
ENGINEERING DEPARTMENT-JOHNSTOWN, PA.									
DRAWN C. DRENN					DATE 6/62				
ORDER NO.									
CHECKED					DATE				
SCALE					= 5/8" = 1'				
APPROVED					DWG. NO. 3313-268				
DATE									