




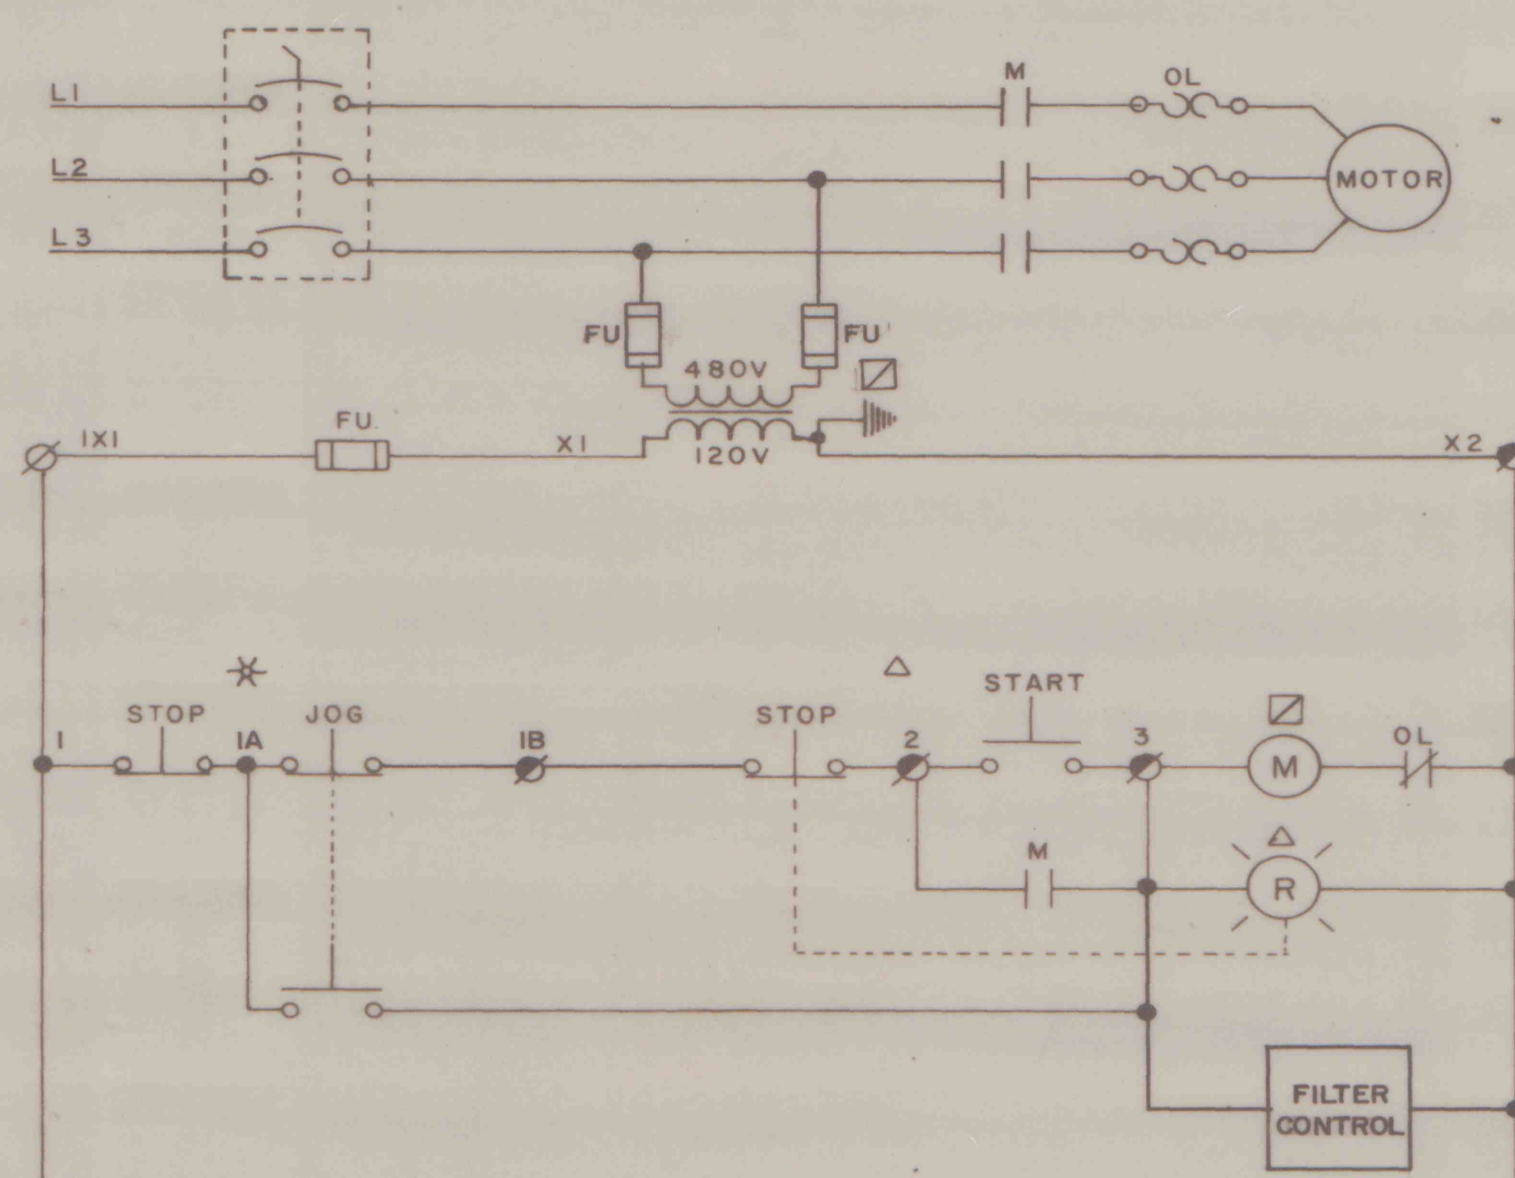

UNIT	DESCRIPTION	HP	MCC
30D	FILTER BLOWER	20	P2

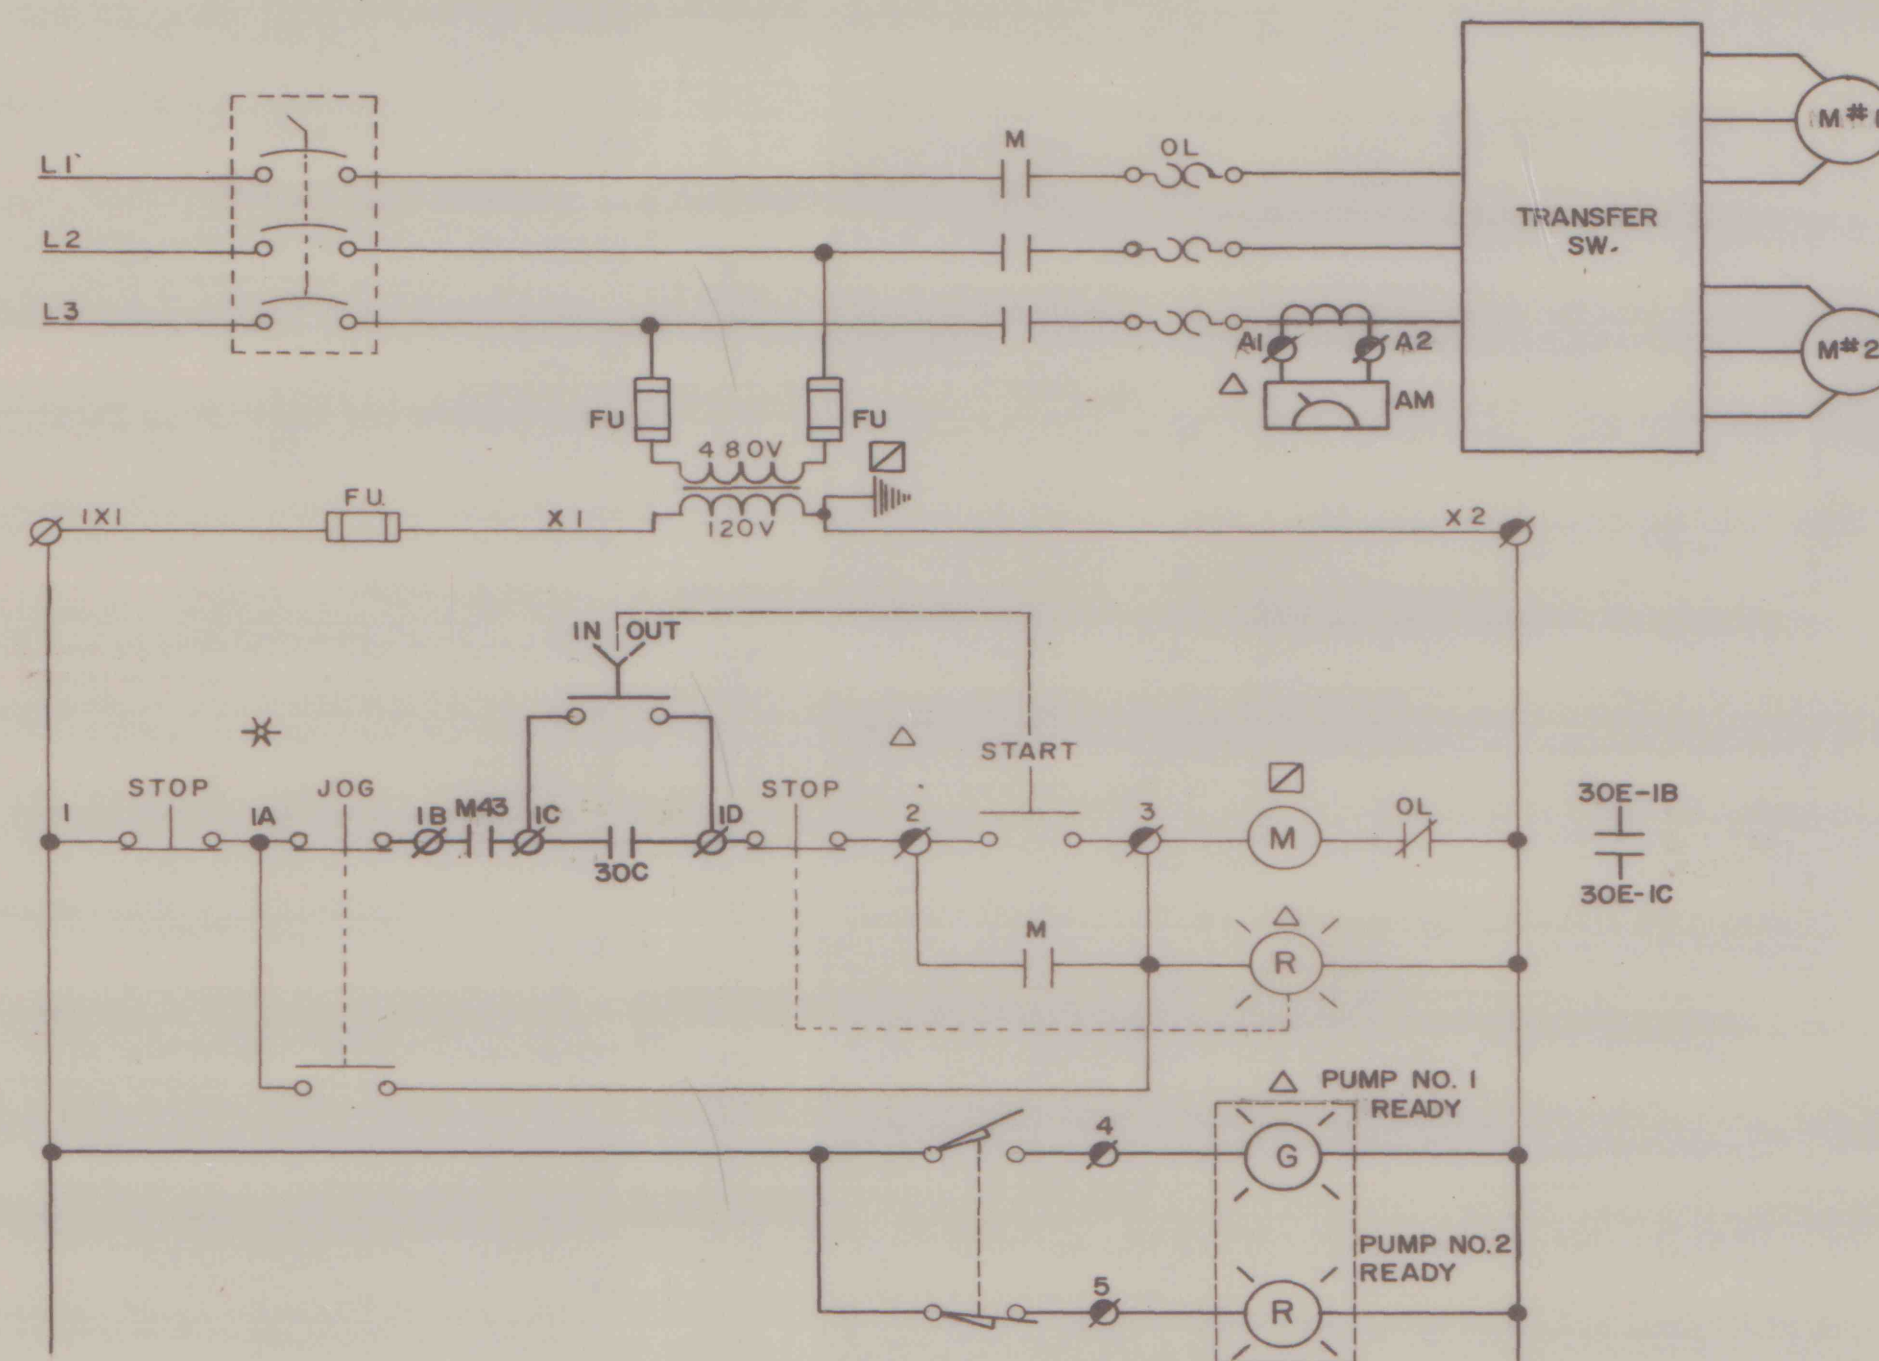


UNIT	DESCRIPTION	HP	MCC
3I	FILTRATE PUMP	25	P2

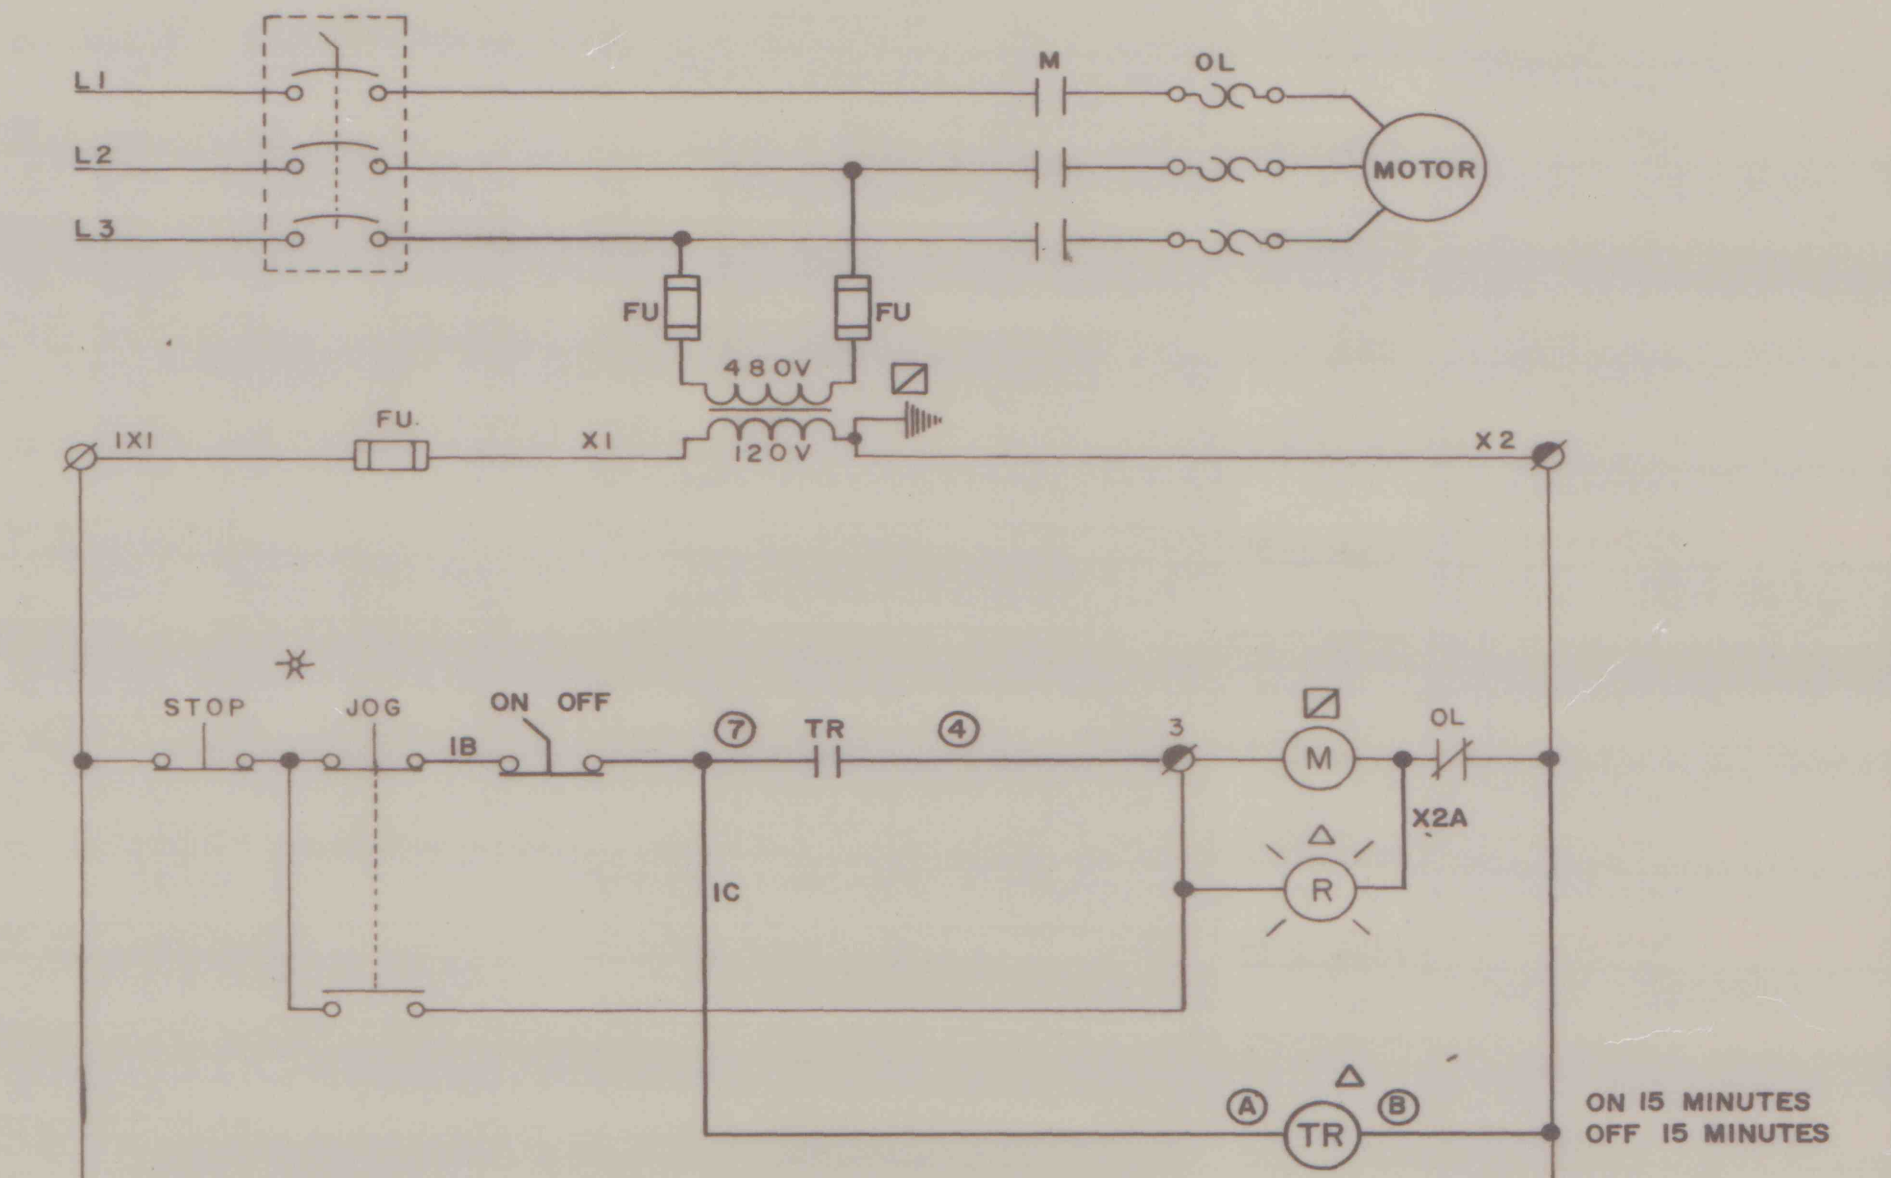


NOTE: (Z) = TERMINAL NUMBERS

UNIT	DESCRIPTION	HP	MCC
46B	MAGNESIUM HYDROXIDE MIXER		

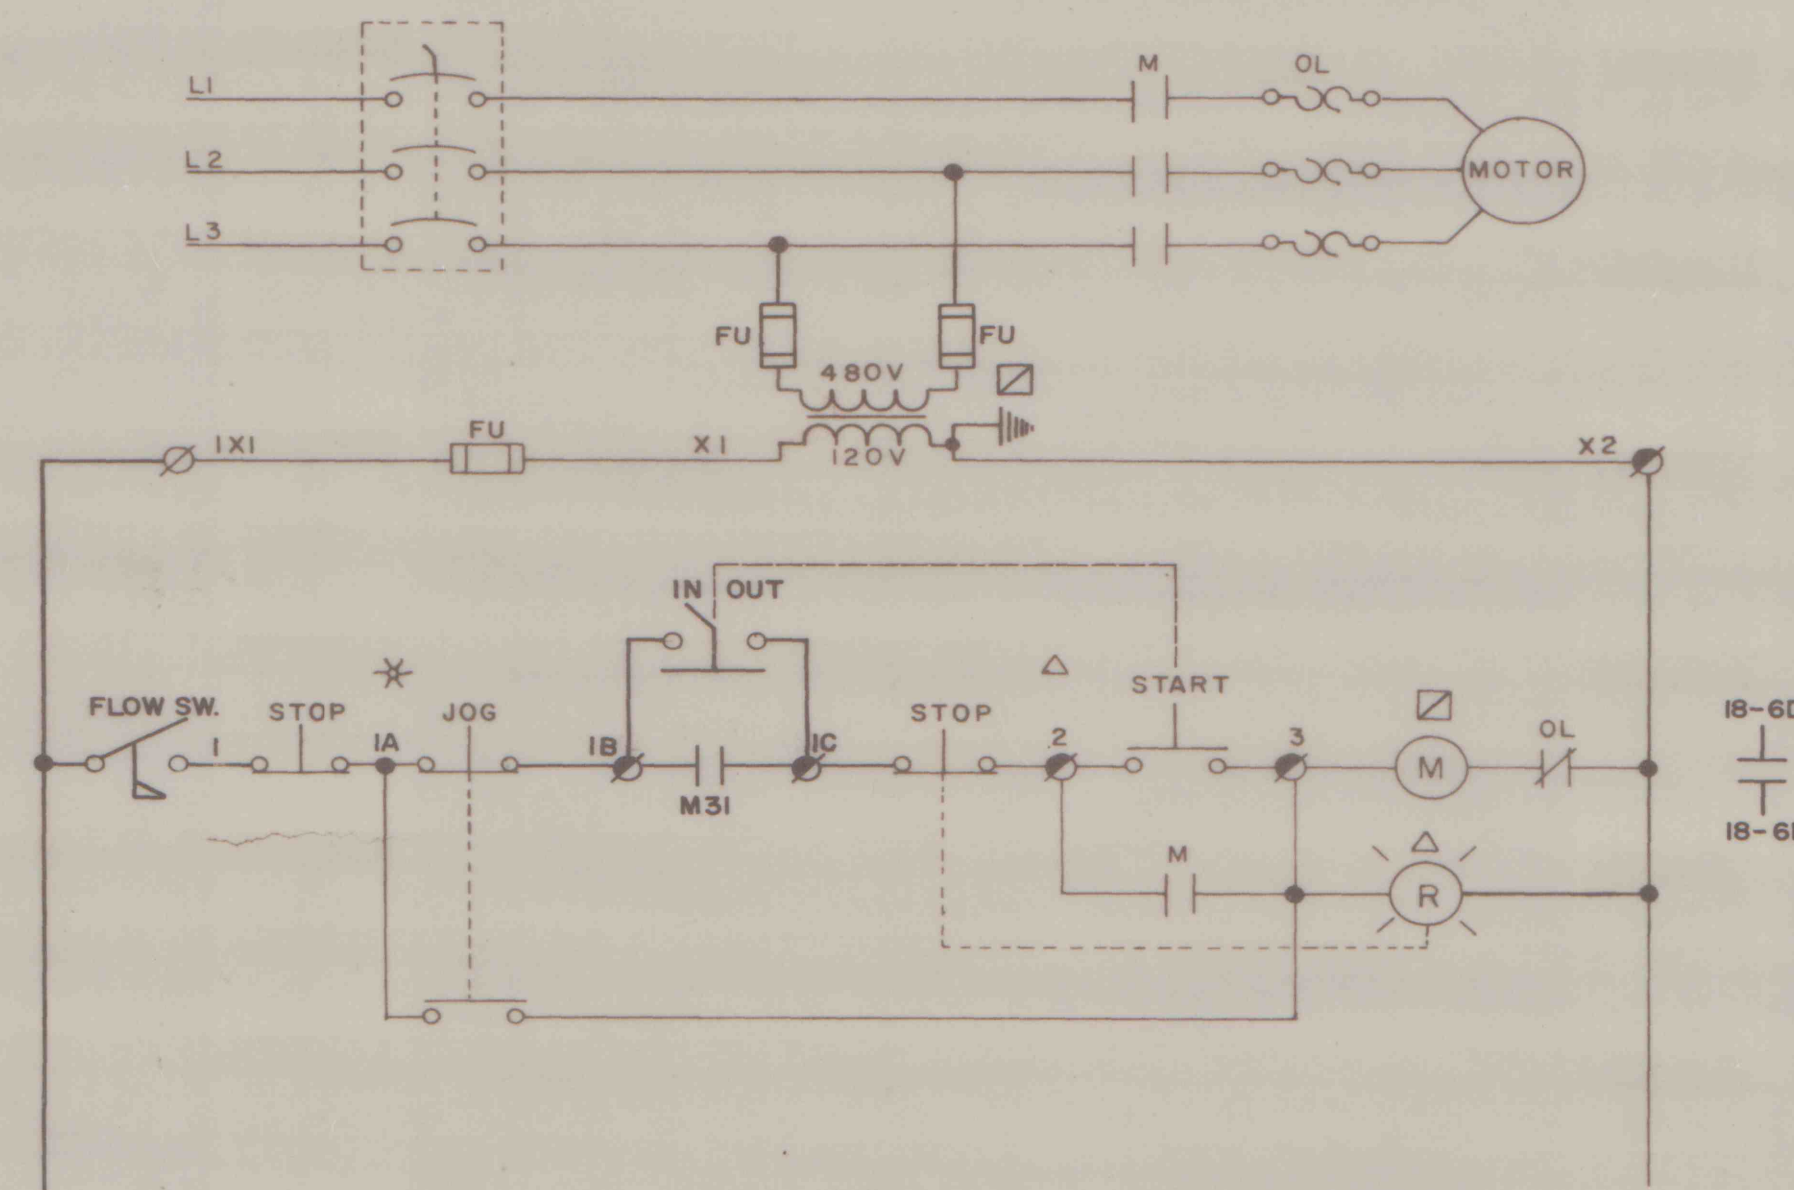

UNIT	DESCRIPTION	HP	MCC
30E	FILTER VACUUM PUMP	250	P2

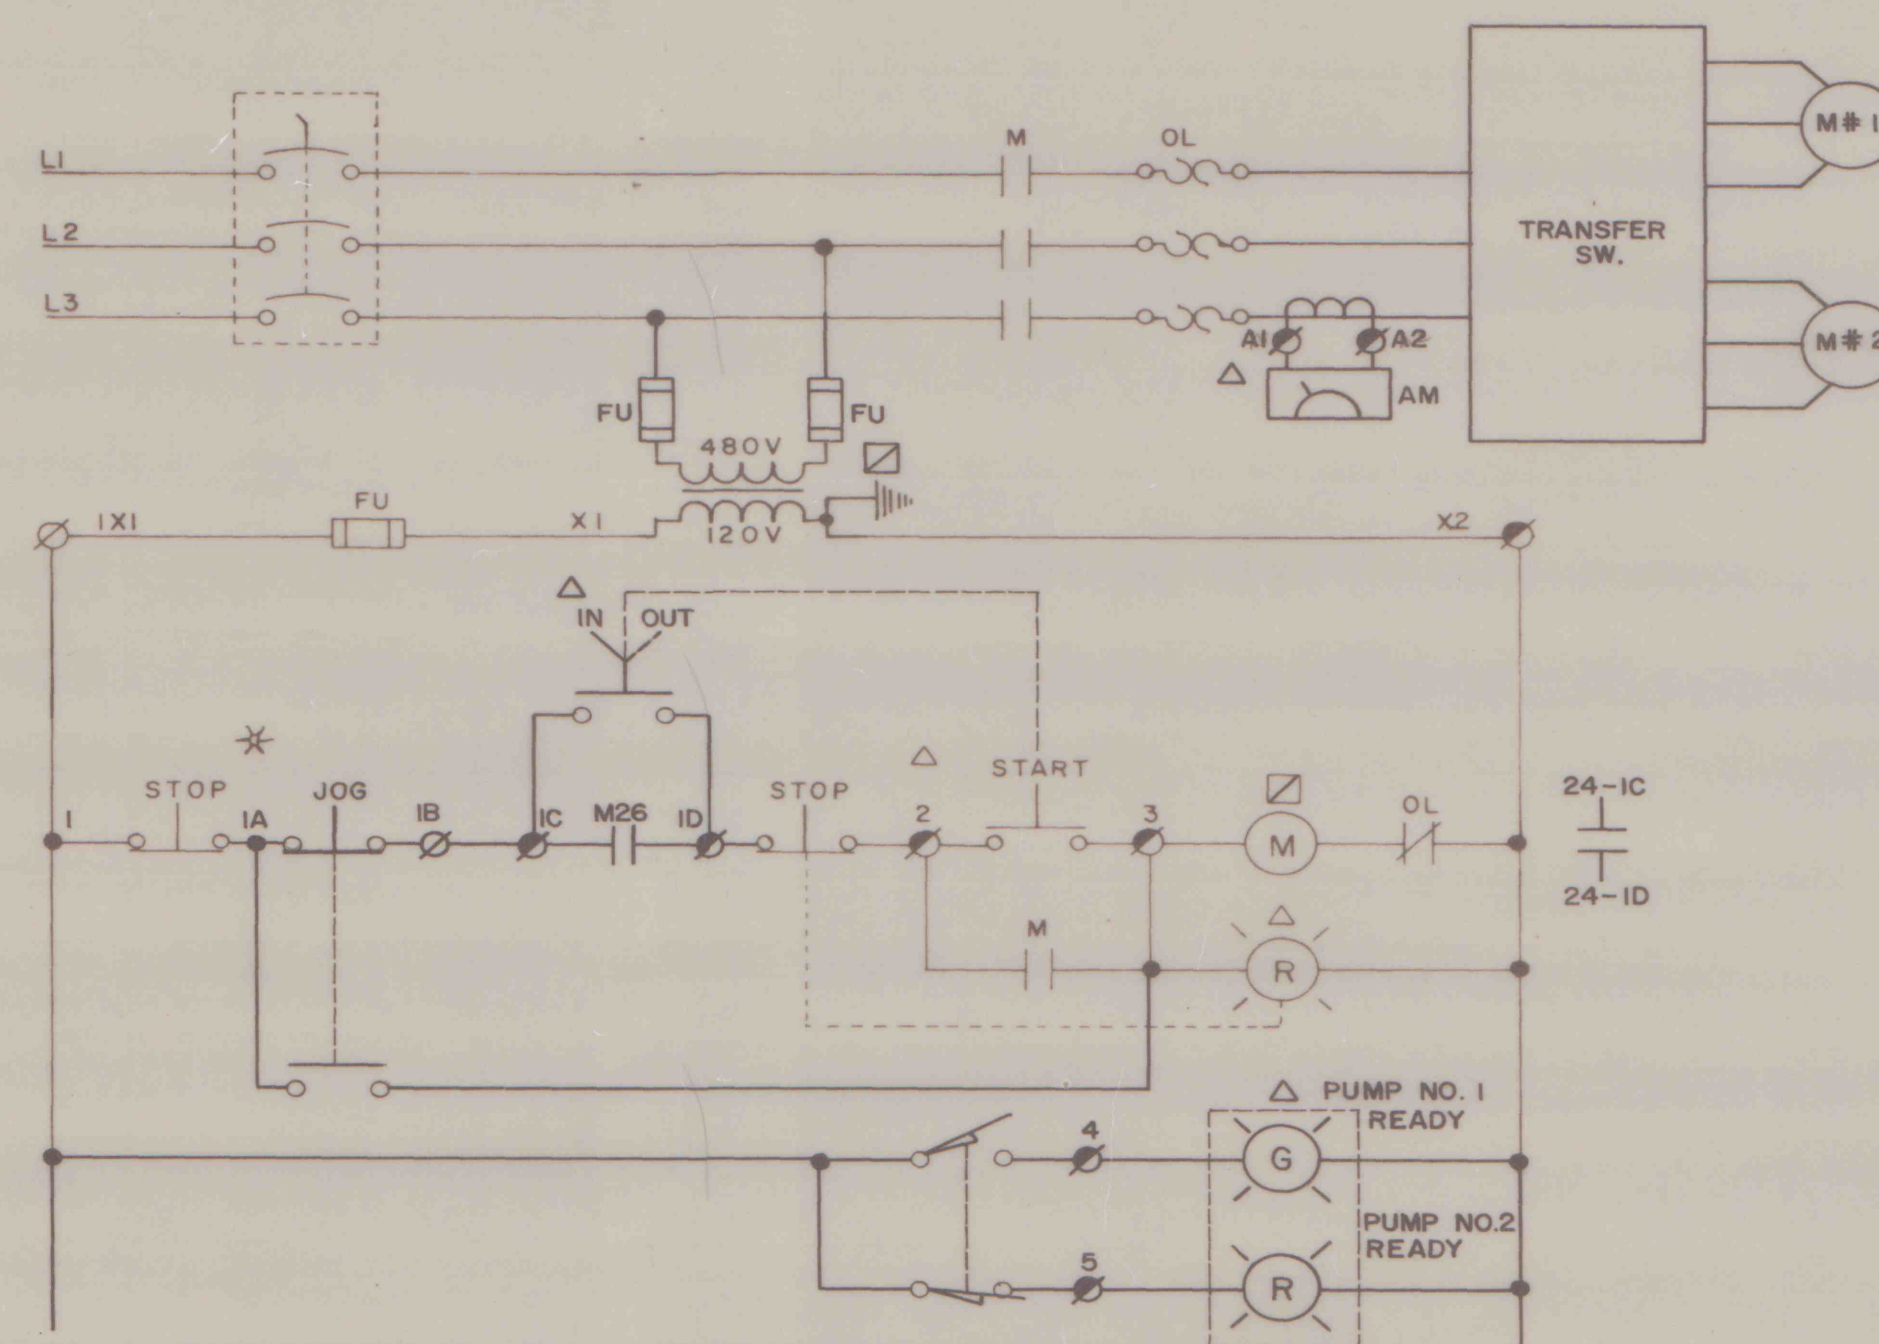

UNIT	DESCRIPTION	HP	MCC
32	CLARIFIER OVERFLOW PUMP	60	P2

E-30	DELETE INTERLOCK IN DISC. SW.	1	7-15-82	LM
E-30	FOR APPROVAL	0	5-20-82	LM
DWG. NO.	REFERENCE	NO.	DATE	BY
BLAIR ELECTRIC SERVICE CO. BELLWOOD, PENNSYLVANIA R & P COAL CO. - KEYSTONE PLANT ELECTRICAL SCHEMATICS DRAWN: JK DATE: 5-20-82 ORDER NO.: W-7478 CHECKED: DATE: SCALE: <i>X</i> APPROVED: DATE: DWG. NO. E-30				