




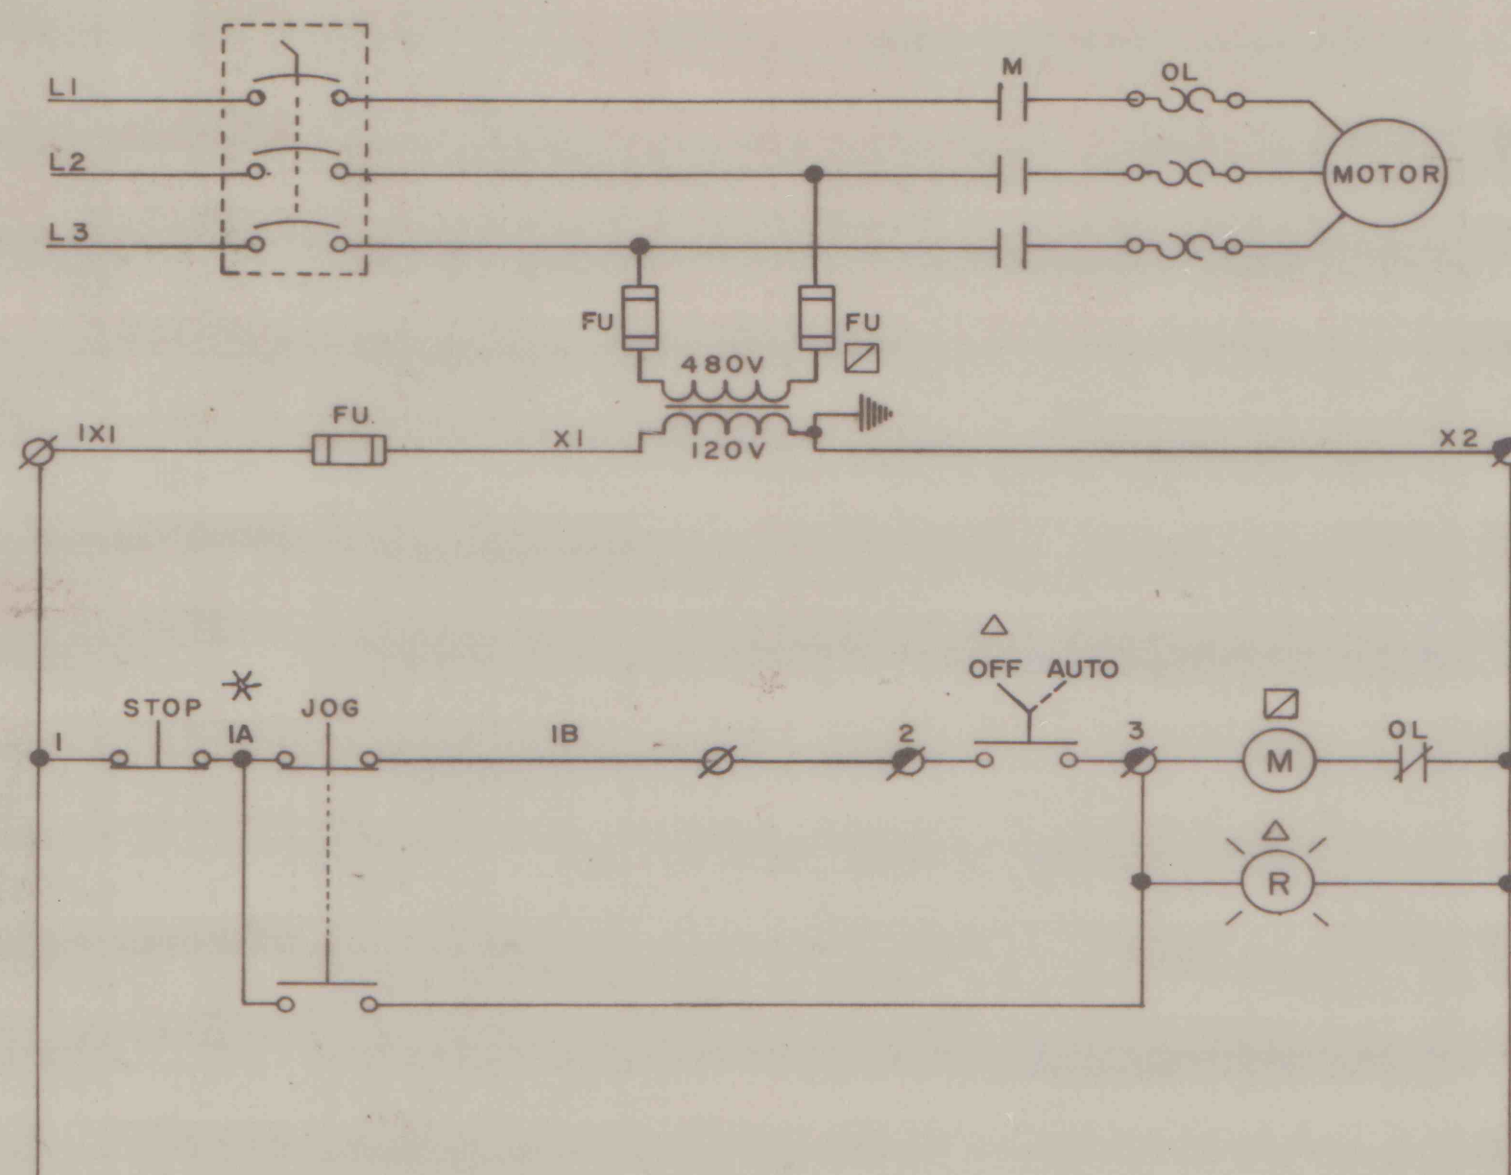


UNIT	DESCRIPTION	HP	MCC
41	CLEAN-UP PUMP	15	P2

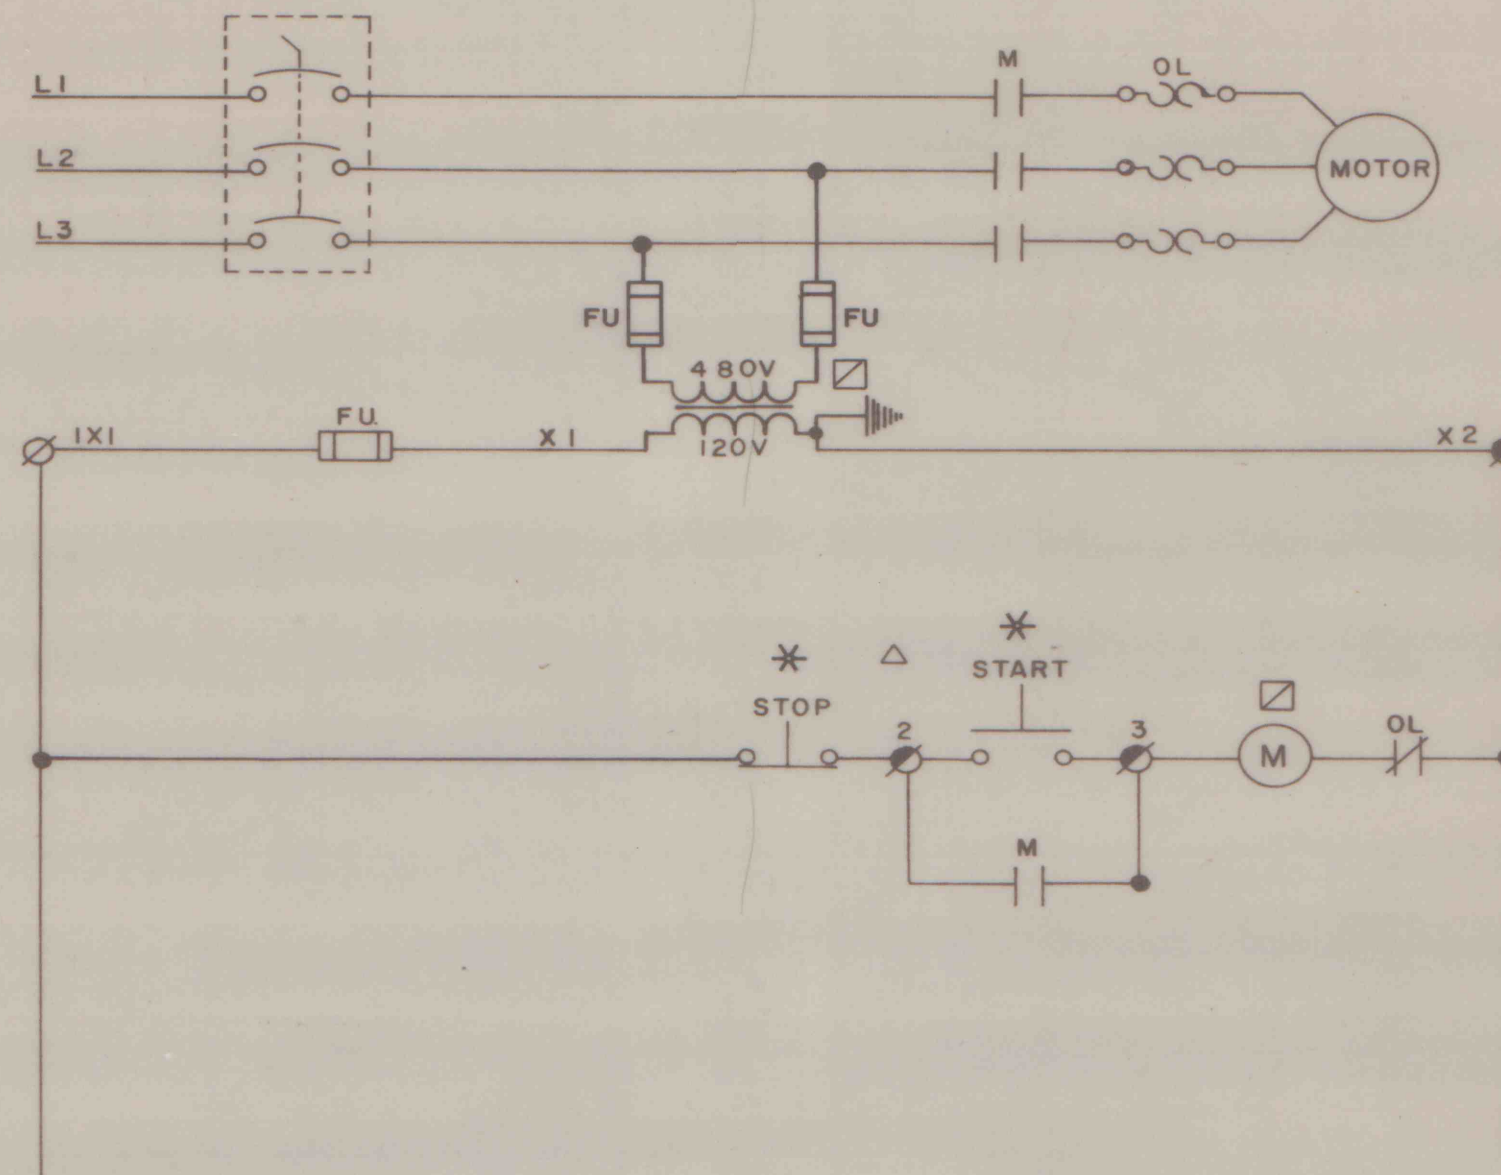


UNIT	DESCRIPTION	HP	MCC
46	FLOCC. MIXER		

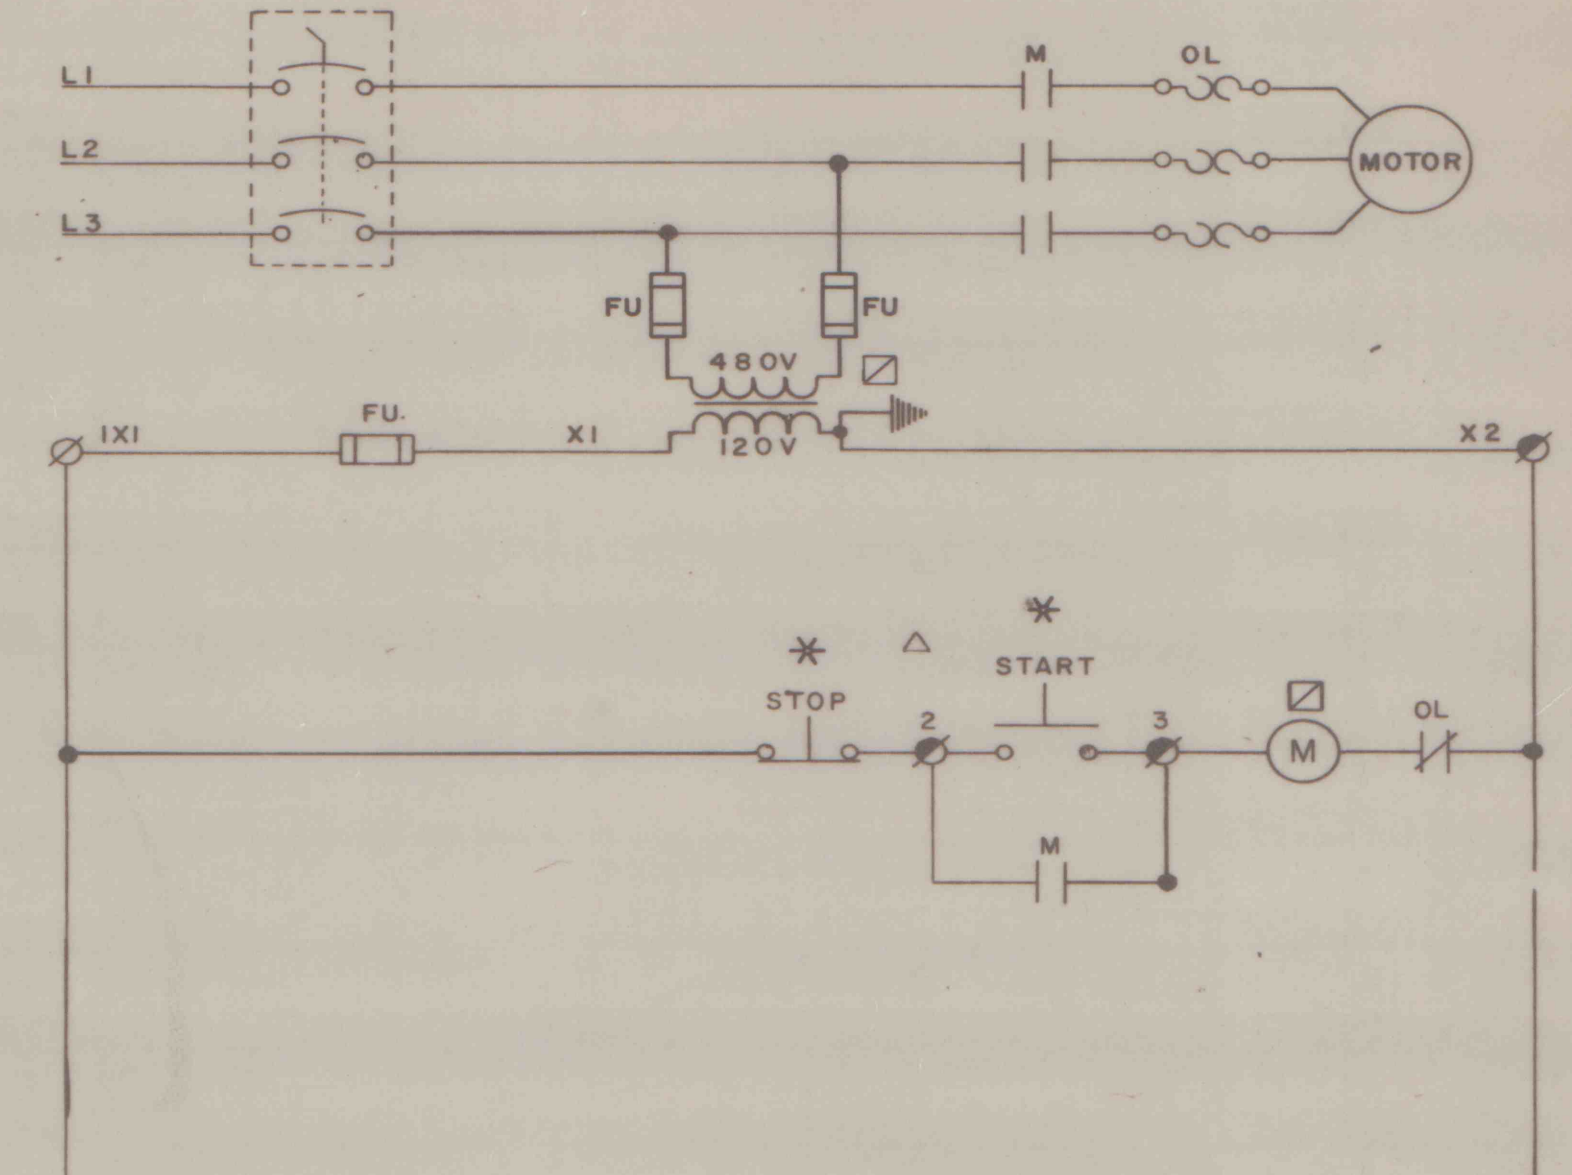

UNIT	DESCRIPTION	HP	MCC
46A	FLOCC. MIXER		

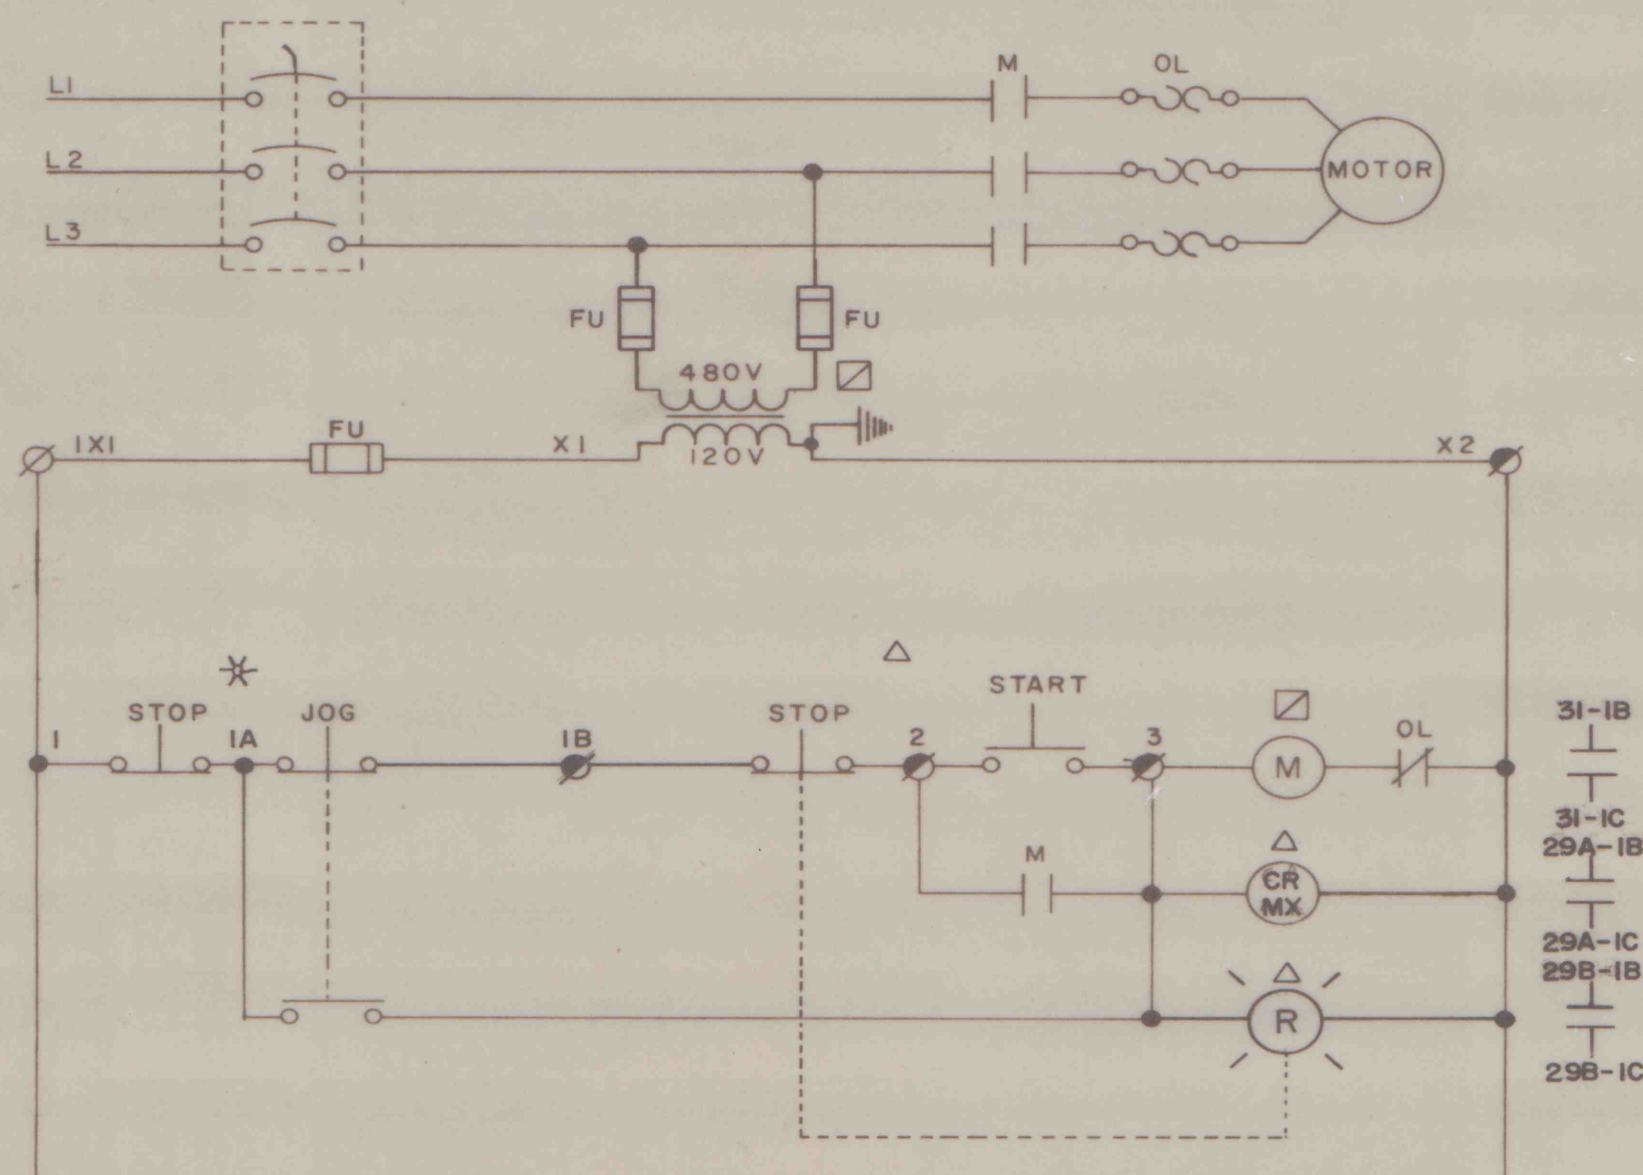

UNIT	DESCRIPTION	HP	MCC
43	GLAND SEAL PUMP	15	P2

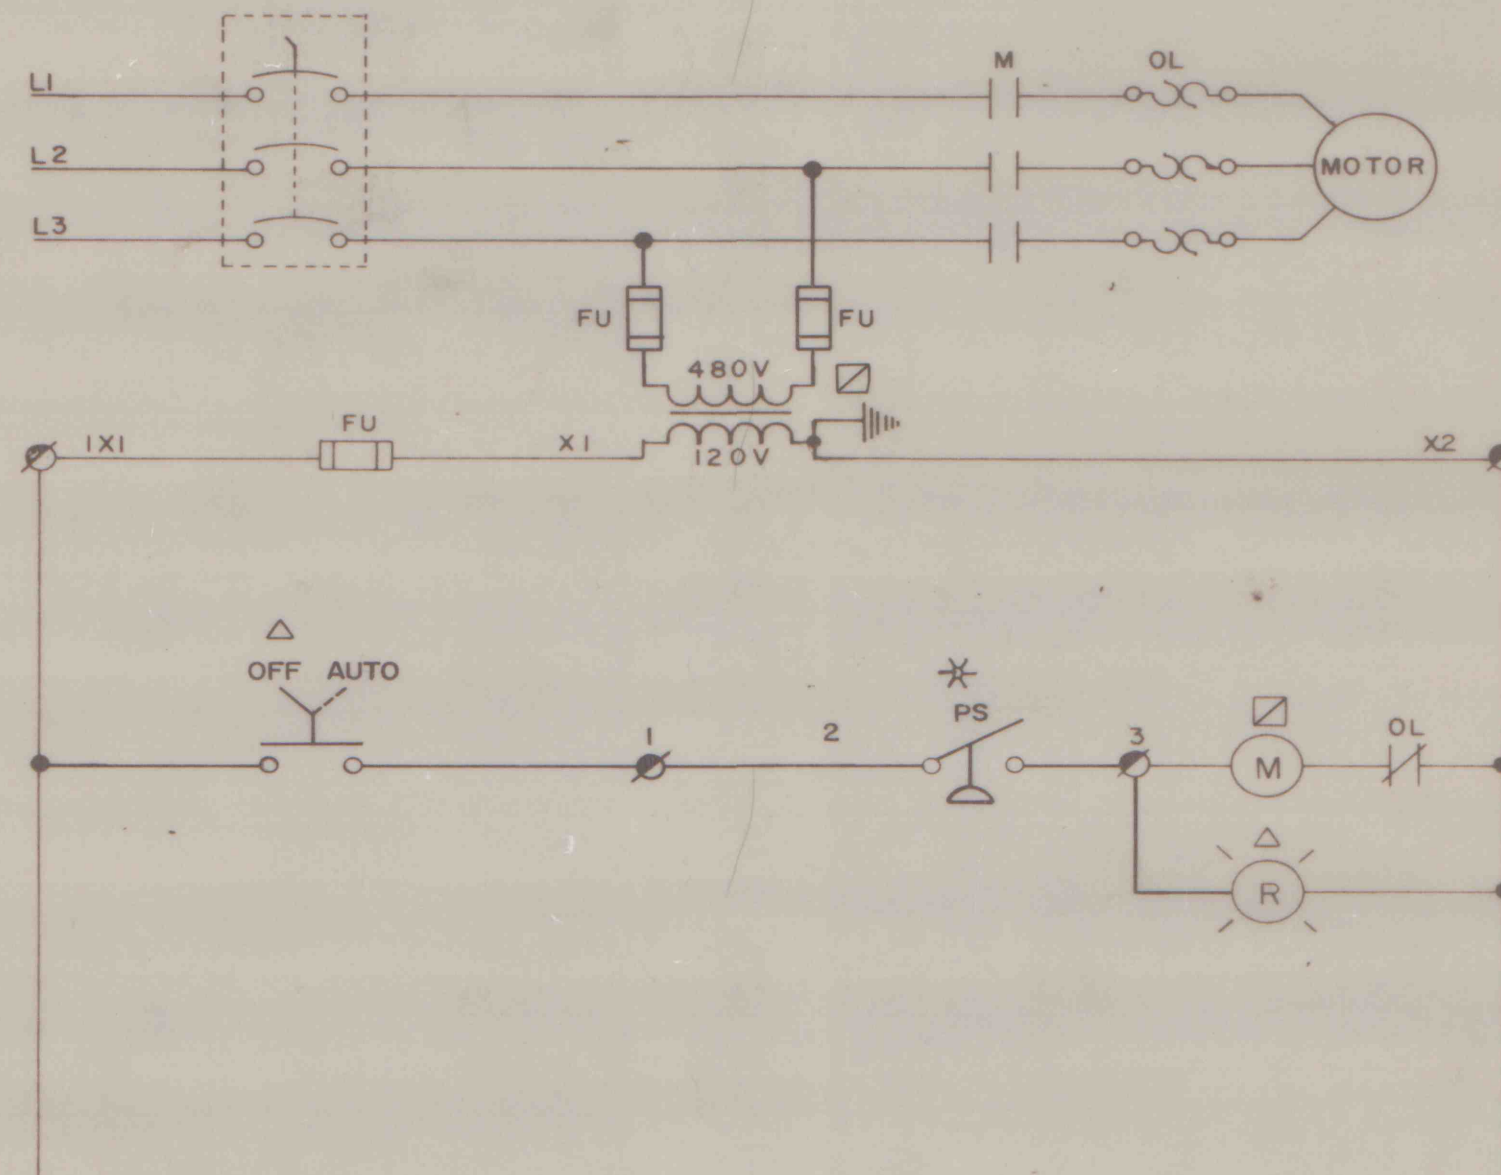

UNIT	DESCRIPTION	HP	MCC
44-A	AIR COMPRESSOR NO. 1	15	SH-1
44-B	AIR COMPRESSOR NO. 2	15	P2

E-33	DELETE INTERLOCK IN DISC. SW.	1	7-15-82	LDM
	REVISION	2	5/17/83	LDM
E-33	FOR APPROVAL	0	5/14/82	LDM
DWG. NO.	REFERENCE	NO.	DATE	BY
				REVISIONS
BLAIR ELECTRIC SERVICE CO.				
BELLWOOD, PENNSYLVANIA				
R & P COAL CO.—KEYSTONE PLANT				
ELECTRICAL SCHEMATICS				
DRAWN JK	DATE 5/14/82	ORDER NO.	W 7478	
CHECKED	DATE	SCALE		
APPROVE:				
DATE	DWG. NO. E-33			