


M-3670974

THIRD ANGLE PROJECTION

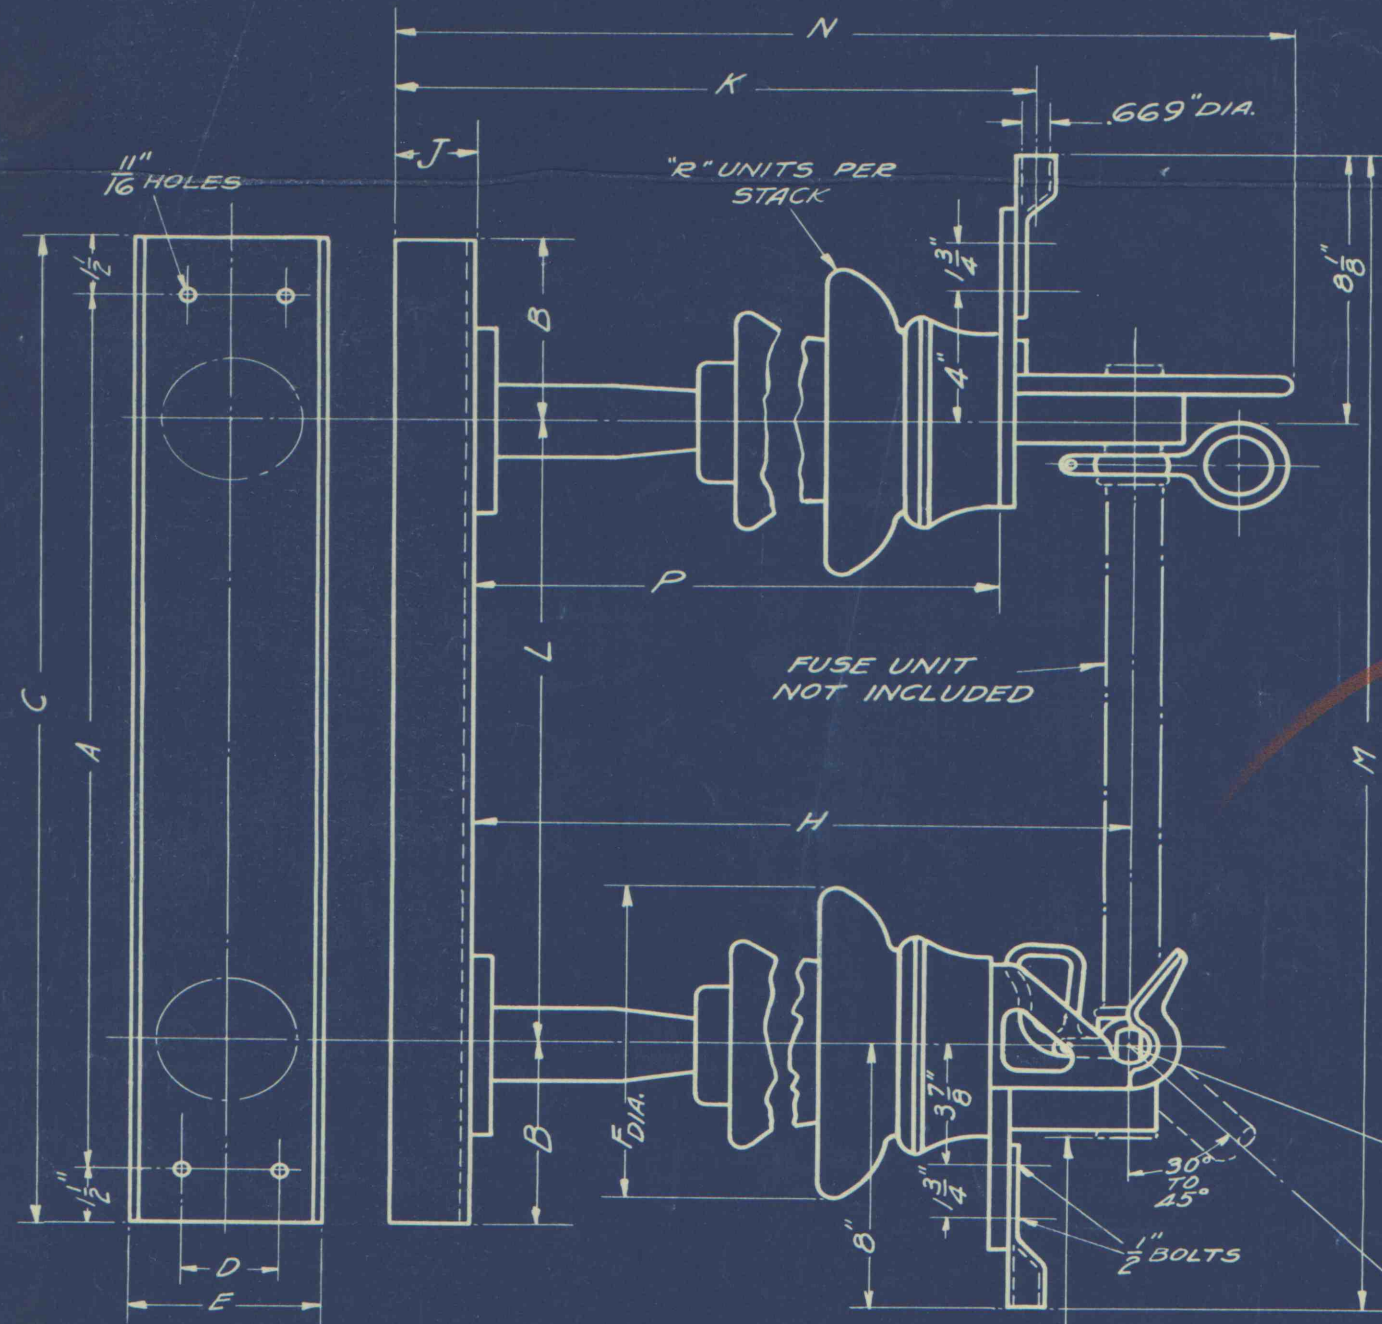

PART NO.	VOLTAGE	A	B	C	D	E	F	G	H	J	K	L	M	N	P	R	NET WGT.
1	7,500	18"	4 1/2"	21"	2"	4"-5.4" PER FT.	6 3/8"	13 1/4"	10 7/16"	1.58"	9 3/4"	12"	2 FT 4 1/8"	15 5/8"	7 1/2"	1	38*
2	15,000	21"	4 1/2"	24"	2"		7 1/2"	16 1/4"	13 15/16"	1.58"	13 1/4"	15"	2 FT 7 1/8"	19 1/8"	11"	1	60*
3	23,000	2 FT 3"	4 1/2"	2 FT 6"	2"		9"	22 1/4"	13 15/16"	1.58"	13 1/4"	21"	3 FT 1 1/8"	19 1/8"	11"	1	68*
4	33,000-S	2 FT 9"	4 1/2"	3 FT 0"	2"		10 1/2"	2 FT 4 1/4"	16 15/16"	1.58"	16 1/4"	2 FT 3"	3 FT 7 1/8"	22 1/8"	14"	1	86*
5	46,000	3 FT 5"	5 1/2"	3 FT 8"	3"	5" 6.7" PER FT.	13"	2 FT 10 1/4"	20 15/16"	1.75"	20 3/8"	2 FT 9"	4 FT 1 1/8"	2 FT 2 1/4"	18"	1	148*
6	66,000-S	4 FT 2"	5 1/2"	4 FT 5"	3"		16"	3 FT 7 1/4"	2 FT 3 15/16"	1.75"	2 FT 3 3/8"	3 FT 6"	4 FT 10 1/8"	2 FT 9 1/4"	2 FT 1"	1	176*
7	34,500	2 FT 9"	4 1/2"	3 FT 0"	2"	4" 5.4" PER FT.	12"	2 FT 4 1/4"	17 15/16"	1.58"	17 1/4"	2 FT 3"	3 FT 7 1/8"	23 1/8"	15"	1	94*
8	69,000	4 FT 2"	5 1/2"	4 FT 5"	3"	5" 6.7" PER FT.	13 1/2"	3 FT 7 1/4"	2 FT 3 15/16"	1.75"	2 FT 3 3/8"	3 FT 6"	4 FT 10 1/8"	2 FT 9 1/4"	2 FT 1"	2	220*

6" TO RECOMMENDED CLEARANCE TO GROUND OR CONDUCTOR OF OPPOSITE POLARITY. FUSE SHOULD NOT BE MOUNTED DIRECTLY OVER OTHER APPARATUS

NOTICE TO PURCHASER

REFER TO CONTRACT FOR MATERIAL TO BE SUPPLIED BY THE GENERAL ELECTRIC COMPANY. THE AMOUNT OF SUCH MATERIAL IS NOT INCREASED BY ANYTHING SHOWN UPON THIS DRAWING.

POSITION FOR REMOVING FUSE

621.317.3-2103-96

OUTLINE OF FUSE DISCONNECTING SWITCH TYPE EF-1

FIRST MADE FOR OUTDOOR SWITCHING EQUIPMENT

BEGUN BY R. BRECKENRIDGE MAY 9-1921

FINISHED BY R. BRECKENRIDGE MAY 9-1921

INSPECTED MAY 15-1931

GENERAL ELECTRIC CO. PHILADELPHIA WORKS

M-3670974