


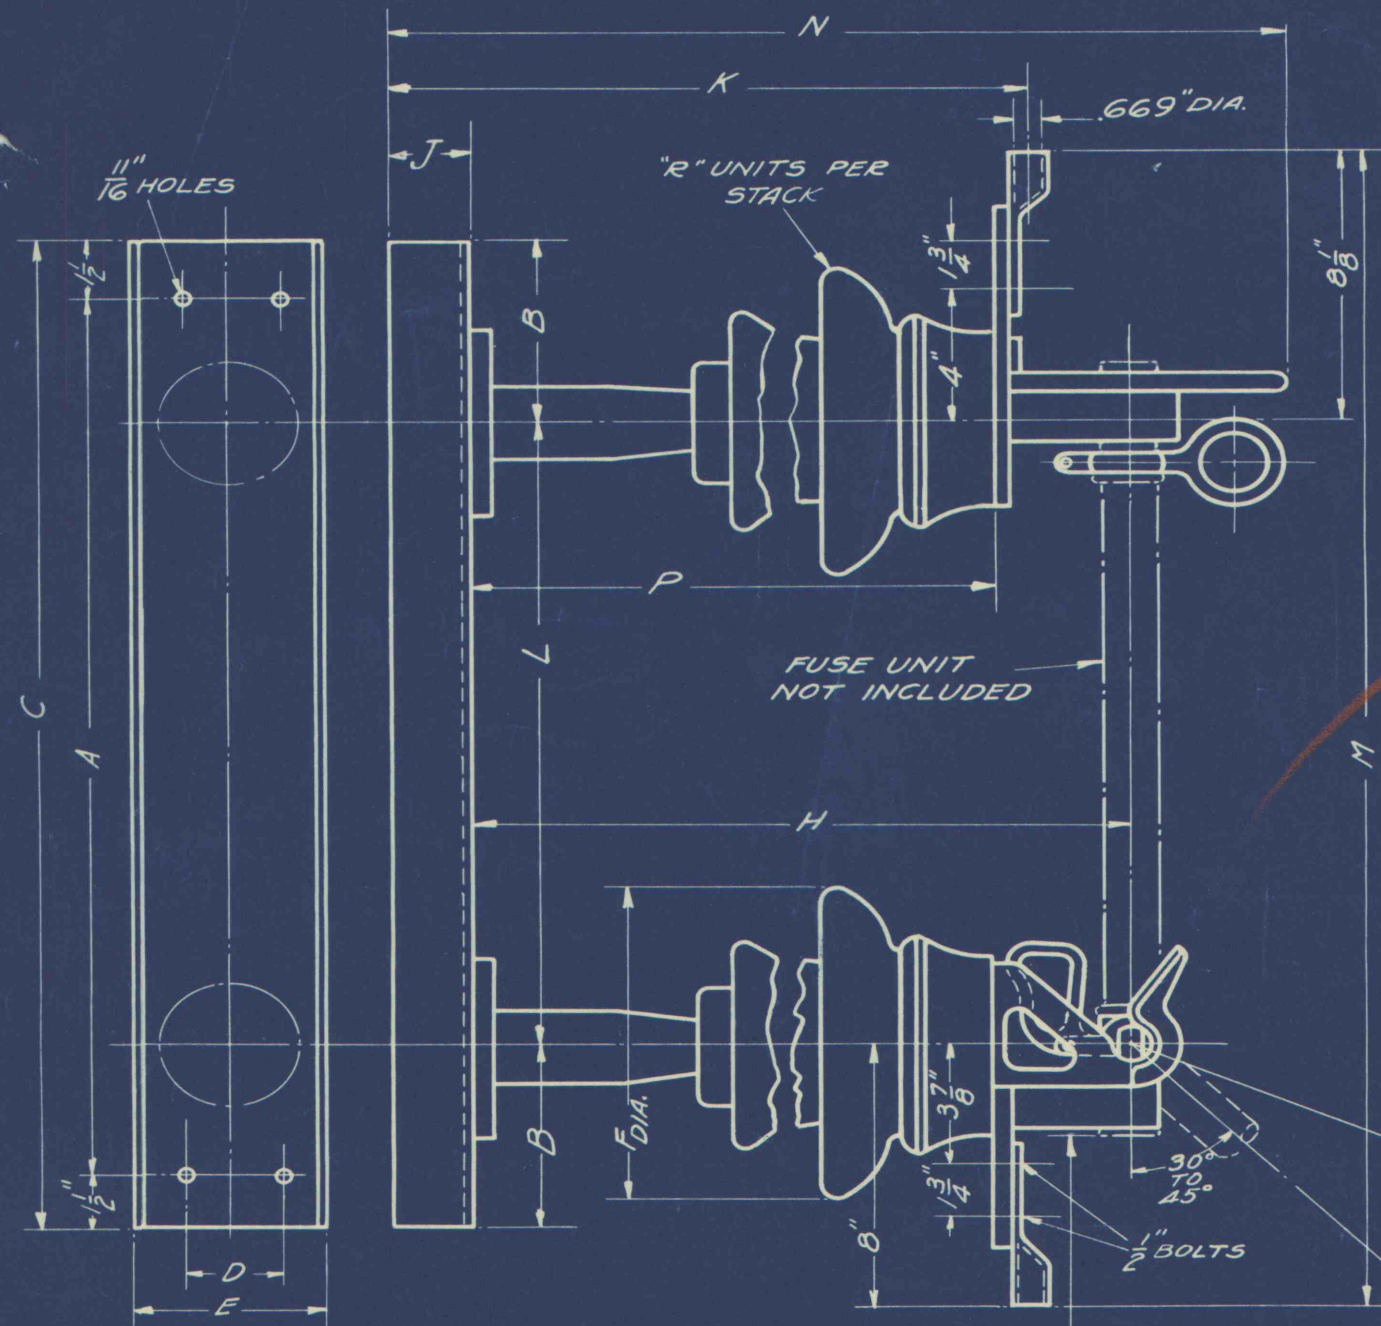

PART NO.	VOLTAGE	A	B	C	D	E	F	G	H	J	K	L	M	N	P	R	NET WGT.
1	7,500	18"	4 1/2"	21"	2"	4"-5.4" PER FT.	6 3/8"	13 1/4"	10 7/16"	1.58"	9 3/4"	12"	2 FT 4 1/8"	15 5/8"	7 1/2"	1	38*
2	15,000	21"	4 1/2"	24"	2"		7 1/2"	16 1/4"	13 15/16"	1.58"	13 1/4"	15"	2 FT 7 7/8"	19 1/8"	11"	1	60*
3	23,000	2 FT 3"	4 1/2"	2 FT 6"	2"		9"	22 1/4"	13 15/16"	1.58"	13 1/4"	21"	3 FT 1 7/8"	19 1/8"	11"	1	68*
4	33,000-S	2 FT 9"	4 1/2"	3 FT 0"	2"		10 1/2"	2 FT 4 1/4"	16 15/16"	1.58"	16 1/4"	2 FT 3"	3 FT 7 7/8"	22 1/8"	14"	1	86*
5	46,000	3 FT 5"	5 1/2"	3 FT 8"	3"	5" 6.7" / FT.	13"	2 FT 10 1/4"	20 15/16"	1.75"	20 3/8"	2 FT 9"	4 FT 1 7/8"	2 FT 2 1/4"	18"	1	148*
6	66,000-S	4 FT 2"	5 1/2"	4 FT 5"	3"		16"	3 FT 7 1/4"	2 FT 3 15/16"	1.75"	2 FT 3 3/8"	3 FT 6"	4 FT 10 1/8"	2 FT 9 1/4"	2 FT 1"	1	176*
7	34,500	2 FT 9"	4 1/2"	3 FT 0"	2"	4" 5.4" / FT.	12"	2 FT 4 1/4"	17 15/16"	1.58"	17 1/4"	2 FT 3"	3 FT 7 7/8"	23 1/8"	15"	1	94*
8	69,000	4 FT 2"	5 1/2"	4 FT 5"	3"	5" 6.7" / FT.	13 1/2"	3 FT 7 1/4"	2 FT 3 15/16"	1.75"	2 FT 3 3/8"	3 FT 6"	4 FT 10 1/8"	2 FT 9 1/4"	2 FT 1"	2	220*

6" TO RECOMMENDED CLEARANCE TO GROUND OR CONDUCTOR OF OPPOSITE POLARITY. FUSE SHOULD NOT BE MOUNTED DIRECTLY OVER OTHER APPARATUS

NOTICE TO PURCHASER
REFER TO CONTRACT FOR MATERIAL TO BE SUPPLIED BY THE GENERAL ELECTRIC COMPANY. THE AMOUNT OF SUCH MATERIAL IS NOT INCREASED BY ANYTHING SHOWN UPON THIS DRAWING.

POSITION FOR REMOVING FUSE

NO.	DATE	REVISION
11	JULY 23 '31	CHANGED PART-8.
10	JUNE 1 '31	CHANGED PART-8
9	MAY 15 '31	RETRACED
8	SEPT. 2-1930	ADDED REVISION NOTE FOR CHANGE NO. 1

DR 96

OUTLINE
OF FUSE DISCONNECTING SWITCH
TYPE EF-1

FIRST MADE FOR OUTDOOR SWITCHING EQUIPMENT

BEGUN BY ROSEBACK MAY 9-1921
FINISHED BY ROSEBACK MAY 9-1921

TRACED BY W. H. MARR May 14-1931
INSPECTED MAY 15-1931

GENERAL ELECTRIC CO.
PHILADELPHIA WORKS

M-3670974

IMAPS 09246