
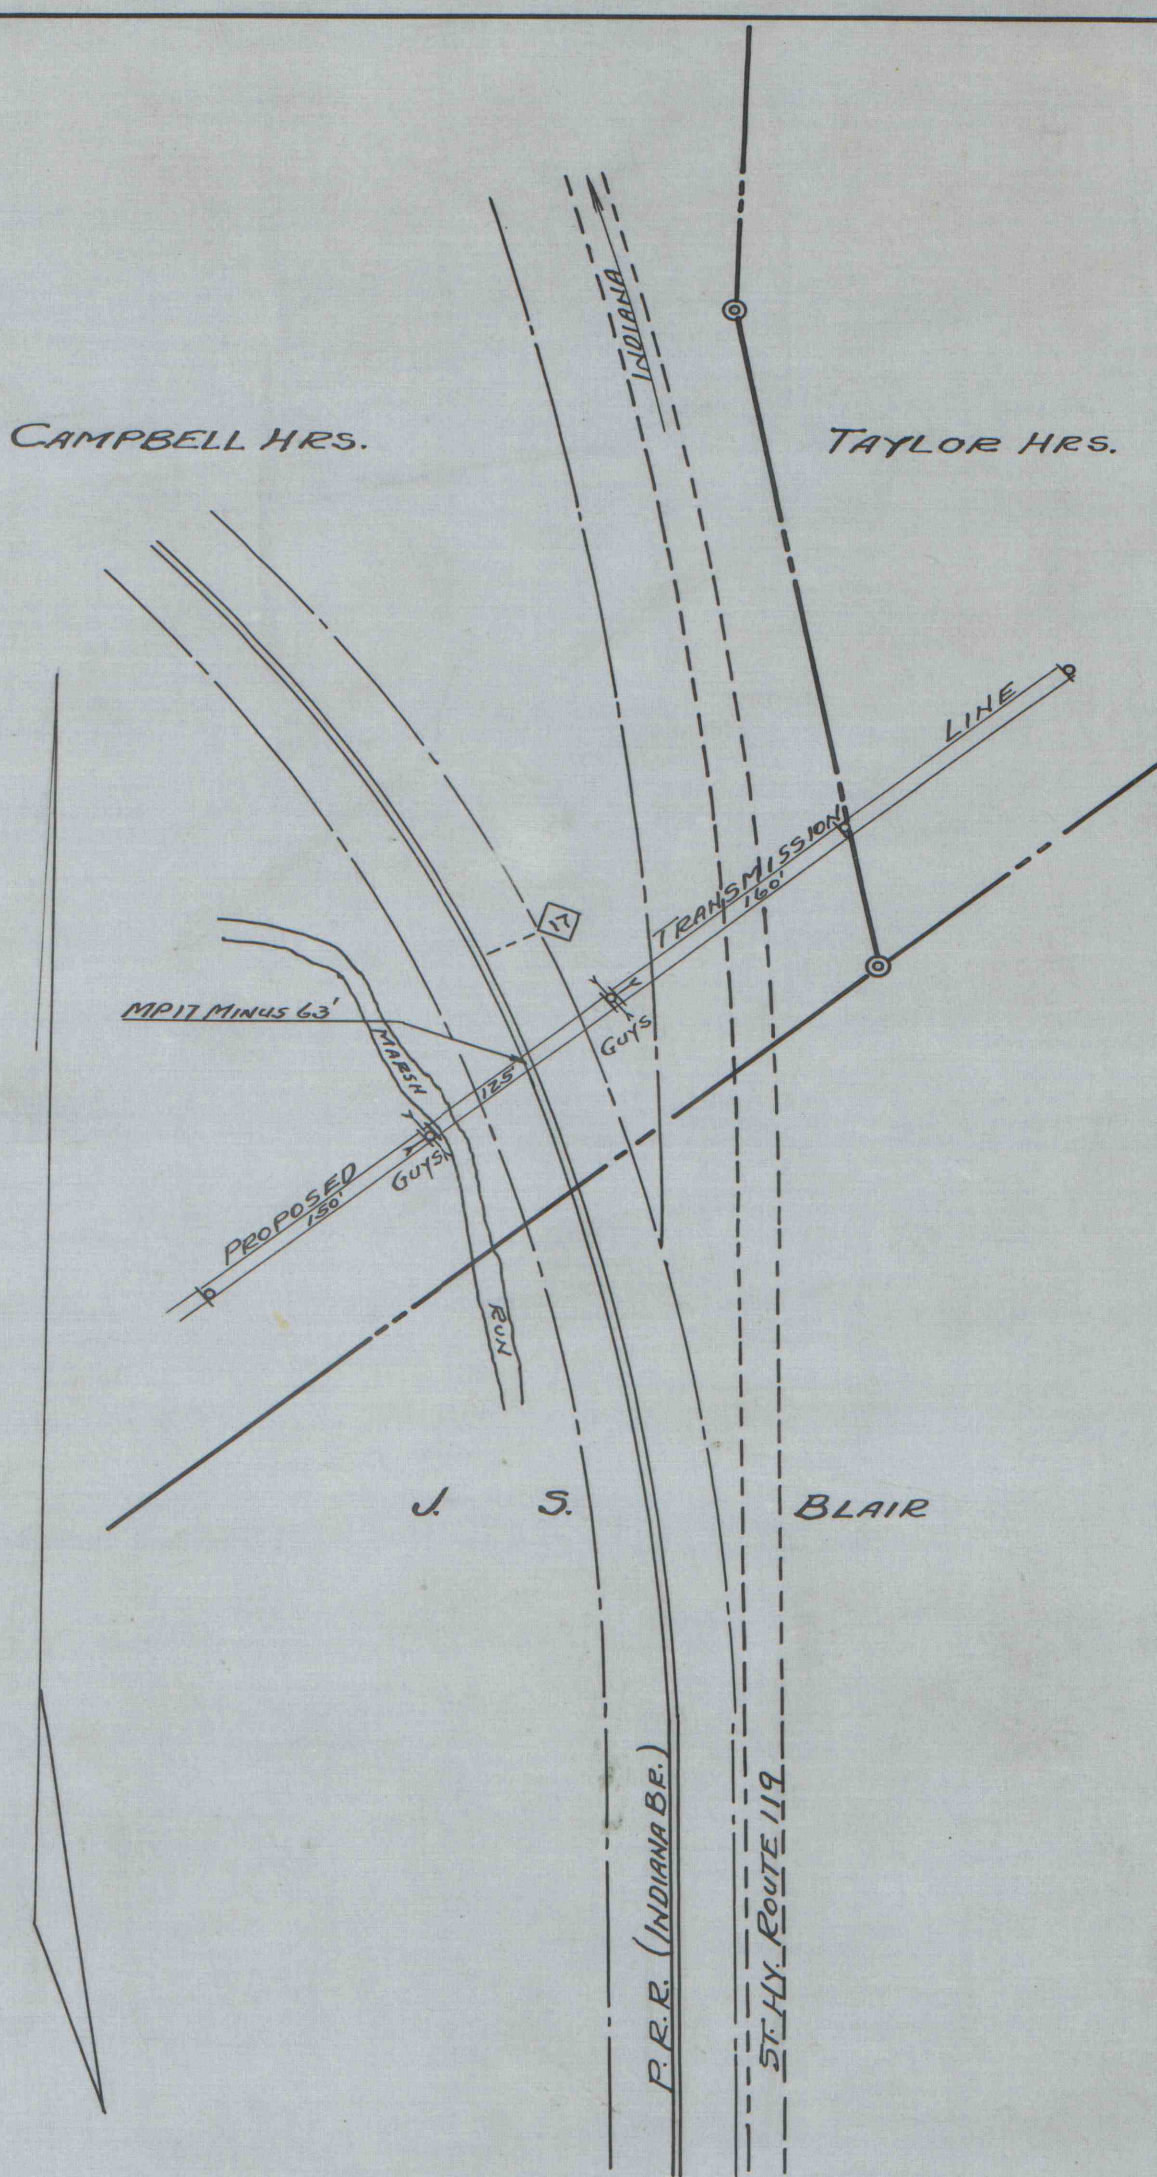
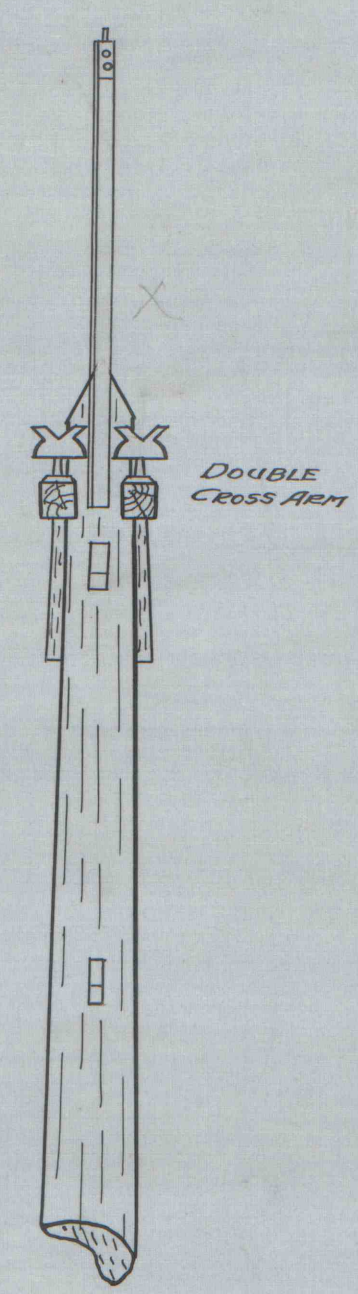
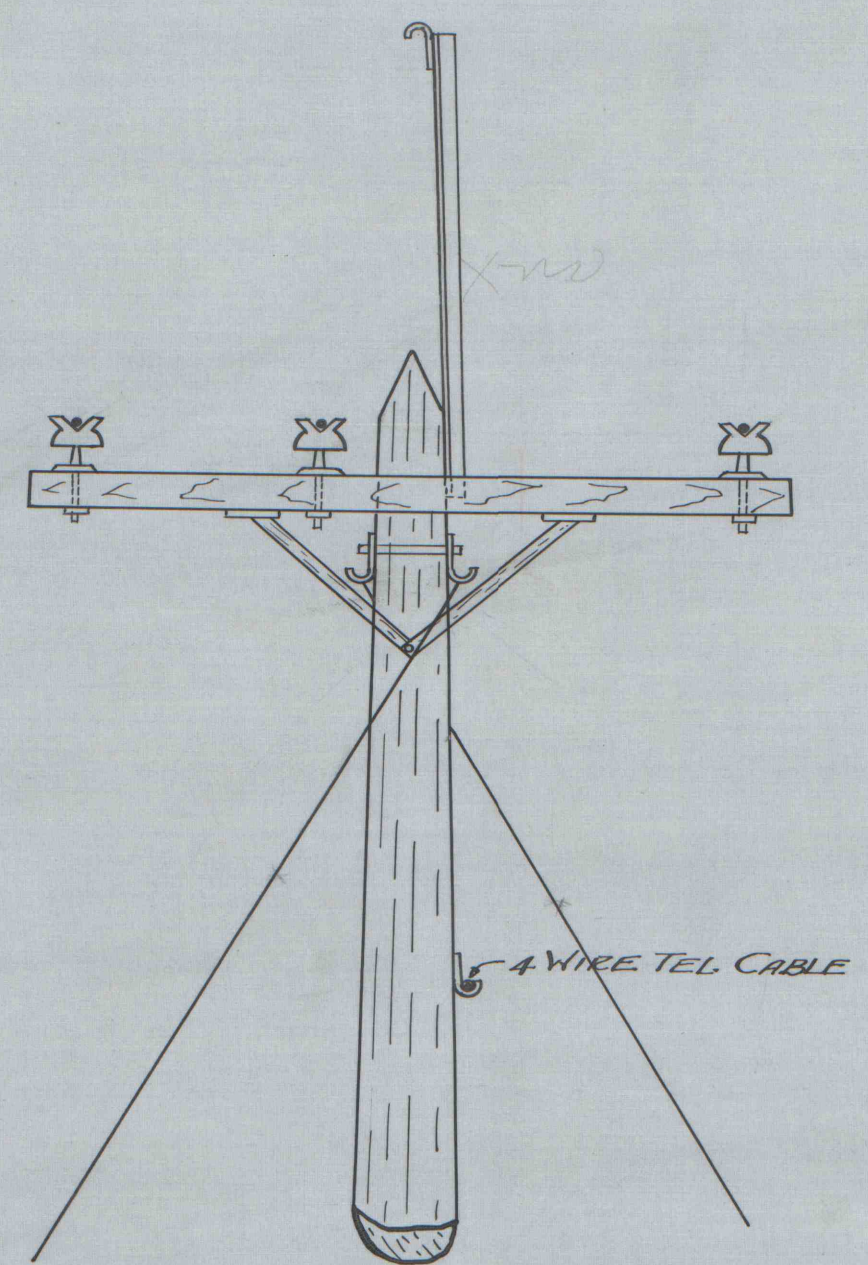


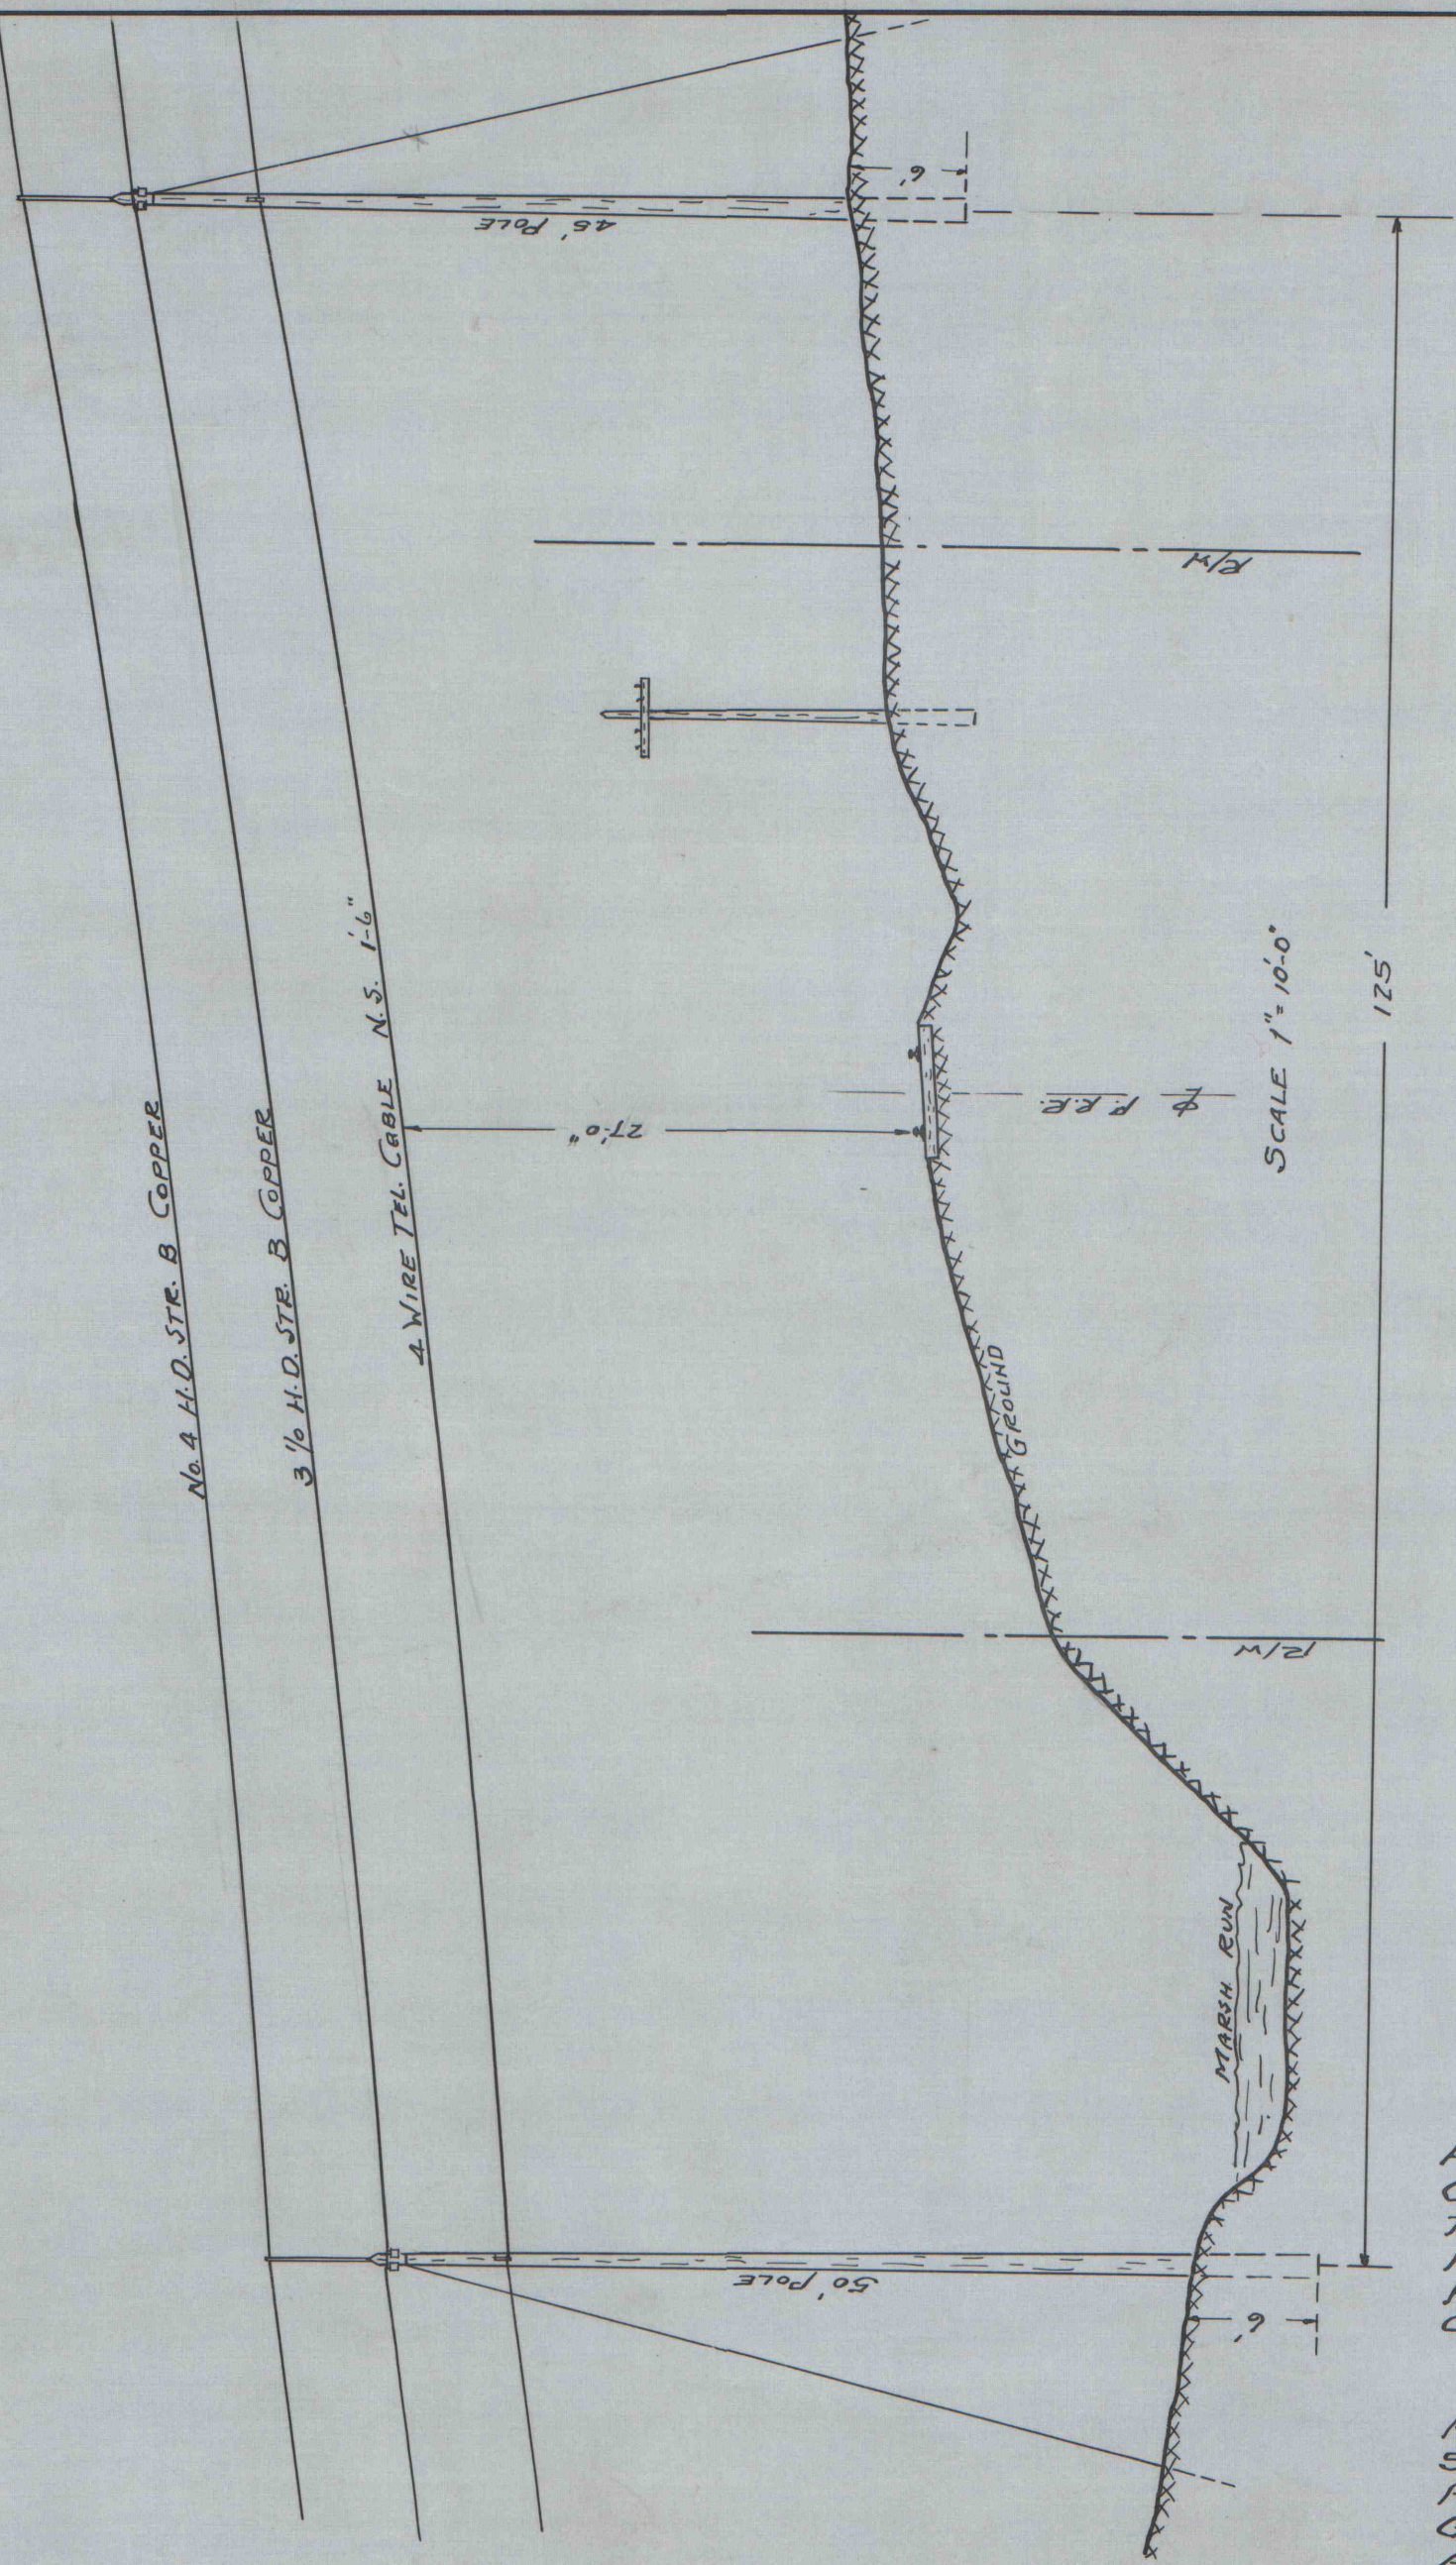

- POTENTIAL
CONDUCTORS
TIES - TYPE
INSULATORS
PINS
CROSS ARMS
" " BOLTS
" " BRACES
POLE BRACE BOLTS
SPACERS
POLE
GUYS
ANCHOR RODS
ANCHORS
BAYONETS
GROUND
CLAMPS
- SPECIFICATIONS
- 6600 VOLTS
 - 3/4 H.D. STR. B. COPPER
 - No. 4 COPPER
 - STRAIGHT LINE OB 34422
 - 3/4" GALV. STEEL LEAD DIP OB 71410
 - 4" x 5" x 3'-0"
 - 3/8" x 18" GALV.
 - JOIST WOOD 2" x 2" x 3'-0" CREOSOTE
 - 1/2" x 3 1/2" LAG SCREWS
 - 3/8" x 18" LONG WITH 4 NUTS & 4 WASHERS
 - RED WOOD CEDAR CLASS 4
 - 3/8" GALV. STEEL
 - 3/4" x 6" ST 1226
 - OLD MINE CAR WHEELS
 - 3" x 3" x 1/4" x 6' LONG GALV. J 1135
 - No. 4 H.D. STR. B. COPPER
 - JOIST W.

ROCHESTER & PITTSBURGH COAL CO.
PLAN AND PROFILE
OF
PROPOSED TRANSMISSION LINE CROSSING.
P.R.R. - INDIANA BR.
WHITETWP. - AT MP17 MINUS 63' - INDIANA CO.
SCALE: AS SHOWN
MAY 1949.