


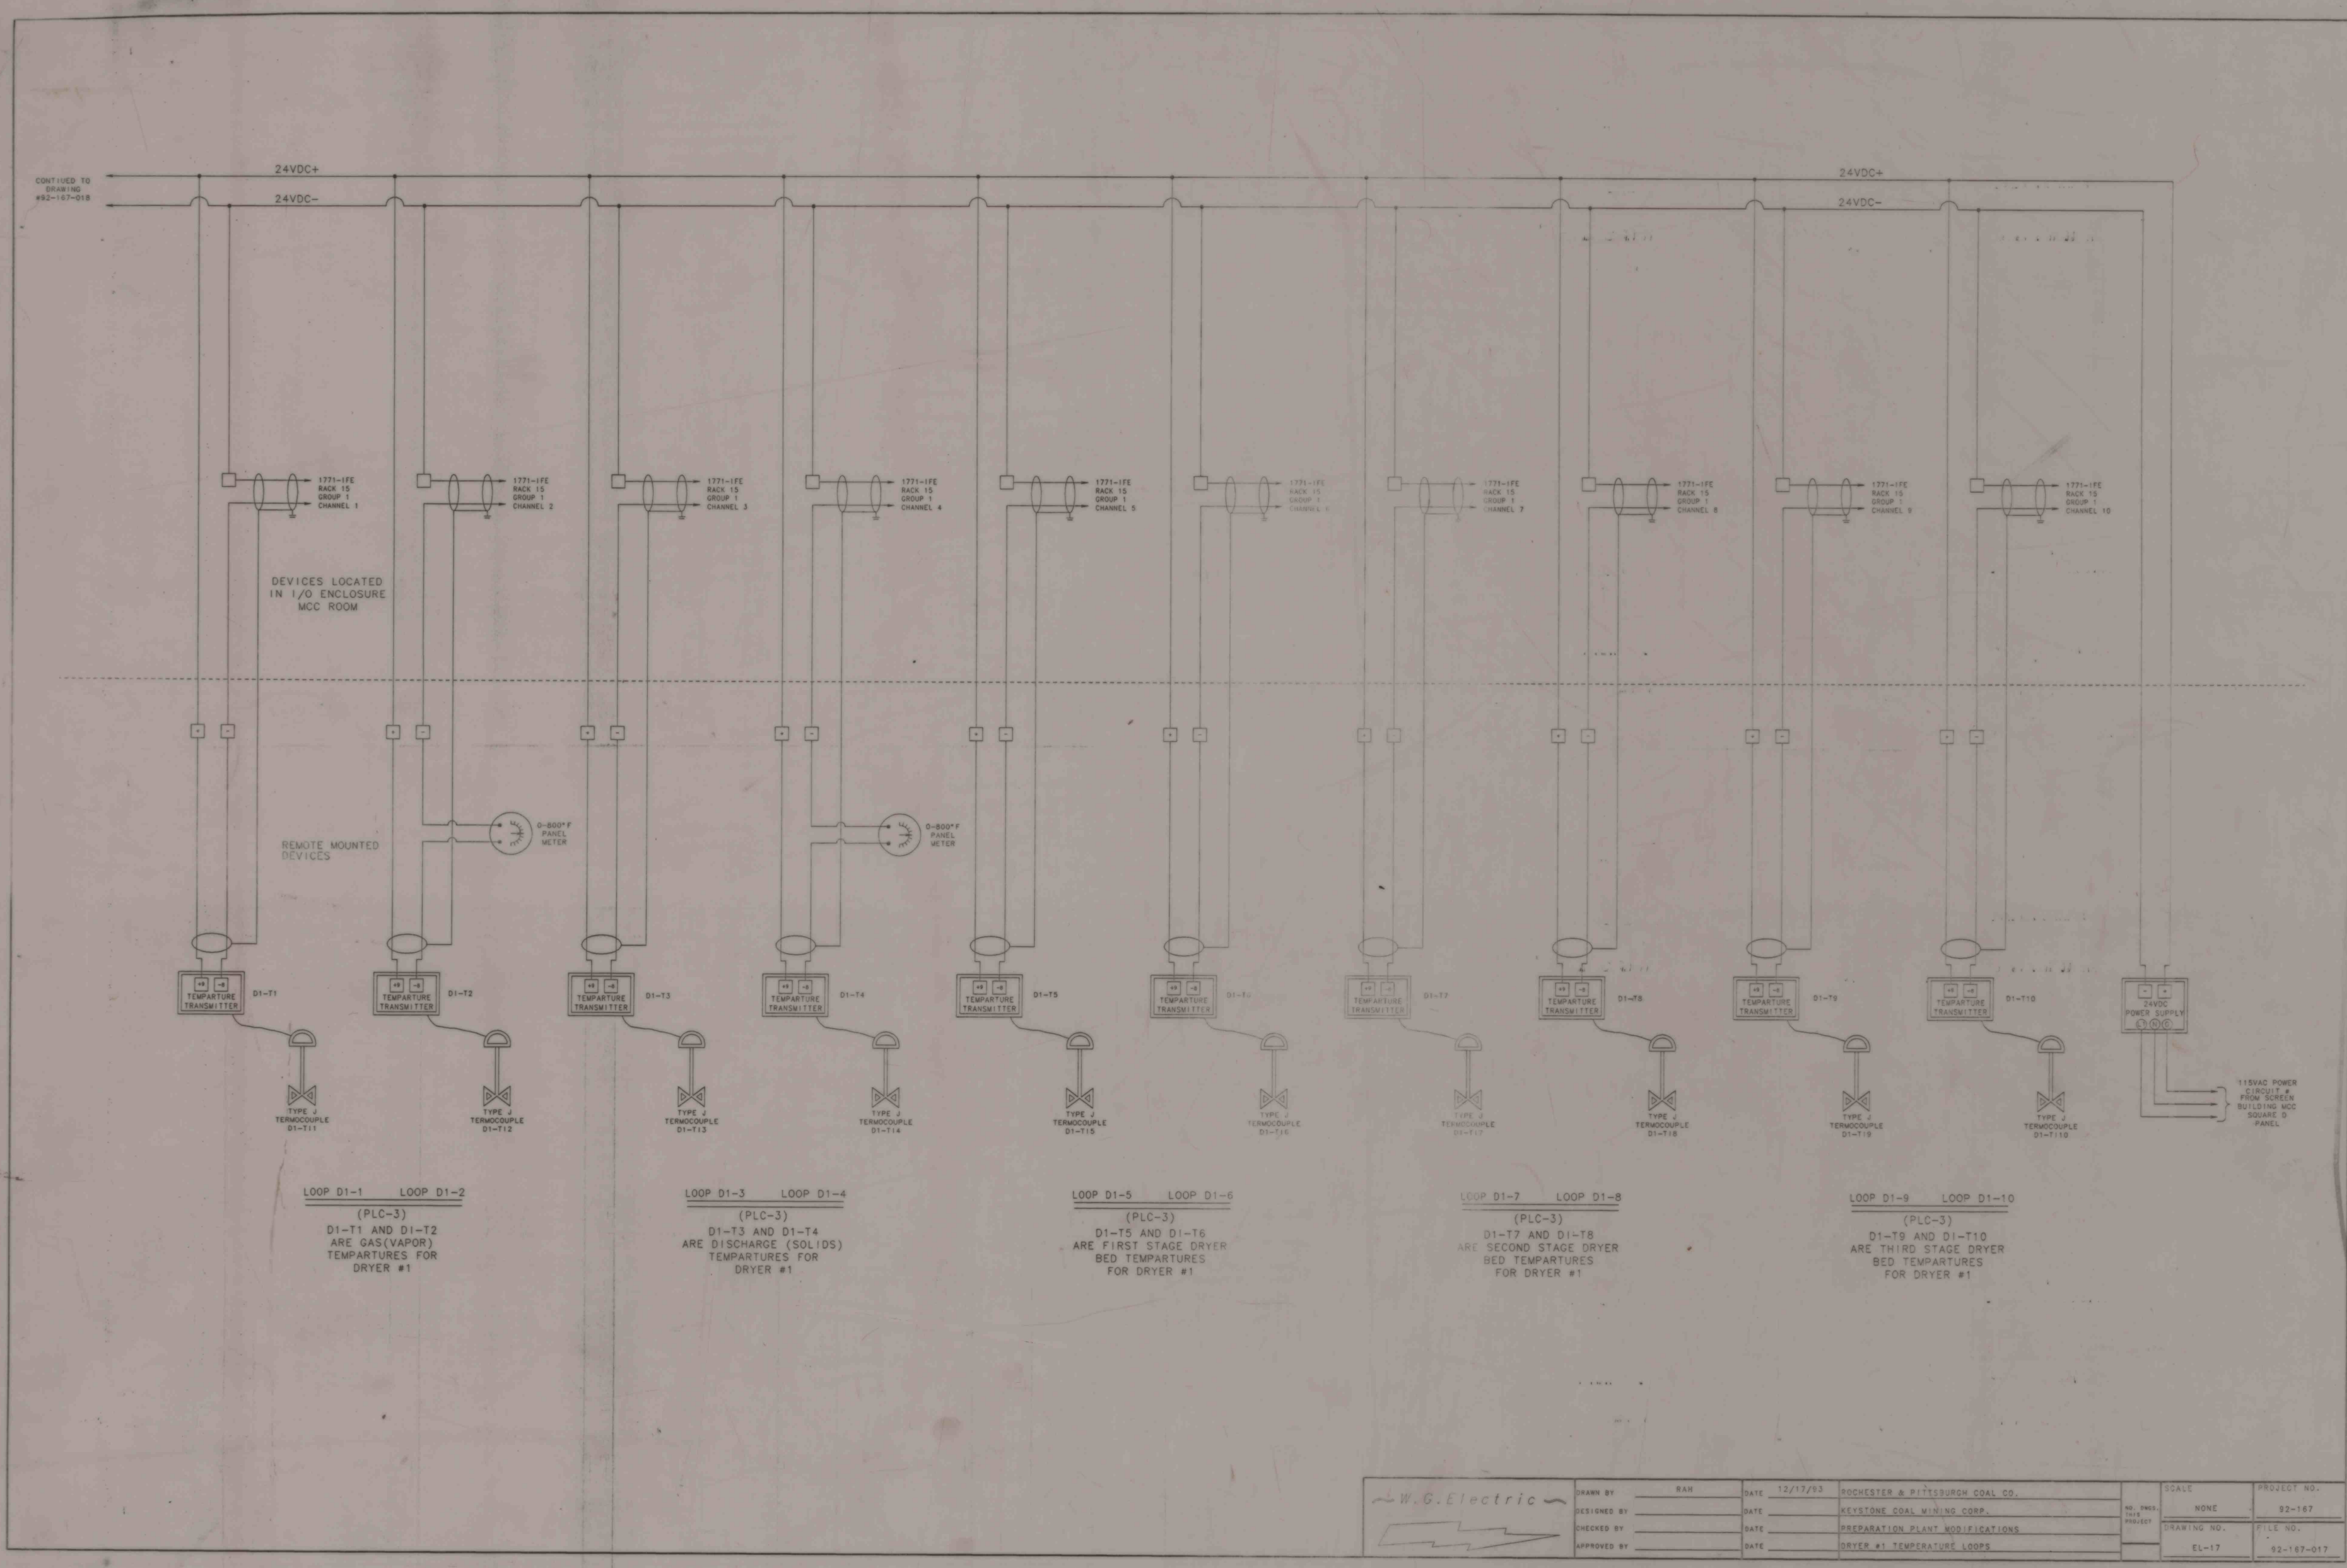

DEVICES LOCATED
IN I/O ENCLOSURE
MCC ROOM

REMOTE MOUNTED
DEVICES

LOOP D1-1 LOOP D1-2
(PLC-3)
D1-T1 AND D1-T2
ARE GAS(VAPOR)
TEMPARTURES FOR
DRYER #1

LOOP D1-3 LOOP D1-4
(PLC-3)
D1-T3 AND D1-T4
ARE DISCHARGE (SOLIDS)
TEMPARTURES FOR
DRYER #1

LOOP D1-5 LOOP D1-6
(PLC-3)
D1-T5 AND D1-T6
ARE FIRST STAGE DRYER
BED TEMPARTURES
FOR DRYER #1

LOOP D1-7 LOOP D1-8
(PLC-3)
D1-T7 AND D1-T8
ARE SECOND STAGE DRYER
BED TEMPARTURES
FOR DRYER #1

LOOP D1-9 LOOP D1-10
(PLC-3)
D1-T9 AND D1-T10
ARE THIRD STAGE DRYER
BED TEMPARTURES
FOR DRYER #1

	DRAWN BY	RAH	DATE	12/17/93	ROCHESTER & PITTSBURGH COAL CO.	NO. DWGS.	SCALE	PROJECT NO.
	DESIGNED BY		DATE		KEYSTONE COAL MINING CORP.	THIS	NONE	92-167
	CHECKED BY		DATE		PREPARATION PLANT MODIFICATIONS	PROJECT	DRAWING NO.	FILE NO.
	APPROVED BY		DATE		DRYER #1 TEMPERATURE LOOPS		EL-17	92-167-017

IMAPS # 14/69