

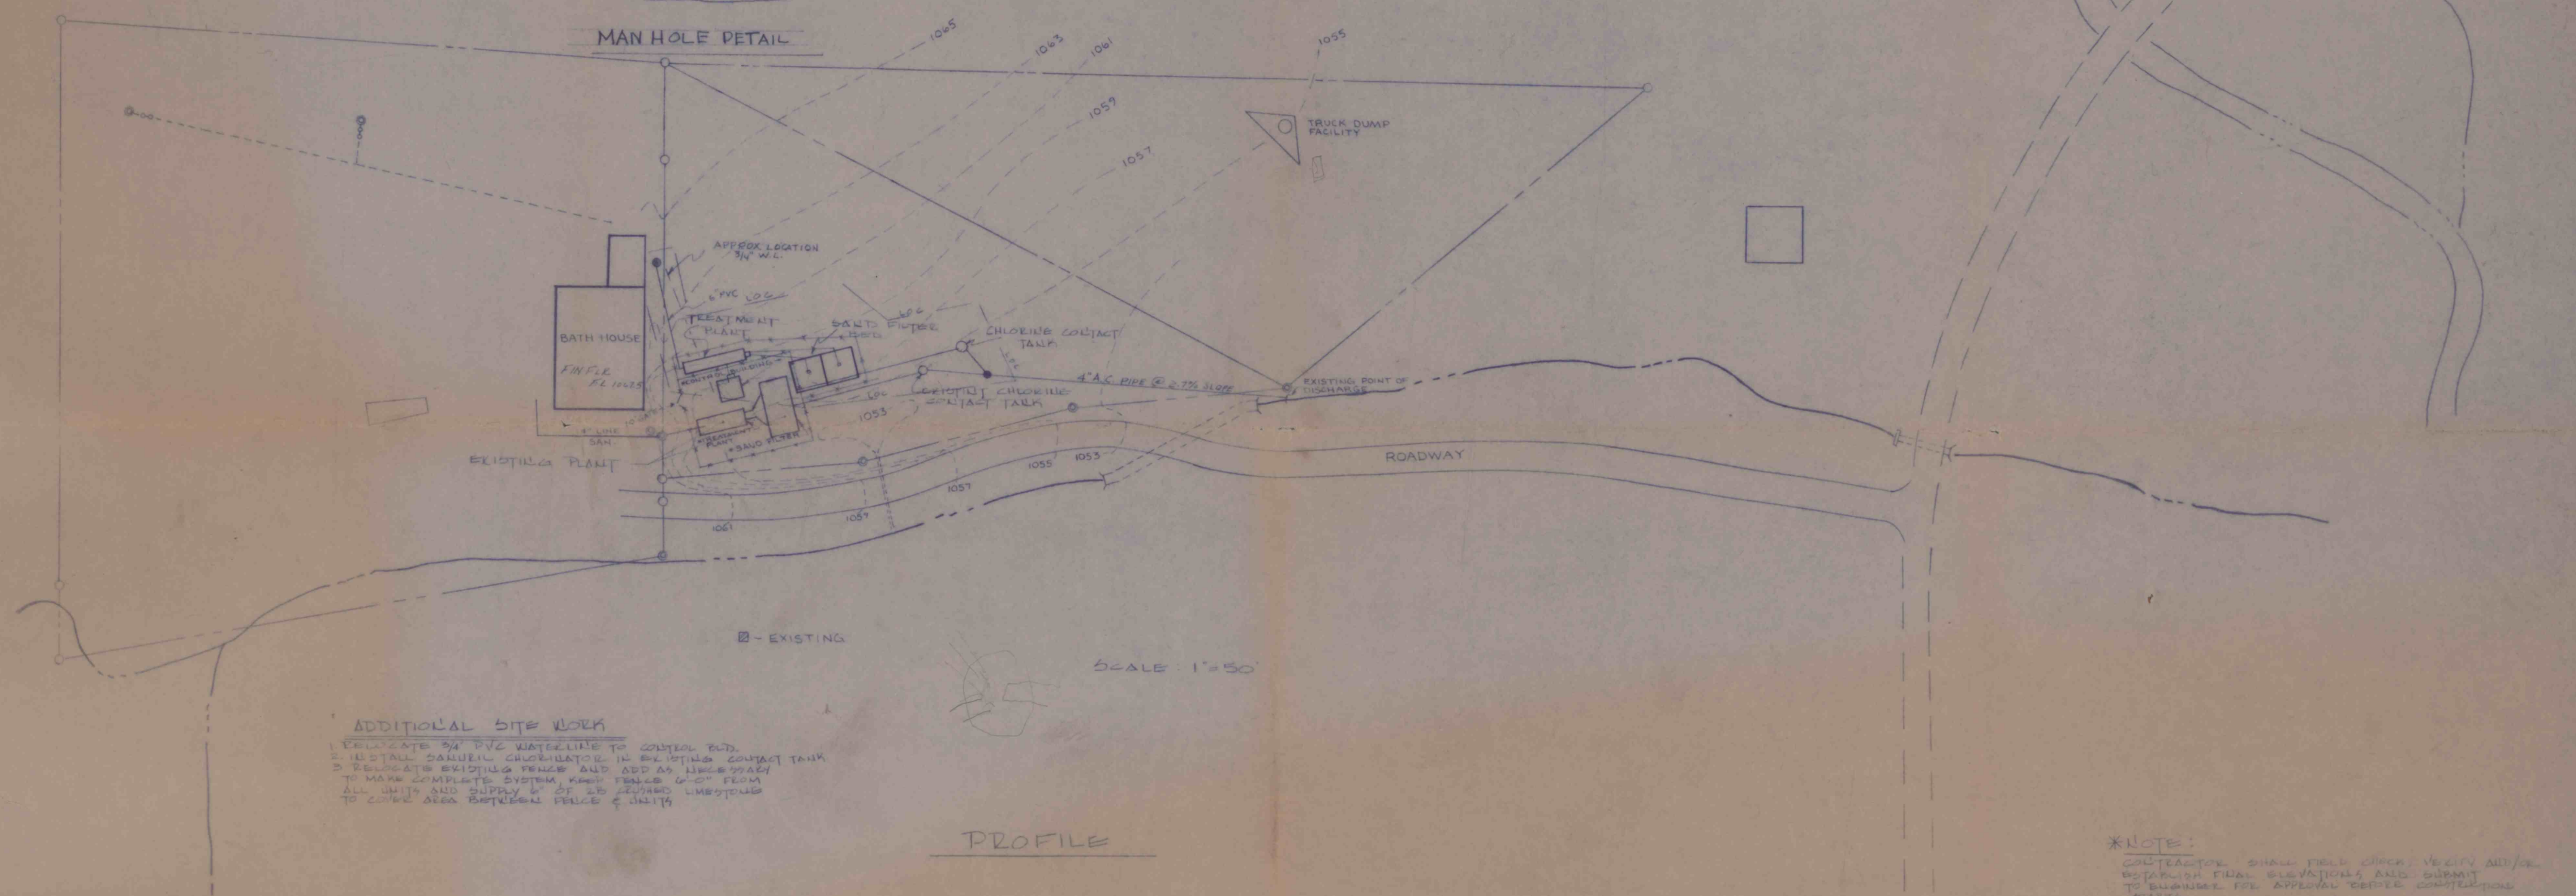


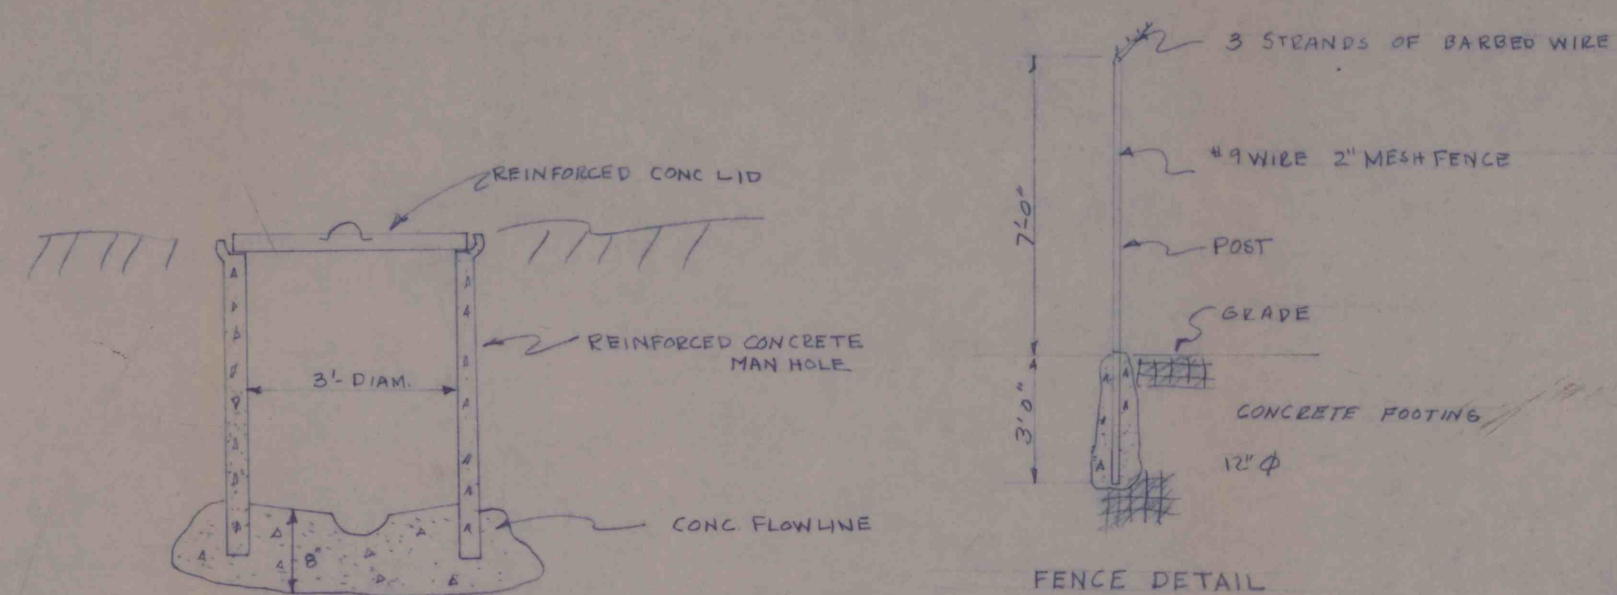

- ADDITIONAL SITE WORK**
1. EXCAVATE 3/4" PVC WATERLINE TO CONTROL BUD.
 2. INSTALL SANITARY CHLORINATOR IN EXISTING CONTACT TANK.
 3. RELOCATE EXISTING FENCE AND ADD AS NECESSARY TO MAKE COMPLETE SYSTEM. KEEP FENCE 6'-0" FROM ALL UNITS AND SUPPLY 6" OF 25' COVERED LIMESTONES TO COVER AREA BETWEEN FENCE & UNITS.

PROFILE

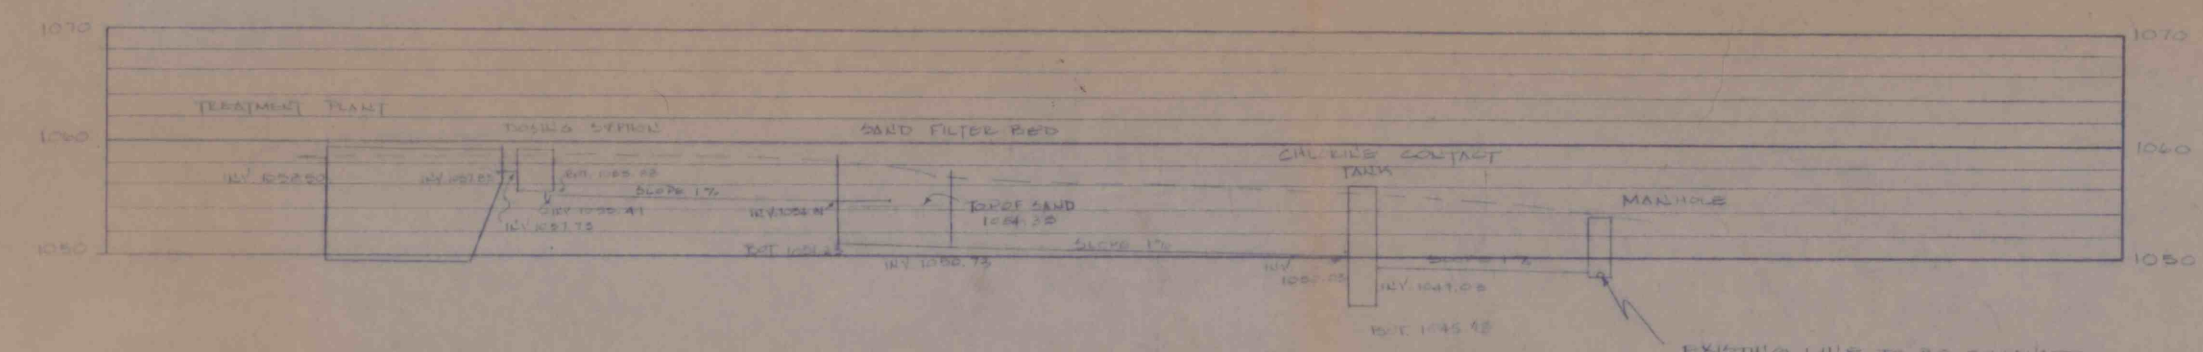

SCALE
 VERT. 1" = 10'
 HORIZ. 1" = 20'

EXISTING LINE TO BE EXCAVATED AND FIELD CHECKED BY CONTRACTOR. ALL ELEV. WILL BE REGULATED FROM EXISTING EFFLUENT LINE.

***NOTE:**
 CONTRACTOR SHALL FIELD CHECK VERTICAL AND/OR HORIZONTAL FINAL ELEVATIONS AND SUBMIT TO BUREAU FOR APPROVAL BEFORE CONSTRUCTION BEGINS.

IMAPS # 15906



LEONARD J. FACCIANI & ASSOCIATES			
Professional Environmental Engineering			
SCALE	APPROVED BY		DRAWN BY
DATE		REVISED	
SEWAGE PLANT EXPANSION LOCATED ON 6 MINE HELVETIA COAL CO.			
SITE PLAN			DRAWING NUMBER 1