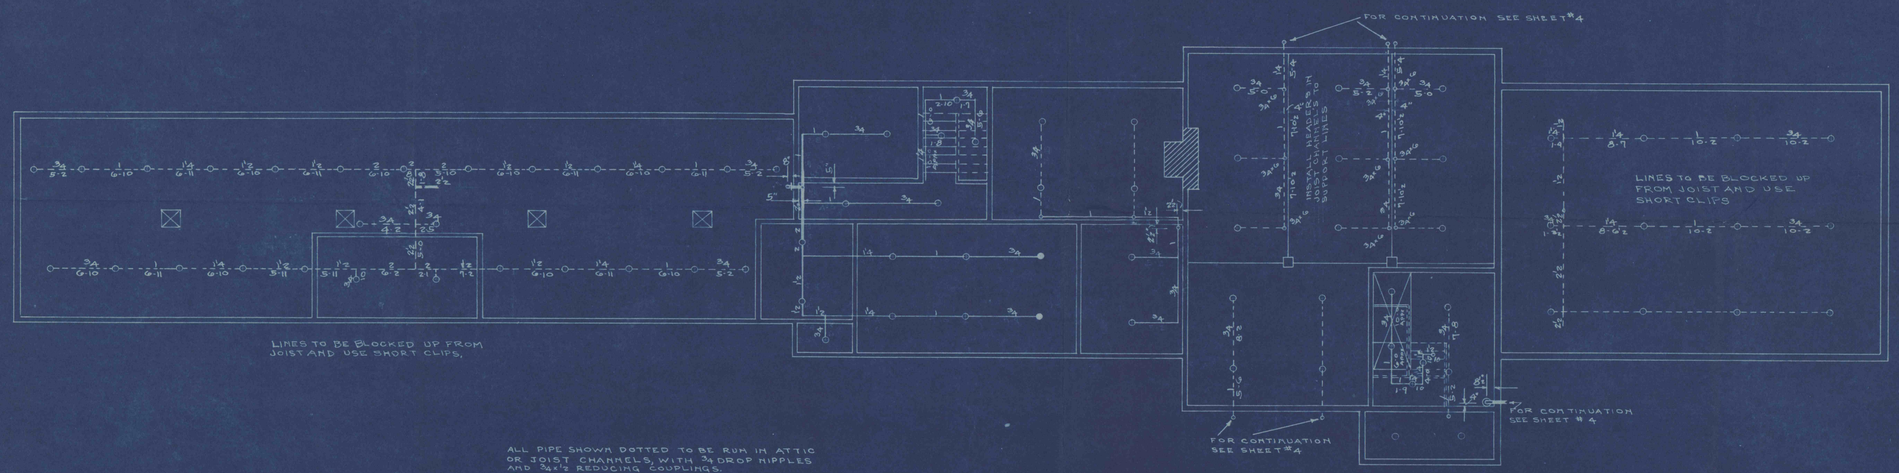

ALL PIPE SHOWN DOTTED TO BE RUN IN ATTIC OR JOIST CHANNELS, WITH 3/4 DROP NIPPLES AND 3/4"x1 REDUCING COUPLINGS.
PIPE SHOWN SOLID TO BE HELD TIGHT TO CEILING, HEADS TO BE IN PENDANT POSITION

LINE NUMBER	NUMBER OF LINES	TOTAL LINES	MAIN LETTER	NUMBER OF PIECES

SPRINKLERS

185°	135°	212°	175°	286°		360°	TOTAL
	80		2				82

MARK PIPING FOR THIS STORY

NOTE: - ALL PIPE MEASUREMENTS SHOWN ARE CUTTING DIMENSIONS. ADD 1-2 INCHES TO MEASUREMENTS SHOWN TO OBTAIN THE DISTANCE BETWEEN SPRINKLERS ON LINES.

SCHUYLKILL COUNTRY CLUB
ORWIGSBURG, PA

BLDG.
CLUB HOUSE

SECTION | STORY

SCALE	CONT. NO.	DRAWING NO	TUBE
1/8" = 1'-0"	8FP 111	2919-2	
ENGINEER	DRAWN BY	DATE	CHECKED BY
JHL	JHL	7-28-31	
	REVISED BY		

GRINNELL COMPANY
INC.
INSTALLATION DIVISION
PHILADELPHIA, PA.

Map No. 2017 B

PRINTED IN U. S. A.