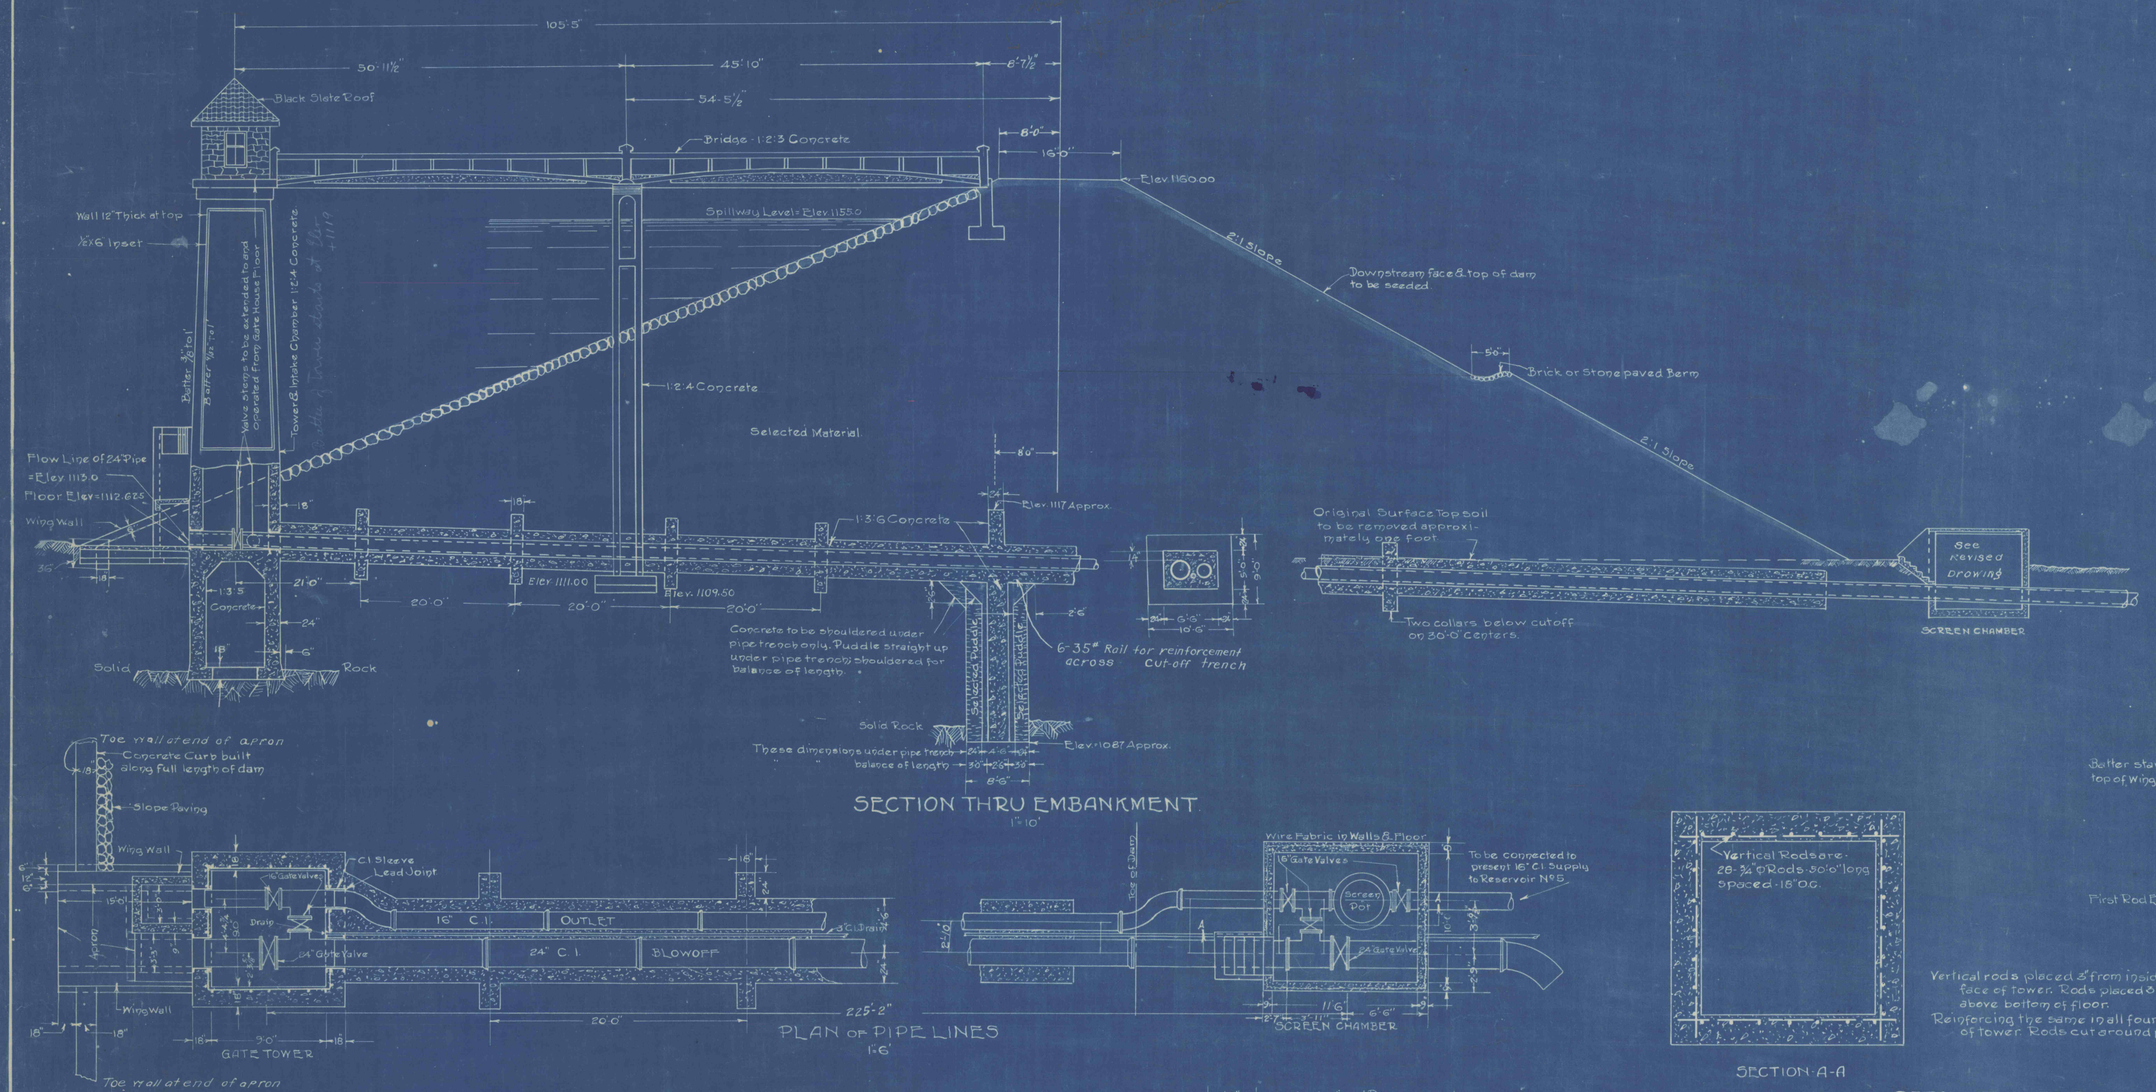

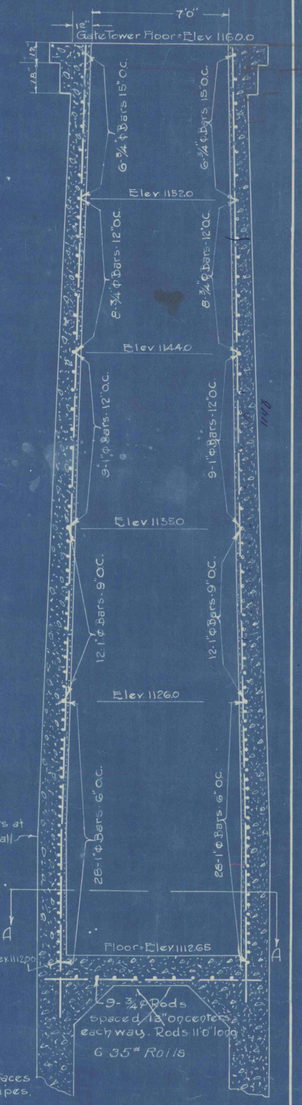

Vertical rods placed 3" from inside face of tower. Rods placed 8" above bottom of floor. Reinforcing the same in all four faces of tower. Rods cut around pipes.

DETAIL OF TOWER REINFORCING
1/4"=1'

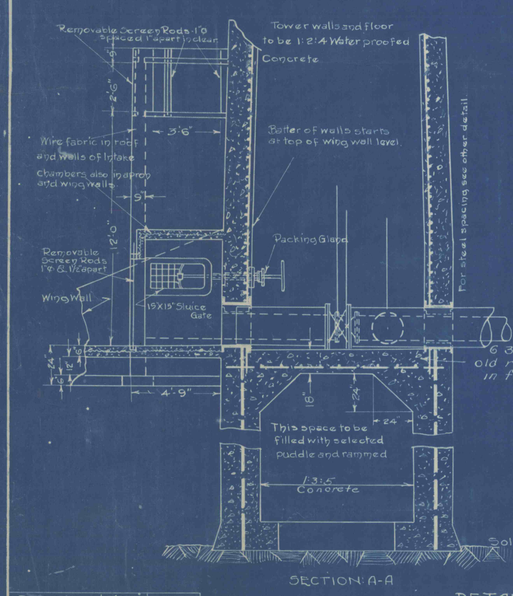

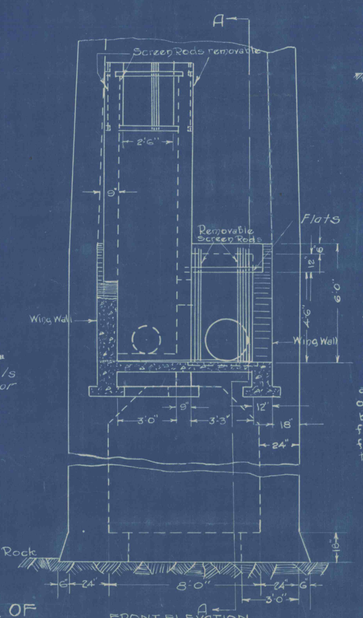

DETAIL OF INTAKE TOWER & SCREEN
1/4"=1'



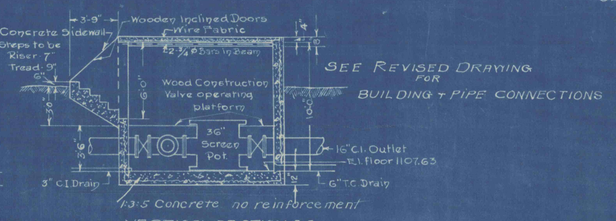

SEE REVISED DRAWING FOR BUILDING + PIPE CONNECTIONS

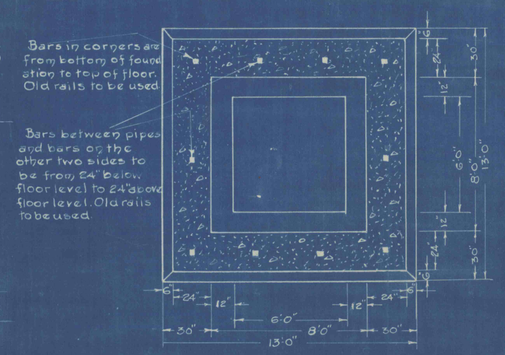

GIRARD WATER COMPANY
POTTSVILLE, PENNA
DAM AND STORAGE RESERVOIR No. 6

ON

WHISKEY MILL CREEK SCHUYLKILL CO., PA.

SECTION THRU DAM AND DETAILS

SCALES AS SHOWN

GANNETT, SEELYE & FLEMING
ENGINEERS HARRISBURG, PA.

MARCH, 1919

Drawn by	J.G.K.	3/19		
Traced by	E.S.	3/19		
Checked by	J.G.K.	4/19	Revised	7/14 8/19