


True Meridian.

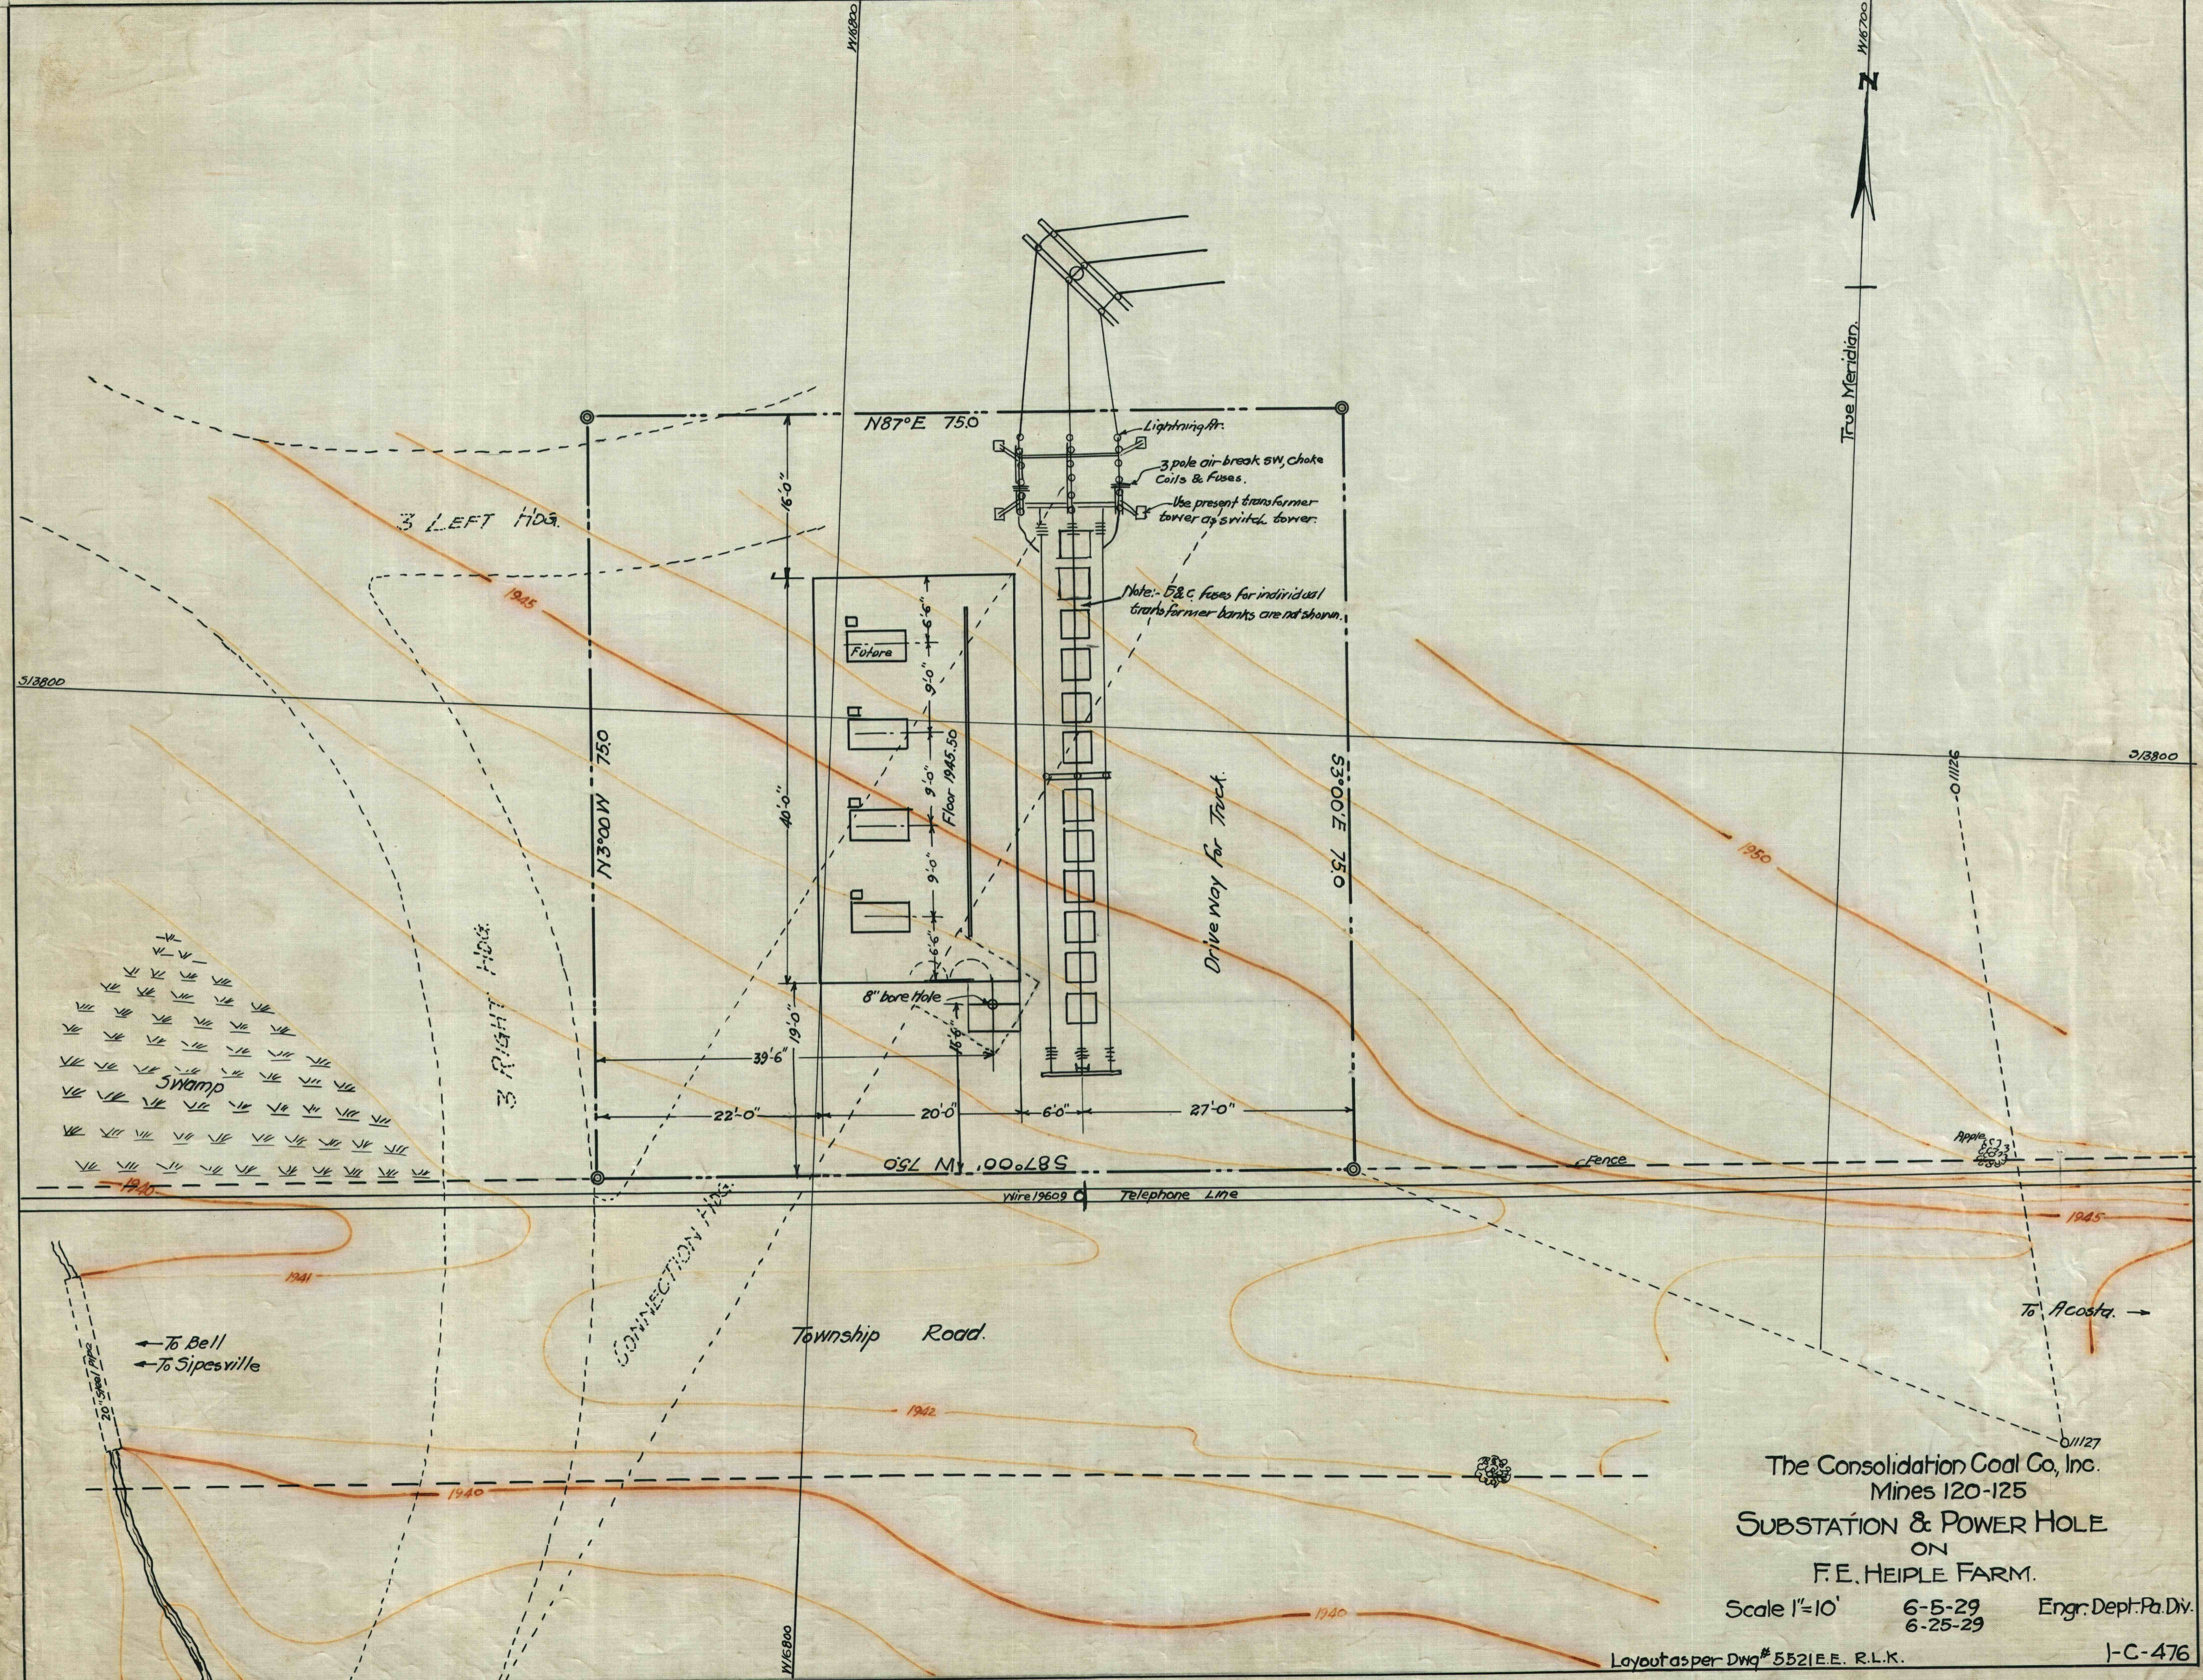

3 LEFT HDG.

3 RIGHT HDG.

N87°E 75.0

N3°00'W 75.0

S3°00'E 75.0

S87°00'W 75.0

CONNECTION HDG.

Township Road.

Telephone Line

Fence


Drive Way for Truck.

Note: - D.C. fuses for individual  
transformer banks are not shown.

Lightning Pt.

3 pole air-break sw. choke  
Coils & Fuses.

Use present transformer  
tower as switch tower.

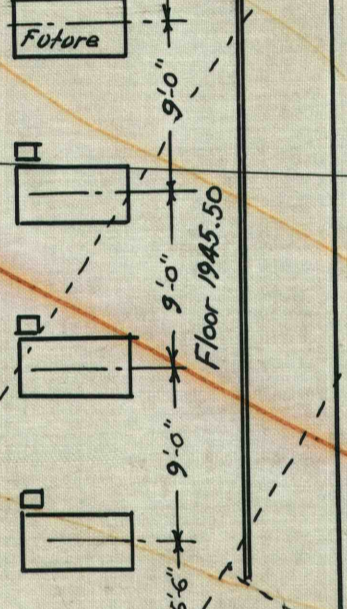

8" bore hole

Floor 1945.50

← To Bell  
← To Sipesville

To Acosta. →

The Consolidation Coal Co., Inc.  
Mines 120-125  
**SUBSTATION & POWER HOLE**  
ON  
F.E. HEIPLE FARM.

Scale 1"=10'    6-5-29    Engr. Dept. Pa. Div.  
6-25-29

Layout as per Dwg # 5521 E.E. R.L.K.

1-C-476