
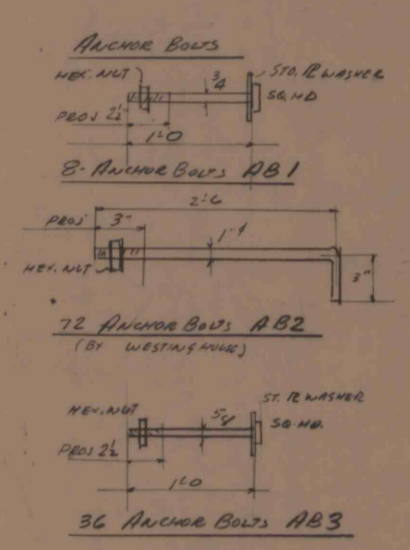


REQUIRED LIST						
NO.	NAME	RE.	NO. PCS.	DESCRIPTION	LOTH.	PC. NO.

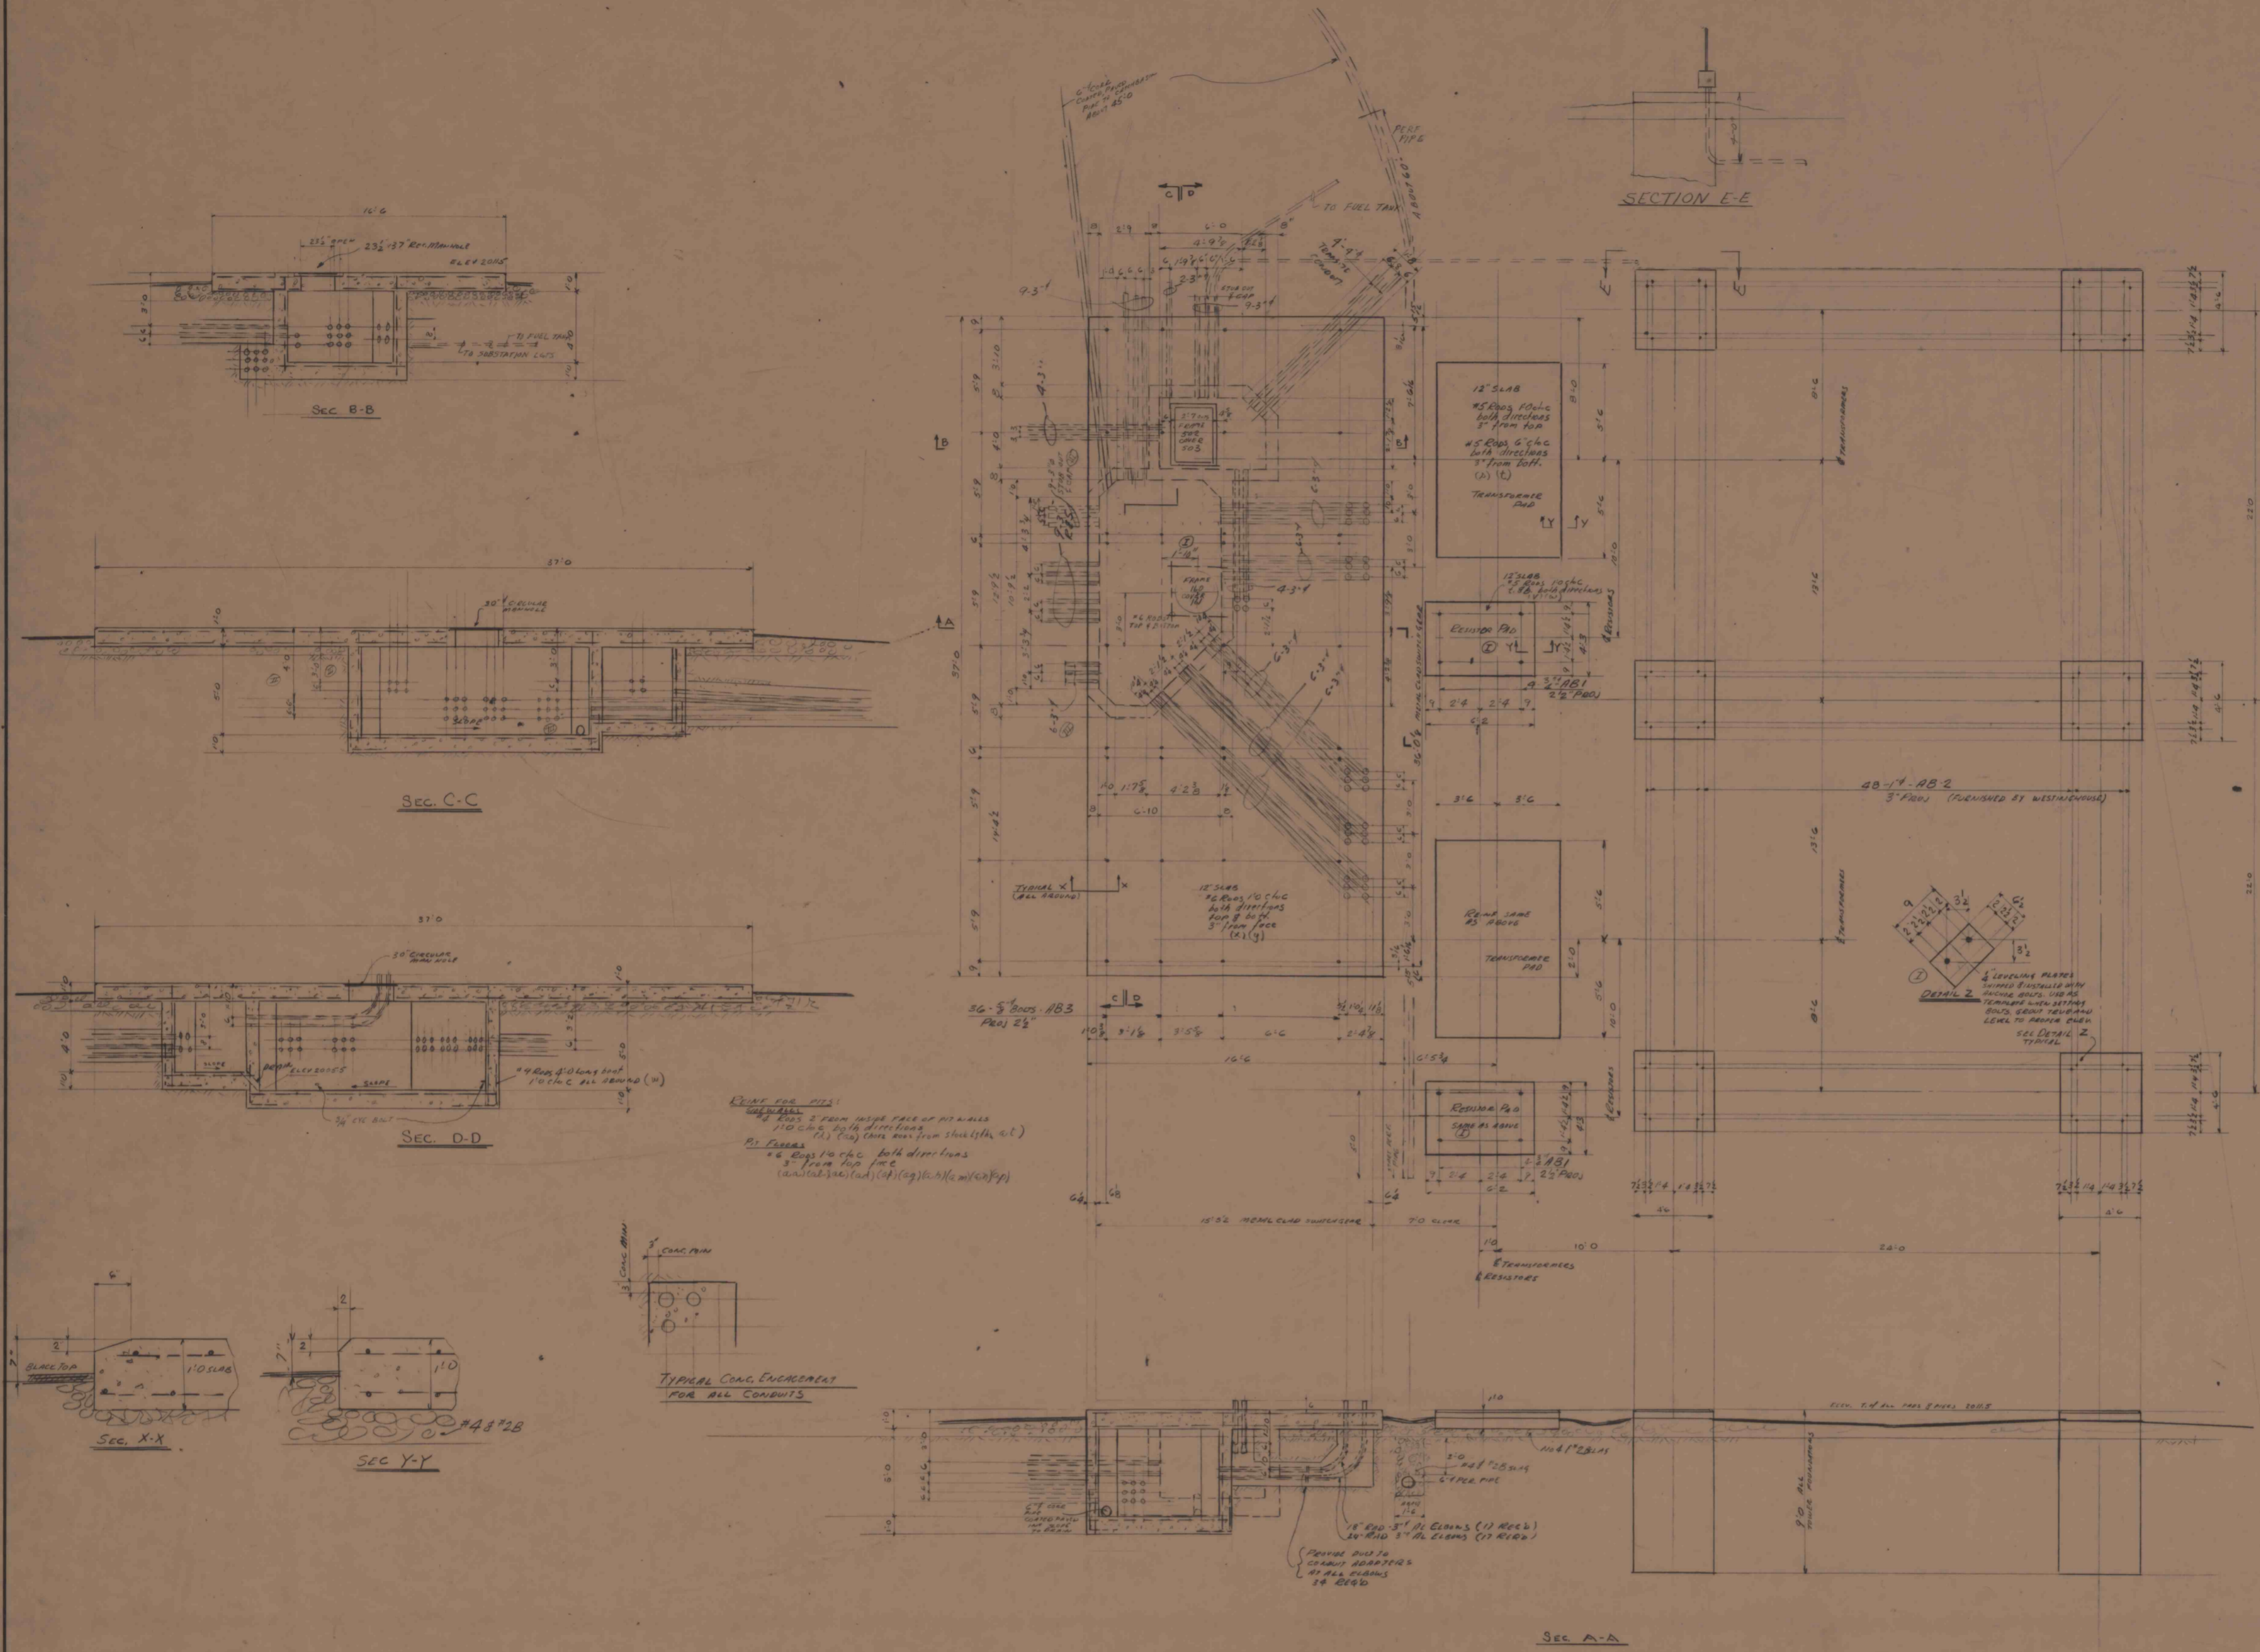

- NOTES:-
- (1) DECS SUBJECT TO DRAIN AWAY FROM ENTIRE IN ALL DIRECTIONS
 - (2) PROVIDE ABOUT 6\"/>
 - (3) PROVIDE 6\"/>
 - (4) PROVIDE GRADING AS SHOWN ON WESTINGHOUSE Dwg 0380793
 - (5) CONCRETE SHALL BE 3000 PSI CONCRETE
 - (6) UPON COMPLETION OF CONCRETE WORK A SLAB CHOKED WITH 2B AND FINES SHALL BE COMPACTED AND DRESSED AND DRAINAGE DRAIN FROM ALL PADS & TIERS
 - (7) 1\"/>
 - (8) ALL CONDUITS ARE 3\"/>
 - (9) TERMINATE DUST RUNS WITH PARCELIN DUST BELLS IN MAN HOLES.

438 D943	WESTINGHOUSE ELEC. CORP.	J	7-10-24	CS
DWG. NO.	REFERENCE	NO.	DATE	BY
FOUNDATION FOR 45KV TO 13.2KV SUBSTATION CAMBRIA SLAB				
DIVISION CAMBRIA		MINE NO. 32		
BETHLEHEM MINES CORPORATION ENGINEERING DEPARTMENT—JOHNSTOWN, PA.				
DRAWN <i>Eme</i>	DATE 6-62	ORDER NO. 9028-034		
CHECKED	DATE	SCALE 1/4\"/>		
APPROVED				
		DWG. NO. 33 L3-269		