

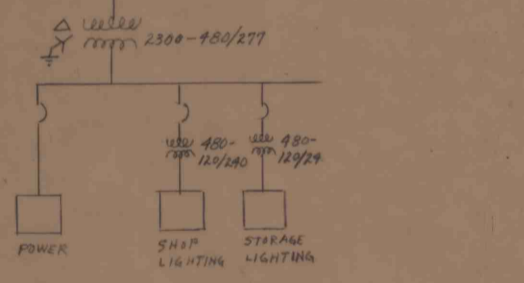
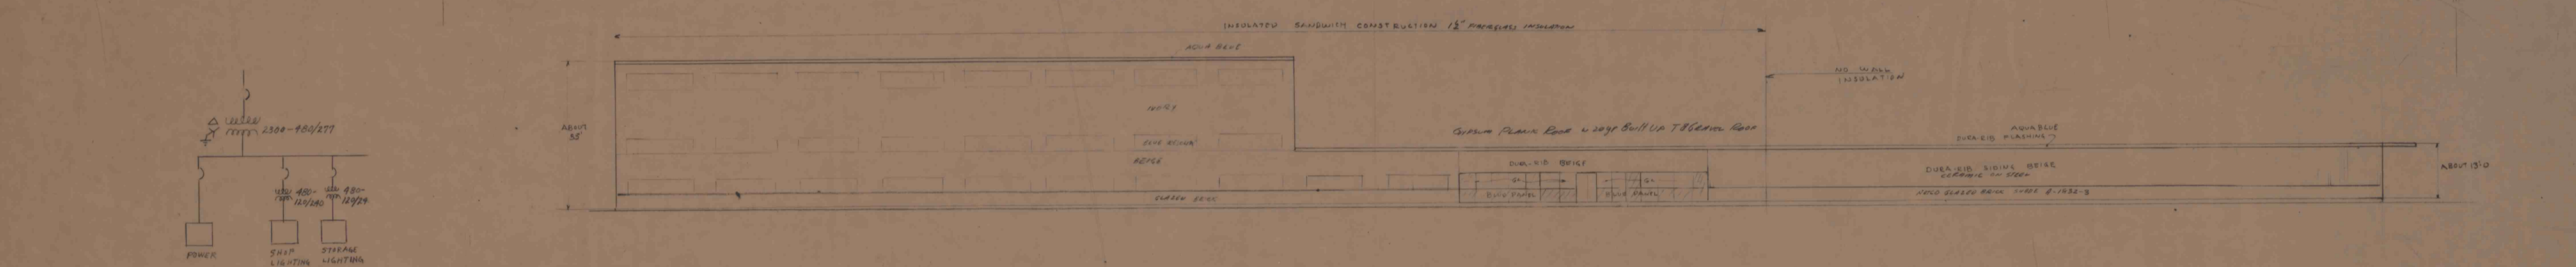


REQUIRED LIST							
NO.	NAME	MK.	NO. PCS.	DESCRIPTION	QTY.	PC. MK.	REMARKS

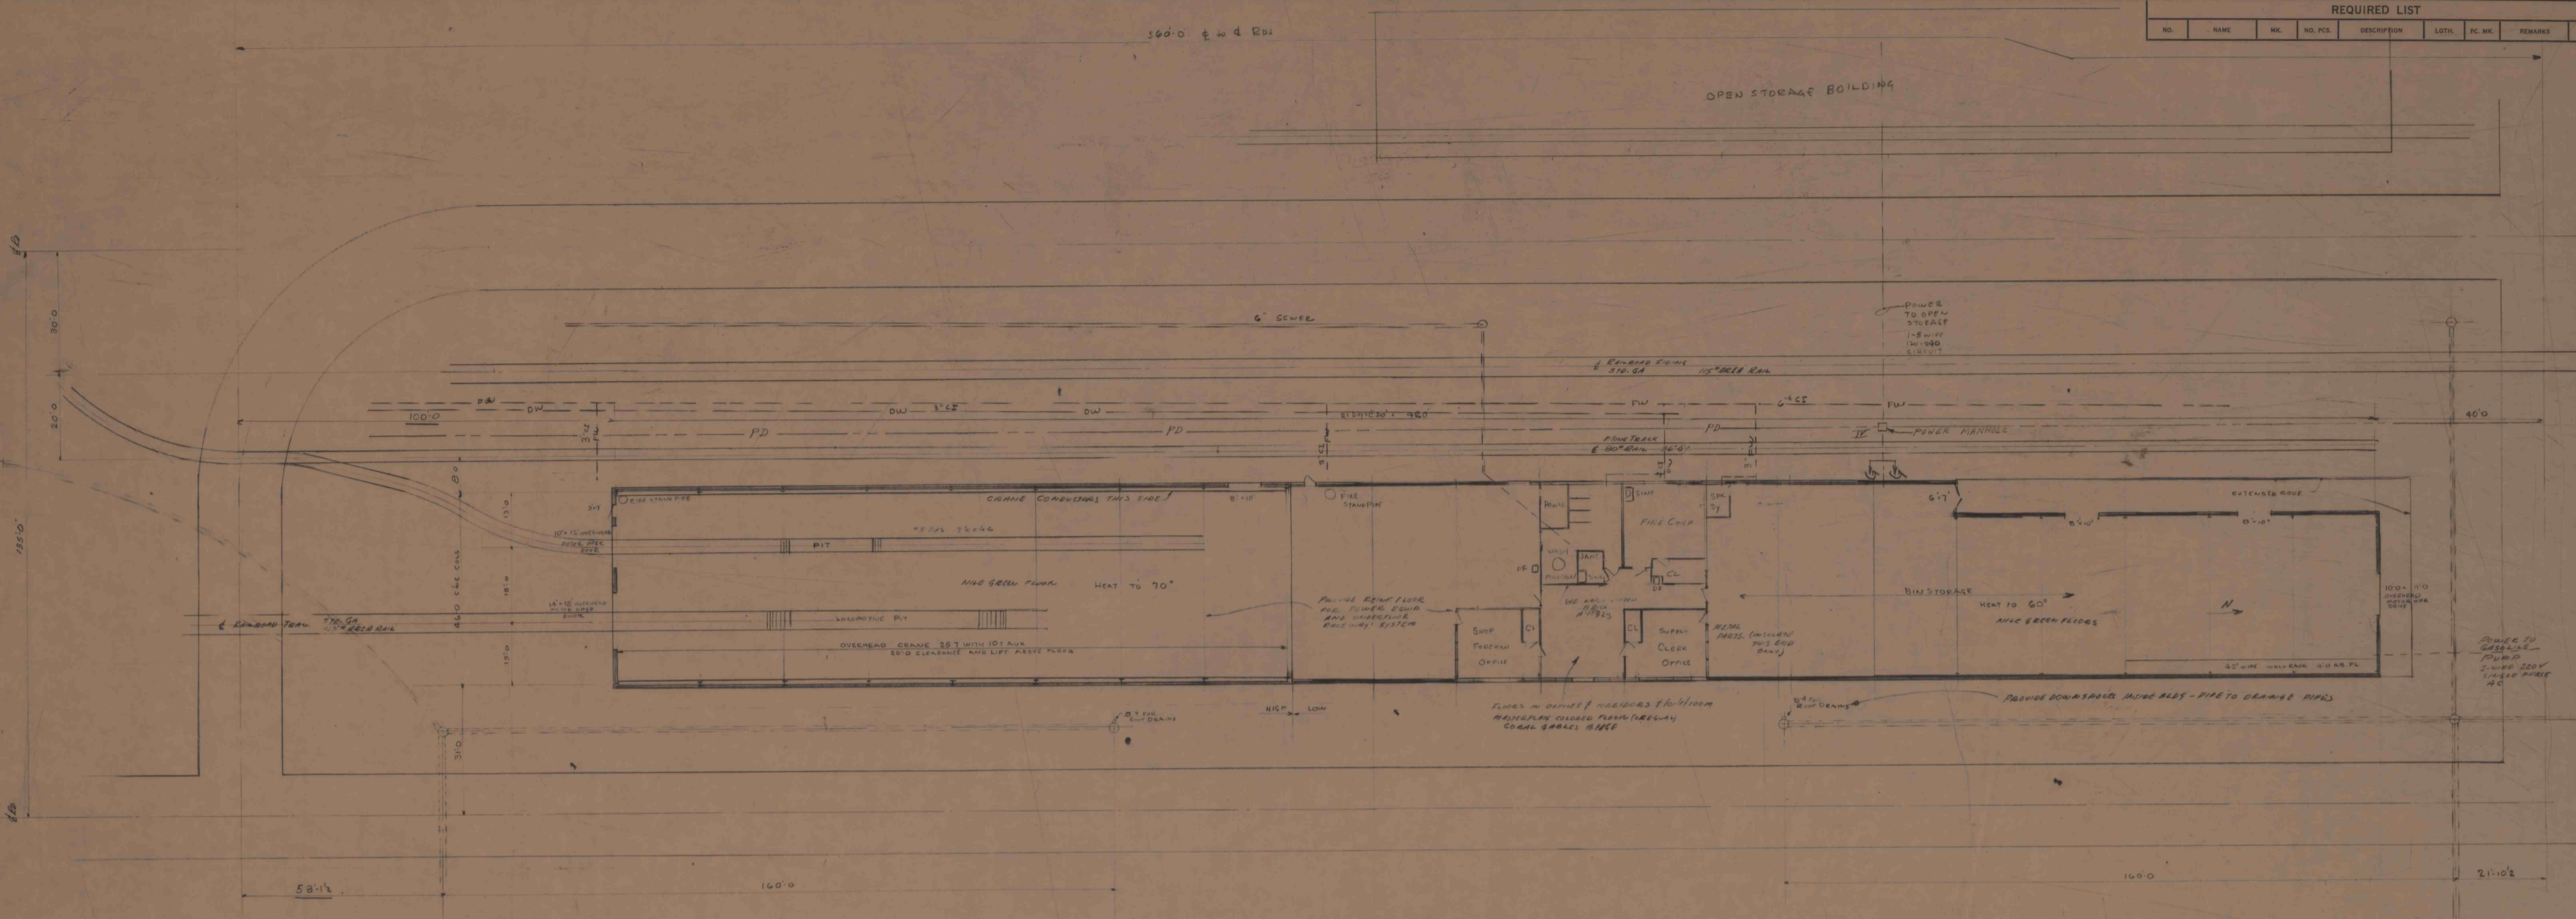

NOTE:
TRANSFORMER KVA RATING TO BE DETERMINED LATER.

ELECTRICAL POWER DISTRIBUTION

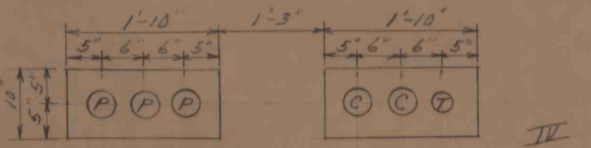

NOTES:
ALL DUCTS ARE 3" TRANSITS EXCEPT TELEPHONE DUCT IS 2" TRANSIT.
POWER TO OPEN STORAGE BUILDING SHALL BE RUN IN CENTRAL DUCT.

DWG. NO.	REFERENCE	NO.	DATE	BY

GENERAL ARRANGEMENT FOR SHOP & STORAGE Bldg.

DIVISION CAMBRIA MINE NO. CAMBRIA SLIDE

BETHLEHEM MINES CORPORATION
ENGINEERING DEPARTMENT - JOHNSTOWN, PA.

DRAWN	DATE	ORDER NO.
CHECKED	DATE	SCALE
APPROVED	DATE	DWG. NO.

II changed building to 900
III changed center area
IV added office - consult with issue